

# CBD Tenancy Lighting Assessment for Offices Rules

Version 4.1



Australian Government  
Department of Industry, Science,  
Energy and Resources



COMMERCIAL  
BUILDING DISCLOSURE  
A National Energy Efficiency Program

Published by the Department of Industry, Science, Energy and Resources

GPO Box 2013

Canberra ACT 2601 Australia

CBD Enquiry Line: 1800 020 131

Email: [info@cbd.gov.au](mailto:info@cbd.gov.au)

Website: [www.cbd.gov.au](http://www.cbd.gov.au)

This document is incorporated by reference in the *Building Energy Efficiency Disclosure Determination 2016* (BEED Determination 2016).

The Rules described in this document should only be applied by people who have received training in the application of the Rules and who are accredited assessors in accordance with the *Building Energy Efficiency Disclosure Act 2010* (BEED Act).

The Rules may specify a preferred means of assessment, or provide different options for the means of assessment. For instance, the Rules provide for both floor based and closer inspection methodologies when conducting a lighting assessment. Persons applying the rules in this publication should make their own decision on the most appropriate approach to assessment, including consideration of their safety, experience and qualifications and must comply with the safety procedures set out in Section 5.2 of these rules and elsewhere, all relevant occupational health and safety standards and workplace safety laws.

---

# Contents

<b>1</b>	<b>Introduction</b>	<b>1</b>
1.1	About CBD Tenancy Lighting Assessments for offices	1
1.2	About this document	3
<b>2</b>	<b>Key concepts and definitions</b>	<b>5</b>
2.1	The assessment process	5
2.2	Definitions	6
2.3	Interpretation	11
2.4	Non-Assessable spaces	12
2.5	Proposed new methods	15
2.6	Assessment Date and Validity Period	15
<b>3</b>	<b>Data and documentation required</b>	<b>17</b>
3.1	Acceptable Data	17
3.2	Summary of data and documentation needed	18
3.3	Site inspection	19
3.4	Documentation and Record-keeping	22
<b>4</b>	<b>Assessment Area</b>	<b>24</b>
4.1	Background	24
4.2	Determining office NLA	24
4.3	Functional Spaces	25
4.4	Documentation requirements	26
<b>5</b>	<b>Luminaire details</b>	<b>27</b>
5.1	Background	27
5.2	Safe work methods	27
5.3	Luminaire schedule	28
5.4	Lamp details	30
5.5	Identifying the ballast or control gear	34
5.6	Documentation requirements – Luminaires	37
<b>6</b>	<b>NLPD assessment</b>	<b>39</b>
6.1	Background	39

---

6.2	Identifying the General Lighting System (GLS)	39
6.3	Selecting the NLPD assessment method	40
6.4	Documentation requirements – NLPD	47
<b>7</b>	<b>Lighting control assessment</b>	<b>49</b>
7.1	Background	49
7.2	Identifying lighting control system capacity	49
7.3	Documentation requirements – Lighting Controls Assessment	53
<b>8</b>	<b>Performance comments</b>	<b>55</b>
8.1	Background	55
8.2	Performance comments	55
<b>9</b>	<b>Proposed systems</b>	<b>56</b>
9.1	Background	56
9.2	Eligibility of proposed systems	56
9.3	Assessing proposed systems	57
9.4	Documentation requirements – Proposed Systems	57
<b>10</b>	<b>Appendices</b>	<b>58</b>
Appendix A	Information checklist for certified Tenancy Lighting Assessments	58
Appendix B	Common Lamp Types	66
Appendix C	Common Lamp Types	70
Appendix D	NLPD calculation examples	71
Appendix E	Lighting Control Assessment Examples	95
Appendix F	Example documentation storage and labelling methodology	109
Appendix G	Examples of photographic evidence	110

# 1 Introduction

The Commercial Building Disclosure (CBD) Program is an Australian Government regulatory program aimed at improving the energy efficiency of commercial office buildings.

The *Building Energy Efficiency Disclosure Act 2010* (BEED Act) requires corporations selling, leasing or subleasing certain large (greater than 1,000m<sup>2</sup>) office spaces to register a **Building Energy Efficiency Certificate (BEEC)**. The **BEEC** consists of two parts:

- A National Australian Built Environment Rating System (**NABERS**) Energy for Offices rating for the building.
- A tenancy lighting energy efficiency assessment.

A CBD Tenancy Lighting Assessment (TLA) of a building is based on a methodical survey of the **general lighting system** installed in the tenant office spaces of a building (the system that is reasonably expected to be left in a tenant space when the tenant leaves and the tenancy fit out is removed).

The TLA measures the lighting power density on an area basis, and the lighting **control capacity**. It does not measure lighting output, light quality or suitability of the lighting for use in offices.

For a lighting assessment to be valid under the **BEED Act**, it must be performed in accordance with these **rules**, as amended from time to time. Assessments may be audited for compliance.

The Secretary of the Department of Industry, Science, Energy and Resources, through the CBD administrator (their delegate), assesses applications and issues **BEECs** on behalf of the Australian Government.

In addition to complying with the **rules**, **assessors** must exercise all due care and comply with all relevant occupational health and safety standards when undertaking an assessment including any COVID-19 requirements for the building being entered.

## 1.1 About CBD Tenancy Lighting Assessments for offices

A CBD Tenancy Lighting Assessment (TLA) may be completed for all of the office space in a building or for part of the office space within a building. Typically:

- A building being offered for sale would undertake an assessment of the entire building.
- A building offering tenancies for lease may assess either the whole building, or only assess the areas being offered.

A TLA comprises two key components:

- An assessment of the **nominal lighting power density (NLPD)**.
- An assessment of the **lighting control system**.

### 1.1.1 Nominal Lighting Power Density (NLPD)

**NLPD** is calculated and reported for each **functional space**. It is calculated based on the total electrical power of the **general lighting system** in the functional space, divided by the **net lettable area (NLA)** of that space. The result is expressed in **watts** per square metre (W/m<sup>2</sup>).

NLPD is graded according to the following criteria and presented in Part 2 of the **BEEC**:

NLPD	NLPD GRADE	APPEARANCE ON BEEC
4.5 W/m <sup>2</sup> or less	Very efficient	Very efficient
4.6 to 7.0 W/m <sup>2</sup>	Efficient	Efficient
7.1 to 10.0 W/m <sup>2</sup>	Somewhat efficient	Somewhat efficient
10.1 to 15.0 W/m <sup>2</sup>	Somewhat inefficient	Somewhat inefficient
15.1 to 18.0 W/m <sup>2</sup>	Inefficient	Inefficient
18.1 W/m <sup>2</sup> or more	Very inefficient	Very inefficient

### 1.1.2 Lighting control systems

**Lighting control systems** determine how lighting systems operate and are an important factor in determining the overall energy efficiency of the lighting system. The most efficient systems have the capacity to closely match lighting operating hours to actual occupancy.

The CBD TLA assesses the **control capacity** of the installed lighting control system for each **functional space** as being Good, Moderate or Poor and presented in Part 2 of the **BEEC**:

CONTROL CAPACITY GRADE	APPEARANCE ON BEEC
Good	Good
Moderate	Moderate
Poor	Poor

## 1.2 About this document

### 1.2.1 When do these rules apply?

Prior to 6 December 2021, TLAs must be completed using the version 3.1 **rules** as provided on the CBD website ([www.cbd.gov.au](http://www.cbd.gov.au)).

These updated version 4.1 **rules** replace the previous version 4.0 **rules** and will apply to all TLA applications submitted through the CBD **assessor portal** from 6 December 2021 onwards.

After this date, TLA applications will not be able to be submitted using the previous version 3.1 **rules**.

In the version 4.1 **rules**, a number of changes have been made to how TLAs are submitted. This has required updates to the **assessor portal** website.

The updated **assessor portal** will be available **for assessors** on 6 December 2021 and will allow applications to be submitted using these version 4.1 **rules**.

### 1.2.2 Who the rules are for

This document is incorporated by reference in the BEED Determination 2016 for use by CBD Accredited **assessors** and **auditors** while conducting and reviewing TLAs.

This document should only be used by people who have undertaken the CBD Accredited Assessor Training Course.

### 1.2.3 What's new in this version

In these version 4.1 **rules**, the start date has been changed to 6 December 2021. These **rules** are otherwise similar to version 4.0, with no other major changes made.

The version 4.0 **rules** included a number of important updates including:

- Updated **NLPD** grading bands
- Updated NLPD assessment methodology
- Improved definition of key terms
- Updated flowcharts and diagrams
- Updated worked examples

### 1.2.4 Related documents

These **rules** are part of a set of documents that govern how TLAs are to be carried out for offices, and audited as per the **CBD Education, Compliance and Enforcement Policy**. Other documents in the set cover:

- Rulings published on the CBD website.
- Conditions of CBD **assessor** accreditation.
- Relevant industry Work Health and Safety (WHS) guidelines.

These **rules** should be read in conjunction with the most recent version of 'The Rules – **NABERS** Energy and Water for Offices' and 'The Rules – NABERS Metering and Consumption' available on the **NABERS** website ([www.nabers.gov.au](http://www.nabers.gov.au)).

### 1.2.5 **Formatting conventions used in this document:**

Note text appearing with a grey tint in the background is explanatory text only. It is not a substantive part of these **rules**.

Text appearing **dark green and bold** is a defined term (see *Section 2.2 Definitions*). For readability, defined terms appearing multiple times on the same page have not always been bolded.



## 2 Key concepts and definitions

### 2.1 The assessment process

On completion of a TLA, the **assessor** submits it to the **CBD administrator** for checking and certification. The checks may include an independent audit of the assessment, and the resolution of any technical issues raised during the assessment. The CBD administrator may seek clarification or supplementary information especially when unusual or inconsistent items are identified in the assessment.

The main documents and tools used in preparing an assessment application are:

DOCUMENT OR TOOL	DESCRIPTION
<b>CBD Tenancy Lighting Assessment for Offices Rules (Rules)</b>	The assessment methods and standards to be applied in working out the energy efficiency of lighting for a building or an area of a building regulated under <b>the Act</b> .
<b>CBD Tenancy Lighting Assessment (TLA)</b>	An assessment of tenancy lighting, conducted as described in these <b>rules</b> .
<b>Assessor Portal</b>	The online system used by accredited assessors to submit <b>TLA</b> and <b>BEEC</b> applications to the CBD administrator, through the secure <b>assessor portal</b> . Only accessible to CBD Accredited Assessors, other persons are not permitted to utilise the assessor portal for any function.

## 2.2 Definitions

TERM	DEFINITION
<b>Acceptable Data</b>	Data which meets the applicable accuracy and validity requirements of the <b>rules</b> .
<b>Aggregate method (1, 2, 3)</b>	Method for calculating <b>nominal lighting power density</b> based on counting <b>luminaires</b> within a sample space.
<b>Aggregate method 1 sample space</b>	The sample space within a <b>functional space</b> to which the assessor applies <b>aggregate method 1</b> to assess <b>NLPD (open office areas)</b> only). Must be measured to $\pm 5\%$ accuracy.
<b>Aggregate method 2 sample space</b>	The sample space within a <b>functional space</b> to which the assessor applies <b>aggregate method 2</b> to assess <b>NLPD (open office areas plus cell office areas)</b> . Must be measured to $\pm 5\%$ accuracy.
<b>Aggregate method 3 sample space</b>	The aggregate method 3 sample space must be the entire NLA of the <b>functional space</b> , as determined by the <b>measurement standard</b> . Any <b>functional space</b> can be considered in its entirety for aggregate method 3, provided it is <b>Assessable</b> (See <i>Section 2.4 Non-Assessable spaces</i> ).  All <b>GLS luminaires</b> within the sample space must be counted, not just those within <b>open office space</b> (e.g. GLS luminaires would be counted in meeting rooms, breakout spaces, corridors etc.)
<b>Assessable</b>	A <b>functional space</b> is deemed to be <b>assessable</b> by default, where the <b>NLPD</b> and lighting controls can be adequately assessed by a CBD assessor for the purpose of completing a TLA. See <i>Section 2.4 Non-Assessable spaces</i> for situations where <b>functional spaces</b> are <b>non-assessable</b> .
<b>Assessment Net Lettable Area (NLA)</b>	All office areas within the building that are considered for the TLA assessment, including vacant areas. This is <b>different to</b> the <b>NABERS</b> rated area used in the NABERS Energy for Offices Rating. NLA is to be measured in accordance with the <b>measurement standard</b> .
<b>Assessment Date</b>	The date of the site inspection associated with the assessment. If the site inspection takes more than one day, it is the date of the first day of the inspection (only one date can be submitted).
<b>Assessment (TLA) Validity Period</b>	The period following the TLA <b>certification date</b> for which the assessment is valid. The maximum Assessment Validity Period is five years.
<b>Assessor</b>	A CBD Accredited Assessor authorised to conduct TLAs (for the purpose of a <b>BEEC</b> ) in accordance with <b>the Act</b> and the <b>rules</b> .
<b>Assessor Portal</b>	Secure online platform for <b>assessors</b> to submit TLA and <b>BEEC</b> applications. Only accessible to CBD Accredited Assessors, other persons are not permitted to utilise the assessor portal for any function.
<b>Auditor</b>	A person appointed under the <b>BEEC Act</b> to perform audits of TLAs.
<b>Average</b>	Arithmetical mean.
<b>Ballast</b>	Device connected between the power supply and one or more <b>lamps</b> primarily to limit the current drawn by the lamp(s). Ballasts may be either electronic or magnetic. A ballast discriminator may be used to differentiate between ballast types.
<b>Building Energy Efficiency Certificate (BEEC)</b>	A Building Energy Efficiency Certificate as issued by the <b>CBD administrator</b> includes: <ul style="list-style-type: none"> <li>• a <b>NABERS</b> Energy for Offices rating</li> <li>• an assessment of tenancy lighting in the office area of a building including the area that is required to meet disclosure obligations under the <b>BEEC Act</b> (2010).</li> </ul>
<b>BEEC Act (the Act)</b>	<i>Building Energy Efficiency Disclosure Act 2010</i> (the Act).

TERM	DEFINITION
<b>CBD Administrator</b>	The body responsible for administering the CBD Program, in particular for: <ul style="list-style-type: none"> <li>• establishing and maintaining the standards</li> <li>• establishing procedures to be followed in all aspects of the operation of the program</li> <li>• determining issues that arise during the operation of the program and the making of assessments</li> <li>• accrediting <b>assessors</b> and reviewing assessments in accordance with CBD standards and procedures</li> <li>• certifying TLAs</li> <li>• issuing <b>exemptions</b> and <b>Building Energy Efficiency Certificates (BEECs)</b>.</li> </ul>
<b>CBD Education, Compliance and Enforcement Policy</b>	This policy sets out the approach to facilitate compliance with <b>the Act</b> and outlines the CBD administrator’s enforcement powers under the Act. This document is available from the CBD website <a href="http://www.cbd.gov.au">www.cbd.gov.au</a> .
<b>Certification Date</b>	The date for which an assessment is certified by the <b>CBD administrator</b> .
<b>Cell Office Space</b>	An individual enclosed office containing one or more workstations.
<b>Commercial Building Disclosure Program (CBD Program)</b>	The program through which the <b>Building Energy Efficiency Disclosure Act 2010</b> is administered.
<b>Control Capacity</b>	A measure of the <b>lighting control system’s</b> capability to closely match the operation of <b>luminaires</b> with the needs of the occupants of a <b>functional space</b> . The control capacity of each assessed functional space is graded in part 2 of the <b>BEEC</b> . Grades can be “Poor”, “Moderate” or “Good”, as described in <i>Section 7 Lighting control assessment</i> .
<b>Control Gear</b>	Lighting <b>ballast, transformer</b> or any other equipment required to start and/or operate a <b>lamp</b> .
<b>Control type</b>	The kind of <b>lighting control system</b> present in a <b>functional space</b> , categorised for the purposes of assessing lighting <b>control capacity</b> . For each <b>functional space</b> , the <b>control type</b> will be either “Occupancy”, “Timer” or “Manual” control. This is determined based on which control type covers greater than 50% <b>functional space</b> area (See <i>Section 7 Lighting control assessment</i> ).
<b>Cut-out Diameter</b>	The cut-out diameter of a circular <b>lamp</b> or <b>luminaire</b> is the diameter of the circle required to be cut into a ceiling system to install that lamp or luminaire. Used in these <b>rules</b> to classify <b>LED</b> downlights into small (<150mm) and large (>= 150mm) categories as per the below example.

TERM	DEFINITION
<b>Data type</b>	<p>A category of data used in an assessment. Data types for TLAs include:</p> <ul style="list-style-type: none"> <li>• <b>Assessment net lettable area</b></li> <li>• <b>Aggregate method sample space</b> area for <b>nominal lighting power density (NLPD)</b> calculation via <b>aggregate methods</b></li> <li>• <b>Luminaire</b> details: <ul style="list-style-type: none"> <li>– <b>Lamp</b> type</li> <li>– Nominal lamp power</li> <li>– Number of lamps per <b>luminaire</b></li> <li>– <b>Ballast</b> type</li> <li>– Fitting</li> </ul> </li> <li>• Lighting controls: <ul style="list-style-type: none"> <li>– Manual switch</li> <li>– Timer</li> <li>– Occupancy sensors</li> </ul> </li> </ul>
<b>Display lighting</b>	Lighting installed for the purpose of illuminating a specific object such as an architectural feature, artwork or signage. Common in reception areas. This lighting is not part of the <b>general lighting system</b> or assessed for <b>NLPD</b> .
<b>Exemption</b>	Temporary exemption from disclosure obligations, granted on application to and review by the <b>CBD administrator</b> under the <b>BEED Act</b> .
<b>Face diameter</b>	The face diameter of a circular lamp or luminaire is the diameter of the circular outward facing surface of the lamp. Used in these <b>rules</b> to classify <b>LED</b> track lights into separate categories.
<b>Fitout works</b>	Construction activity undertaken to install, remodel, replace or remove an office fitout.
<b>Functional space</b>	A space identified by an <b>assessor</b> as a distinct space in accordance with <i>Section 4.3.1 Identifying Functional Spaces</i> .
<b>General Lighting System (GLS)</b>	<p>This is the lighting system generally used to illuminate <b>open office spaces</b> (professional judgement is required). The <b>GLS</b> lighting is typically ceiling-mounted, and may be a combination of luminaires that were provided by the base building and the tenant. It does not include desk-mounted <b>task lighting</b>, <b>display lighting</b>, or dedicated emergency lighting.</p> <p>Depending on the applicable <b>NLPD</b> assessment method, the <b>GLS</b> may also include lighting in other spaces such as <b>cell office spaces</b> and meeting rooms.</p>
<b>Grid Method</b>	A method of calculating <b>NLPD</b> where the <b>GLS</b> consists of a repeating grid of up to two <b>luminaires</b> (of the same or different types), with minimal variations.
<b>Lamp</b>	A device for generating light from electricity (excludes control and switchgear).
<b>Lamp driver</b>	Control gear for <b>lamps</b> of different types (LED, Metal Halide, etc.).
<b>LED</b>	Light emitting diode ( <b>LED</b> ), a type of <b>lamp</b> .
<b>Lighting Control System</b>	A system that controls the light output of a lighting installation in response to external inputs such as manual switches, occupancy sensors, time switches, light sensors, etc.
<b>Luminaire</b>	An electrical appliance used to create artificial light and/or illumination. It includes the body, one or more <b>lamps</b> , any control gear and any reflectors or lenses for directing the light.

TERM	DEFINITION
<b>Measurement Standard</b>	<p>The standard used for determining the <b>net lettable area (NLA)</b> of <b>functional space</b> areas for the purpose of completing a TLA, as set out in:</p> <ul style="list-style-type: none"> <li>The Property Council of Australia (PCA), Method of Measurement: Commercial, 2008 (1997 reprint)</li> </ul> <p><b>OR</b></p> <ul style="list-style-type: none"> <li>Building owners and Managers Association (BOMA), Method of Measurement, 1989 or 2017</li> </ul> <p><b>OR</b></p> <ul style="list-style-type: none"> <li>Building owners and Managers Association (BOMA), Method of Measurement (Net Rentable Area), 1985 or 2017.</li> </ul>
<b>NABERS</b>	<p>The National Australian Built Environment Rating System (<b>NABERS</b>) is a national program managed by the NSW Government and overseen by a National Steering Committee, comprised of members from the Commonwealth and all the state and territory governments.</p> <p>The NSW Government manages the operation and development of NABERS throughout Australia on behalf of the National Steering Committee.</p>
<b>Net Lettable Area (NLA)</b>	The floor area of <b>functional spaces</b> assessed for a TLA, determined in accordance with the <b>measurement standard</b> .
<b>Nominal Lighting Power Density (NLPD)</b>	A measure of the power density of the installed <b>general lighting system</b> expressed as watts per square metre (W/m <sup>2</sup> ). It is based on <b>total luminaire power</b> in a space (power of lamps plus any control gear) divided by the floor area of that space.
<b>Non-Assessable</b>	Defined area or situation where an <b>NLPD</b> calculation cannot be achieved for reasons that include but not limited to as outlined in <i>Section 2.4 Non-Assessable spaces</i> .
<b>Open office space/Areas</b>	<p>Areas within a <b>functional space</b> that are dedicated to the provision of workstations and desks for general office use, plus the associated transit areas but excluding:</p> <ul style="list-style-type: none"> <li><b>Cell office spaces</b> (individual enclosed offices containing 1 or more workstations.)</li> <li>meeting rooms</li> <li>reception areas</li> <li>specialist function rooms (i.e. other rooms that are not being used as workstation areas)</li> <li>toilets and bathrooms</li> <li>kitchens</li> <li>storage areas/ printing/ server rooms</li> <li>corridors and passageways that are walled to the ceiling on both sides.</li> </ul>
<b>Police or Security Operations</b>	These include tenancies where access by visitors, consultants and contractors is strictly limited due to the secure nature of the work being undertaken, or the security of documents or information stored on the premises. These are areas used by police or security agencies of the Commonwealth, State or Territory governments, for matters connected with criminal or security operations. Corporate security operations will not be deemed as police or security operations by the <b>CBD administrator</b> .
<b>Proposed System</b>	A lighting system which is not installed or partially installed, but for which there is a contractual commitment to install within 3 months of the <b>assessment date</b> in accordance with the requirements of <i>Section 9 Proposed systems</i> . The proposed system may result from the building owner's intention to upgrade the lighting system or from a make-good clause in the lease agreement that requires the incumbent tenant to return the lighting system to its original state when vacating the tenancy.

TERM	DEFINITION
<b>Reflected Ceiling Plan (RCP)</b>	A reflected ceiling plan (RCP) shows a view of the area as if looking from above, through the ceiling, which shows the reflected image of the ceiling above. This convention maintains the same orientation of the floor and ceilings plans - looking down from above.
<b>Rules</b>	CBD Tenancy Lighting Assessment for Offices Rules (this document).
<b>Submission Deadline</b>	The 122 calendar day period that TLA applications can be submitted to the <b>CBD administrator</b> following the <b>assessment date</b> .
<b>Substantive Provisions</b>	Core provisions of the <b>rules</b> as required to satisfy the <b>BEED Act</b> . This includes all sections of the <b>rules</b> that are not marked as explanatory text (highlighted with a grey tint in the background).
<b>Supervisory Control System</b>	A high level lighting control system, similar to a BMS that allows for programming of time schedules for lighting control.
<b>Task lighting</b>	Lighting installed for the purpose of illuminating a particular task and switched independently of the <b>general lighting system</b> . For example, moveable lighting that is mounted on the desk or the workstation. This lighting is generally not included in the <b>general lighting system</b> or assessed for <b>NLPD</b> .
<b>Total Luminaire Power</b>	The total nominal power rating of a <b>luminaire</b> including the <b>lamps</b> and any associated control gear.
<b>Transformer</b>	Magnetic transformer or electronic step-down converter used to reduce voltage for extra low voltage (typically 12V) lighting systems.
<b>Watt/Wattage</b>	Unit of electrical power, equivalent to one joule per second energy use, corresponding to the rate of consumption of energy in an electrical circuit.

## 2.3 Interpretation

### 2.3.1 Current version

**The rules** are revised from time to time.

Assessments must comply with the version of the **rules** current on the day the assessment is submitted, unless the **CBD administrator** has specifically approved otherwise.

All new versions of the **rules** are published on the CBD website [www.cbd.gov.au](http://www.cbd.gov.au).

### 2.3.2 Technical Advice from CBD Administrator

These **rules** are intended to cover most commercial office buildings in Australia. However, it is always possible that some aspect of a building's design or operation raises a new issue that is not clearly covered by the **rules**.

Whenever **assessors** are unsure how to apply the **rules** to a particular issue or situation, they must contact the **CBD administrator** for technical advice.

Assessors will receive emails notifying them of the technical advice and should ensure their email address with the CBD administrator is current. The advice given may be added to future versions of the **rules** and assessors should ensure they are always consulting the correct version of the **rules**.

### 2.3.3 Precedence

#### Technical advice from CBD Administrator

Technical advice from the **CBD administrator** always takes precedence if there is any conflict with any other provision of these **rules** or a Ruling. If there is a conflict between different technical advices, the most recent advice takes precedence.

#### Rulings by the CBD Administrator

Rulings made by the **CBD administrator** will take precedence over these **rules** if there is any conflict.

#### Secondary material

These **rules** include some material which is secondary to the **substantive provisions**, including:

- introductions and explanations (such as summaries, flowcharts, diagrams, notes and examples) intended only to help readers understand its Substantive Provisions.
- forms and notices intended only to assist in conducting an assessment.

The **substantive provisions** of these **rules** always take precedence if there is any misunderstanding or conflict<sup>1</sup> with any other:

- material contained in these **rules**.
- documentation or forms associated with TLAs.

## 2.4 Non-Assessable spaces

A **functional space** may be deemed **non-assessable** only if strict criteria are met. These criteria are subject to the discretion of the **CBD administrator**.

A CBD **assessor** may request the **CBD administrator** deem a **functional space** to be **non-assessable** if it is:

- Used by **police or security** Agencies of the Commonwealth, State or Territory governments, for matters connected with criminal or security operations.

**OR**

- The space cannot be assessed for technical reasons, justified by the assessor to the satisfaction of the **CBD administrator**.

By default all functional spaces are considered to be **assessable** unless the above criteria are satisfied. Specific **non-assessable** technical reasons include:

- The **functional space** area is smaller than 50m<sup>2</sup>.
- The **functional space** does not contain at least 50m<sup>2</sup> of **open office space**.
- **Open office space** in the **functional space** does not make up at least 15% of the total functional space area.
- No lighting is installed in the **functional space** and there is no contractual agreement to install a **proposed lighting system** within three months of the **assessment date**.

*Figure 1* provides a flow chart detailing these requirements.

The **CBD administrator**'s policy is to allow a whole TLA to be marked as **non-assessable** where the lighting systems do not exist, or the entire building is a **police or security operation**, to allow a **BEEC** application to proceed where there is a valid and approved **NABERS** rating for that building.


**Assessors** are encouraged to contact the **CBD administrator** to discuss specific scenarios, noting the CBD administrator will determine, at their discretion, whether a **functional space** is **non-assessable**.

---

<sup>1</sup> Contact the **CBD Administrator** if you believe that a section of the **Rules** is inconsistent with another section or with other documentation or forms.



**Figure 1: Flow chart to confirm if a functional space is assessable**

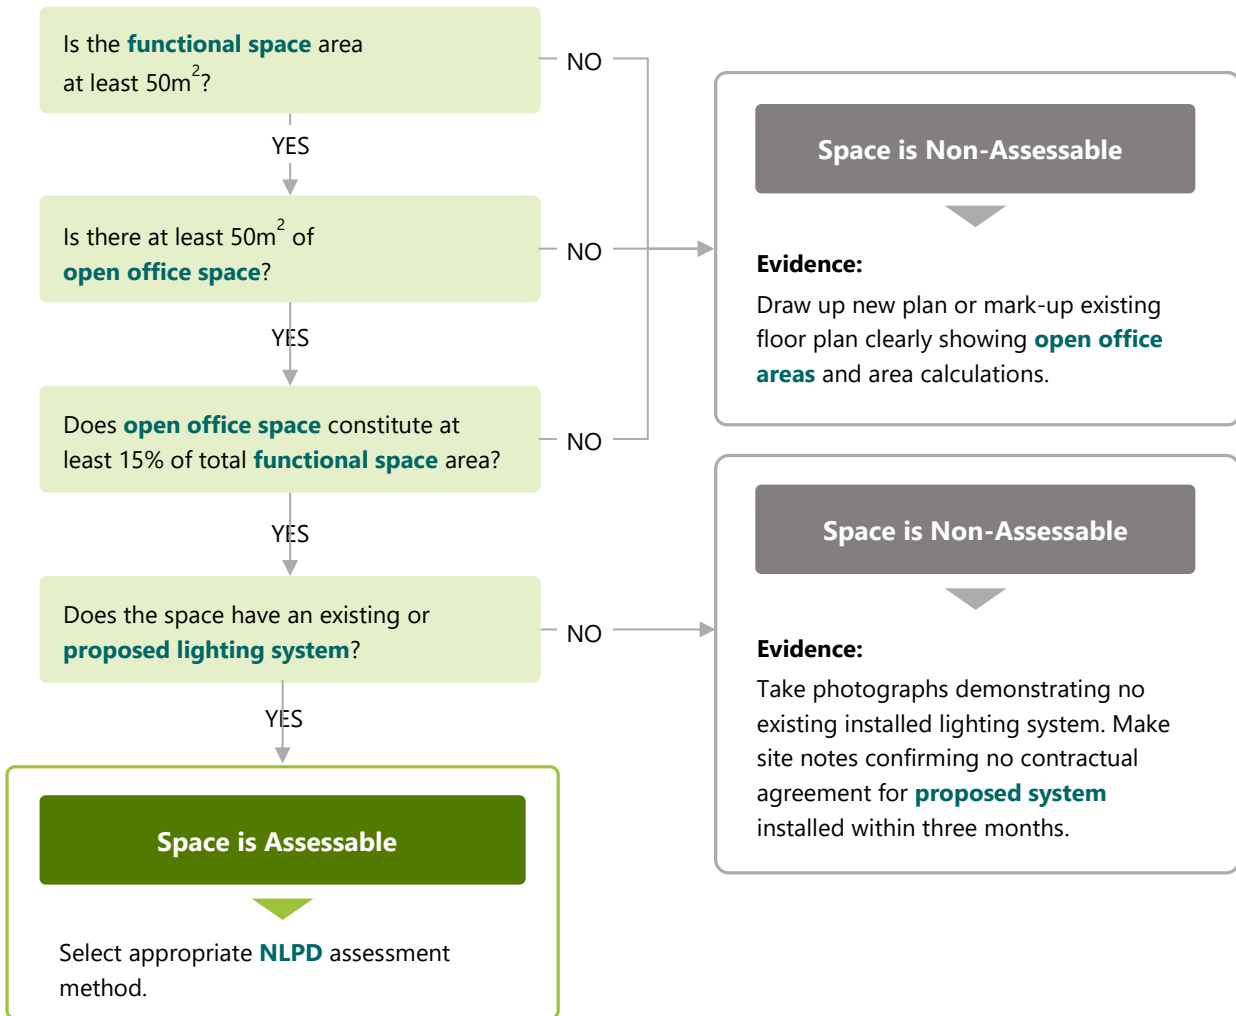

## 2.4.1 Police or Security Operations

**Functional spaces** used for **police or security operations** are to be deemed **non-assessable**. However, the **assessor** must detail the tenant and the nature of police or security operations and may be required to provide evidence.

Note that the coverage of this section is intended to cover matters of national and criminal security; corporate security areas will not be deemed as **non-assessable** by the **CBD administrator**.

## 2.4.2 Documentation required – Non-Assessable Spaces

The **CBD administrator** will determine, at their discretion, whether a **functional space** is **non-assessable**.

Where **functional spaces** are deemed **non-assessable** an **assessor** must retain the following documentation, complying with *Section 3.1 Acceptable Data*:

### Lack of open office space:

- Floor plan **OR assessor** sketch (either to scale, or not to scale but sufficiently dimensioned to demonstrate area calculations) clearly showing the **functional space** has less than 50m<sup>2</sup> of **open office space**. Add additional evidence with photographs where possible.

**OR**

- Floor plan **OR assessor** sketch (either to scale, or not to scale but sufficiently dimensioned to demonstrate area calculations) clearly showing the **functional space** has less than 15% **open office space**. Add additional evidence with photographs where possible.

### No existing or proposed lighting system:

- Photographs demonstrating there is no existing lighting system.

**AND**

- Site notes confirming there is no contractual agreement for a **proposed lighting system** to be installed within three months of the **assessment date** (see *Section 9 Proposed systems*).

### Police or security operations:

- Site notes identifying the tenant organisation and the nature of the **police or security operations** in the **functional space**.

**AND**

- Written response (email or letter) from a senior member of the **police or security organisation** to confirm that access will not be granted to the **functional space** to complete the assessment.

## 2.5 Proposed new methods

**Assessors** may find they need to use a new method for obtaining or interpreting data for an assessment. For example, they may encounter a new lighting technology or control system strategy; or they may need to develop a proposed new method to use available data acceptably.

**Assessors** who wish to use a new method must contact the **CBD administrator** to request approval beforehand. The request should include:

- a complete explanation of the circumstances, including the reason why an existing method cannot be used.
- a complete explanation of the method proposed and all calculations required.
- an analysis of the possible error involved in use of the method.

### 2.5.1 Standard for Acceptable data

The standard for **acceptable data** for a new method will be specified when the method is approved by the **CBD administrator**. In general, data must be derived from measurements or records which have been independently verified and are known to be accurate by a third party without a significant interest in the operation or performance of the building or its equipment (such as a consultant or technician engaged to provide independent advice) or by the **assessor**.

### 2.5.2 Documentation required

The documentation required for a new method will be specified when the method is approved. In general, it must include copies of the original records which the method requires for data, and documentation of all calculations, assumptions, and interpretations involved.

## 2.6 Assessment Date and Validity Period

### 2.6.1 Assessment timing

A TLA must be submitted to the **CBD administrator** within 122 days from the first **assessment date**, unless the **CBD administrator** allows extra time to compensate for time taken to issue technical advice before the application could be submitted.

The **CBD administrator** may accept, at their discretion, applications submitted after the **submission deadline** has passed.

### 2.6.2 Assessment Validity Period

Where the TLA is submitted within 122 days of the first **assessment date**, or a longer period approved by the **CBD administrator** as above, the approved TLA will be valid for up to five years from the **certification date** (the date the assessment is certified by the **CBD administrator**).

### 2.6.3 Amending certified TLAs

**Assessors** will be able to amend specific **functional spaces** of a certified TLA within a certified **BEEC** through the **assessor portal**, if requested by the building owner or their agent. The process is just like a new assessment but only for the specific functional spaces requested/mentioned by the owner.

The **assessors** will have to confirm with **CBD administrator** that they have been requested to amend the TLA. Amending the certified TLA will not extend the **assessment validity period** of the original TLA, it will maintain the original expiry date.

# 3 Data and documentation required

This section deals with the principles and standards of data and documentation requirements including site inspection, record-keeping and how to proceed when access or information is denied. Data and documentation requirements are specified in detail in *Appendix A: Information checklist for certified Tenancy Lighting Assessments*.

## 3.1 Acceptable Data

### 3.1.1 Principles

#### Data must be as specified

A TLA must be based on the data specified in the relevant:

- provisions of the **rules**.
- sections of the **assessor portal**.

#### Data must be of acceptable standard

The decision process for determining **acceptable data** in *Section 3.1.2 Standards for acceptable data* must be followed, except where another process is specifically allowed by a provision of these **rules**.

### 3.1.2 Standards for acceptable data

If accurate and verifiable data is available, it must be used. The following order of preference applies, subject to any specific requirements applied in the relevant provisions of the **rules**:

- 1) Accurate and verifiable data obtained directly by the **assessor** (such as reading the **nominal lamp power** from the label of an installed **lamp**) and appropriately documented.
- 2) Data provided by a third party without a significant interest in the operation or performance of the building or its equipment (such as a consultant or technician engaged to provide independent advice) which has been authenticated by the **assessor**.
- 3) Data provided by the organisation commissioning the assessment, or a third party with a significant interest in the operation or performance of the building or its equipment (such as a facility manager, technical contractor or equipment supplier) which has been authenticated by the **assessor**.

#### Data authentication

**Assessors** can authenticate collected data using the following simple steps:

- 1) Check that information provided by the third party or organisation is reasonable for what was observed on site i.e. general tenancy layout, tenancy boundaries consistent with the **measurement standard**.
- 2) Obtain the name and company name of the person providing the information, and document this in site notes or filing of relevant emails/correspondence for audit.

### Unacceptable data

If information is required for an assessment but none of the requirements in this section can be satisfied, the functional space cannot be assessed.

Note: Some sections of the **rules** provide that, if specific procedures are followed for some input data, the requirement for compliance with *Section 3.1.2 Standards for acceptable data* is then deemed to be satisfied.

## 3.2 Summary of data and documentation needed

The following information is required for a TLA. Individual assessments may also require additional information or documentation depending on the particular circumstances of the premises.

A more detailed checklist is included in *Appendix A: Information checklist for certified Tenancy Lighting Assessments*.

TOPIC	DATA AND DOCUMENTATION NEEDED
<b>Information about the assessment application</b>	Information about the: <ul style="list-style-type: none"> <li>• premises to be assessed.</li> <li>• person or organisation commissioning the assessment.</li> <li>• date of assessment.</li> <li>• <b>Assessor</b> name and ID.</li> </ul>
<b>Assessment NLA – the NLA of the building or tenancy areas being assessed.</b>	Lease documents, or documentation of subsequent negotiations and changes, showing office tenancy boundaries. Survey, lease or third-party data.
<b>Luminaire details</b>	A schedule of all <b>luminaires</b> used in the assessment including the quantity, type and power of <b>lamps</b> and the type of any <b>ballast</b> or <b>transformer</b> in the luminaire. Where <b>total luminaire power</b> is used, the source of the information on which the total luminaire power is based e.g. direct measurement, manufacturer's data etc.
<b>Aggregate method sample space area</b>	Details of the assessed area that are used in <b>aggregate method NLPD</b> calculations including a mark-up of floor plans showing the extent of the <b>aggregate method sample space area</b> .
<b>Proposed system documentation</b>	Details of the contractual arrangements that triggered the assessment of the <b>proposed system</b> and a copy of all documentation that the assessment of the proposed system was based on.
<b>Lighting Control System documentation</b>	Details of lighting <b>control type</b> and sketch or commentary demonstrating the coverage of the occupancy or timer control system.

## 3.3 Site inspection

### 3.3.1 Site visit requirement

**Assessors** are required to visit and inspect the premises during their assessment. This is in order to:

- become familiar with the layout, services and features of the premises.
- confirm that documentation provided for the assessment is accurate, complete and up-to-date.
- identify all luminaires that are to be used in the assessment.
- count luminaires where relevant.
- take photographs of ceiling grids.
- take close up representative photographs of assessed **luminaires** and **lamp** types.
- confirm the definition and boundaries of all functional spaces.
- gather sufficient information to enable calculation of the **NLPD** in each **functional space**.
- determine the appropriate NLPD assessment methodology for each functional space; either the **grid method** or an **aggregate method**.
- measure **aggregate method sample spaces** where applicable.
- identify the type of **lighting control system** that applies to each functional space.
- resolve any other issues relating to the assessment.

An **assessor's** inspection of the premises is expected to include a physical check of all functional spaces being assessed.

The assessor who lodges a TLA must be the same assessor who completed the site visit.

Note: **BEEC applications** can be lodged by any CBD assessor with the appropriate approved TLA and **NABERS** reference numbers.


### 3.3.2 Process for dealing with denial of access or information

There may be circumstances where the **assessor** is denied access to a **functional space**, or information held by a tenant, which is necessary to complete an assessment.

To assist assessors to manage a denial of access or information the following process chart (*Figure 2*) has been prepared to guide **assessors** through the process.

If you have any questions about managing the process at any time, call the CBD enquiry line on 1800 020 131 or refer to the TLA Access Fact sheet. The Fact Sheet will be made available to **assessors** by sending a request to [info@cbd.gov.au](mailto:info@cbd.gov.au).

**Figure 2: Process for dealing with denial of access or information flow chart**

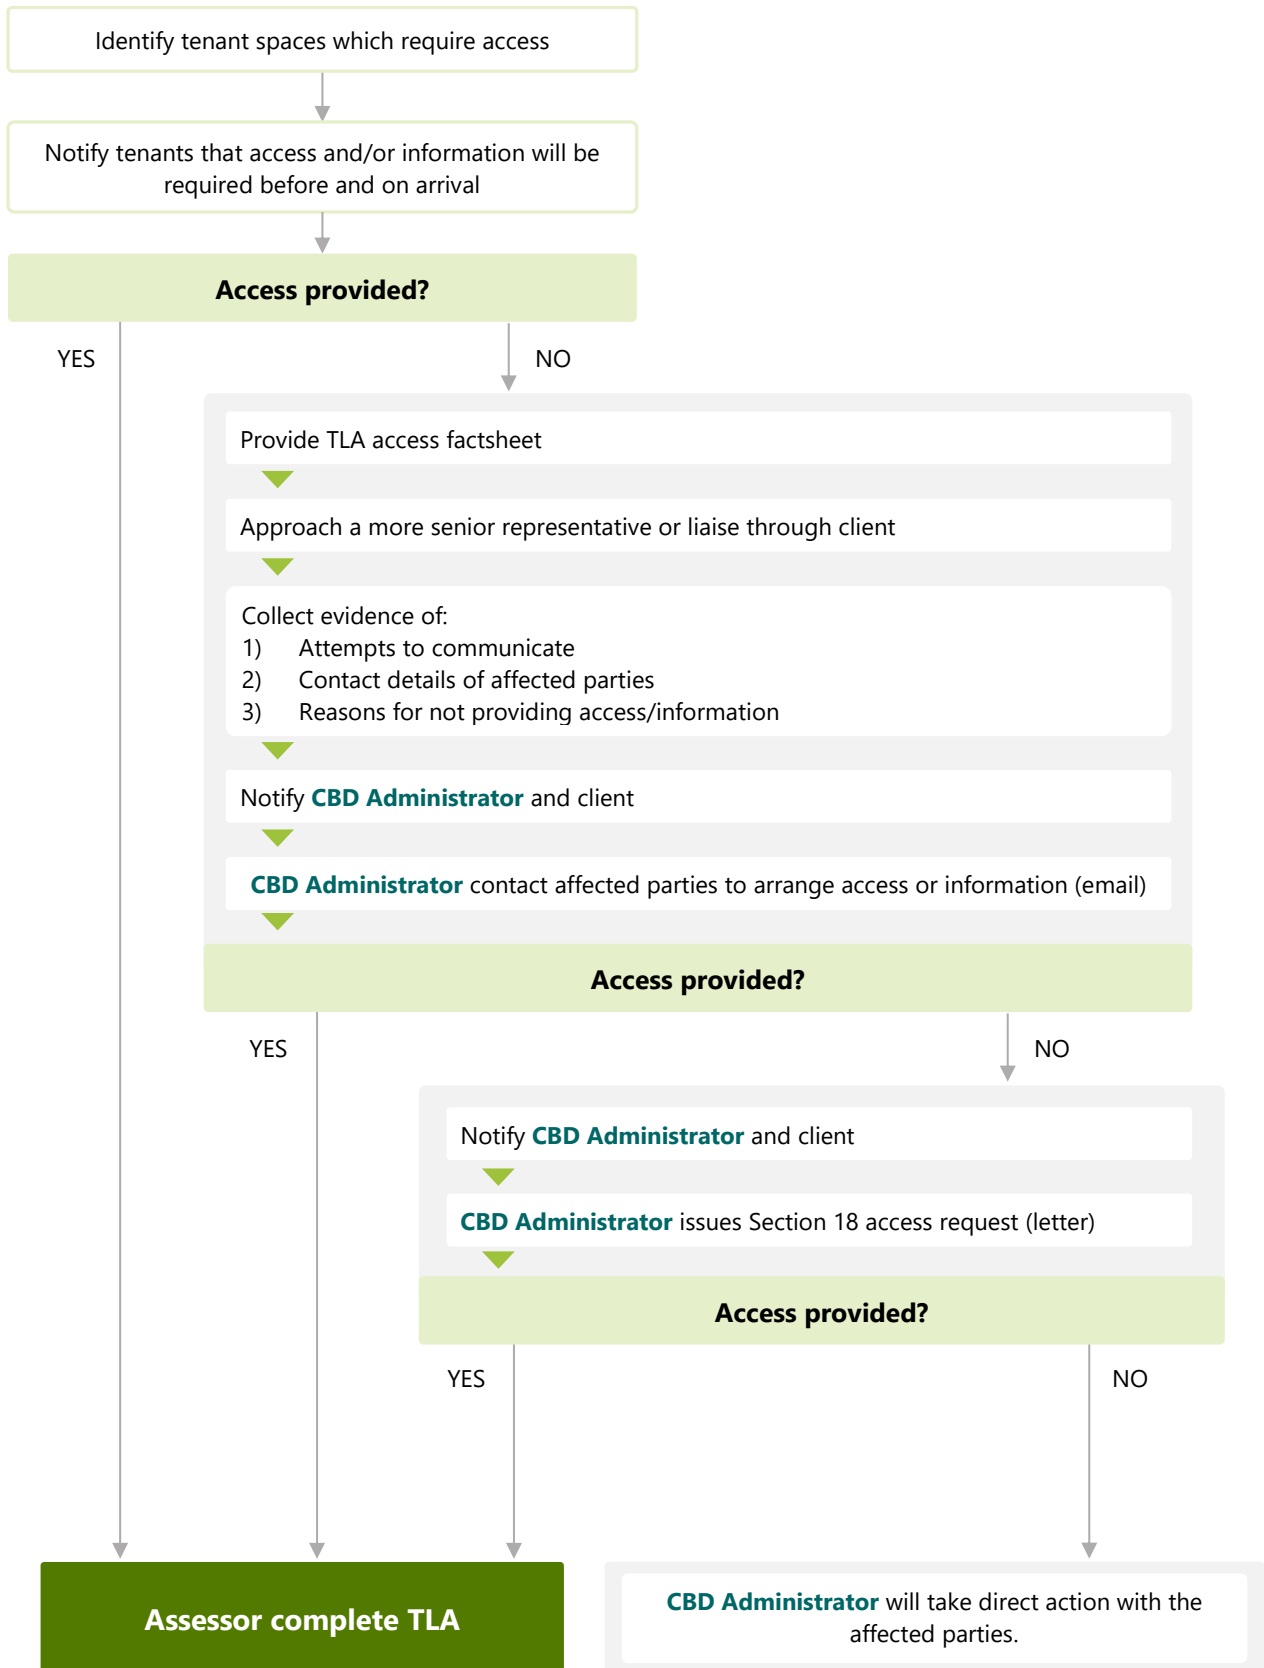



**Assessors** cannot directly demand information via a formal notice. Assessors are required to notify the **CBD administrator** of a denial of access or information once reasonable attempts have been made to obtain access or information.

These attempts should include:

- Contacting a more senior representative from the affected party.
- Liaising through the assessor's client to attempt to obtain access or information.
- Providing the affected party with the TLA Access Fact Sheet detailing the legal framework under which assessors can request access and information.

Following this notification the **CBD administrator** may:

- issue an informal request for access of information to the affected party.
- issue a formal request for access or information (Section 18 request).

It is important to keep the **CBD administrator** informed of any developments once a Section 18 request is issued. For example, if the tenant makes contact to re-iterate their refusal, or complies with the request, the **assessor** must inform the CBD administrator.

Where a Section 18 request is not complied with, an **assessor** may contact the CBD administrator for further assistance.

If a Section 18 request is not complied with, the **CBD administrator** may choose at their discretion to enforce the notice. This may be done by issuing an infringement notice (a fine) or commencing court proceedings.

However, in most cases, such as where the majority of space is **non-assessable**, it will be appropriate to simply mark the relevant area as non-assessable and continue with the TLA. This will allow the building to obtain a **BEEC** and meet disclosure obligations, as long as a certified **NABERS** rating has also been completed.

The TLA Access Fact Sheet contains a summary of the reasons why access or information may be required by an **assessor**. The Fact Sheet will be available to assessors by sending a request to [info@cbd.gov.au](mailto:info@cbd.gov.au).

### 3.3.3 Safety and security considerations

There may be circumstances where access to all or part of the premises is not possible on safety or security grounds (see also *Section 2.4.1 Police or Security Operations*). In this event the **assessor** must explain why they could not access these spaces, and fully document the reasons on the **assessor portal**.

If there are known impacts on the quality of the information obtained for the assessment then these must also be fully described.

Importantly, if an assessor is concerned that a space is unsafe, they should not enter the space until they have assurance that the space is safe and/or have adequate processes and measures in place to ensure safety as per *Section 5.2 Safe work methods*.

## 3.4 Documentation and Record-keeping

### 3.4.1 Documentation required

It is not essential that the records obtained for an assessment are the original documents, such as signed leases. An assessment may be based on copies of leases and other records provided that the **assessor** is satisfied that they are, or can be verified to be, true and complete records of the original documents or files.

Photographs of **luminaires** and lighting arrangements and repeating grids taken on the **assessment date** are required documentation.

Summaries, or other derivative documents that quote the original source documents, are not the same as verifiable copies of the originals. If used, the **assessor** needs to be satisfied that these are true and correct sources of required data.

### 3.4.2 Records to be kept seven years for audit

**Assessors** must keep for audit all records on which an assessment is based, including records of assumptions made and all information and calculations used, for seven years from the date the assessment was lodged with the **CBD administrator**.

Where an **assessor** undertakes an assessment as an employee or contractor of a company, it is the **assessor's** responsibility to ensure that records of the assessment are kept for the seven year period such that they can be made available to the **CBD administrator** on request.

### 3.4.3 Records to be kept by assessors

The records kept must be the actual documents used for the assessment, or verifiable copies. If summaries are used, the **assessor** needs to be satisfied that these are true and correct sources of required data.

The documentation requirements for each component of the assessment are provided in the relevant sections of these **rules**.

The records kept by assessors must be to such a standard that it would be possible for another assessor or an **auditor** to repeat accurately the assessment from only the documents provided.

### 3.4.4 Auditing

The BEED Act provides for a system of auditing and verification of assessments undertaken by CBD Accredited Assessors, carried out for the purpose of applying for a **BEEC**.

If an assessment is selected for an audit, the **CBD administrator** will contact the **assessor** and request all the documentation and records used in the assessment.

An assessment may be selected for audit at the time of submission, at which time material for the audit will be required to be provided.

A TLA can also be audited up to 7 years from the date of certification.

The BEED Act also provides for actions in consequence of an unsatisfactory audit outcome. For further information, refer to the [BEED Act](#) and the guidance on auditing and compliance available on the CBD Website ([www.cbd.gov.au](http://www.cbd.gov.au)).

### 3.4.5 Records lodgement

Where a CBD **assessor** is moving to a new employer, ceasing to be an **assessor** or is otherwise in a position where they would have difficulty in maintaining records for a certified TLA which may be subject to audit, they may, with the agreement of the **CBD administrator**, lodge these records with the **CBD administrator**.

This must include all documentation and records used in the assessment in a form suitable for audit.

The **CBD administrator** may also request records at the time of lodgement to secure these records for future audit. This may be when an **assessor** has indicated they are ceasing work as an **assessor**, or when their accreditation lapses. This is to ensure that documentation for an audit is secure, complete and accessible if the assessment is selected for audit.

## 4 Assessment Area

### 4.1 Background

The assessment area is the **NLA** of the office space being assessed for the purposes of a TLA (**Assessment NLA**). All office space is included in the assessment regardless of its condition or whether or not it is occupied.

The TLA is based on a rate (W/m<sup>2</sup>) that does not generally depend on total **functional space** area, therefore precise measurement of the total **assessment NLA** is not always critical to the assessment. However, for individual spaces where an **aggregate method** is used, accurate measurement is required.

The **assessment NLA** indicates the overall coverage of the assessment, whether compliance with **the BEED Act** is required, and the relative importance of the assessment of each **functional space**.

The **assessment NLA** for TLAs will often differ from the 'NABERS Rated Area' for the same building (total m<sup>2</sup>). This can be due to a variety of factors including exclusions from the NABERS rated area due to vacancies and non-office spaces such as meeting rooms, server rooms etc.

The **CBD administrator** does compare the 'NABERS Rated Area' to the TLA assessment **NLA** as part of the standard application checking process, particularly for TLAs where **assessors** have indicated that they cover all office space in a building.

### 4.2 Determining office NLA

The **assessment NLA** must be determined and documented by the **assessor**. It is expected that the information will be provided by the building owner at the time of commissioning the assessment.

The assessor's assessment of the office NLA must be based on one of the following methods:

- 1) Reference to a third-party survey or to lease documentation that is explicitly based on the **measurement standard** for **functional space** area or, if not available;
- 2) Direct measurement from current plans or scaled prints, measured to the measurement standard for functional space area, or, if not available;
- 3) Site measurements verified by the assessor to have been done to the measurement standard for functional space area.

Note that  $\pm 5\%$  accuracy is required for the assessment of **aggregate method sample space area** (see *Section 6.3.4, 6.3.5 and 6.3.6*) or assessment of repeating grid area (see *Section 6.3.3 Grid Method*).

## 4.3 Functional Spaces

### 4.3.1 Identifying Functional Spaces

The premises to be assessed must be divided into **functional spaces** in order to clearly identify where lighting efficiency may vary from one part of a building to another. These spaces should be based on existing functional distinctions such as physical boundaries, leases, or operational divisions.

**Functional spaces** must be the smaller of:

- 1) each individual contiguous floor of the building (for buildings with multiple units or towers, each floor of each unit or tower).
- 2) each individual and distinct tenancy, regardless of its size.

A TLA must include assessments of each functional space within the **assessment NLA**.

**Assessors** should note that while there are similarities in these **rules** to the **NABERS** definition of functional spaces, for TLAs an assessor is not required to treat:

- computer server rooms as separate functional spaces.
- areas with differing operating hours as separate functional spaces.
- sub-leased areas as separate functional spaces.

**Assessors** are not required to list all spaces in the building in their **functional space** list. Specifically, non-office spaces and particularly those measured using Gross Lettable Area (GLA) or Gross Lettable Area Retail (GLAR) do not have to be included.

Examples of these types of spaces include cafés, retail tenancies and gymnasiums.

**Assessors** should include comments in their application explaining that non-office areas are present i.e. 'There are two retail tenancies on the ground floor, one café (120sqm) and one clothing store (300sqm).'

This will allow the **CBD administrator** to understand clearly that no office areas have been missed in the assessment. This is particularly important for TLAs defined to cover 'All office space'.

### 4.3.2 Naming Functional Spaces

**Functional spaces** must be given an unambiguous name comprising, as a minimum, the following components:

- Identification of the level of the building on which the functional space is located, preceded or followed by "Floor" or "Level".
- If the functional space comprises the whole floor, naming must include "whole floor".
- If the functional space comprises less than the whole floor, naming must include "part floor".
- If the functional space comprises less than the whole floor, naming must include either a geographical indicator (e.g. East, West, North, South) or a suite number to enable unambiguous identification (e.g. Suite 1, Suite 2).

Functional **space** names must NOT include tenant names for privacy reasons.

Examples of acceptable functional space names include:

Level 1 - Whole floor

Part Ground Floor - Suite G1

Part 2nd Floor – East

## 4.4 Documentation requirements

The **assessor** must retain the following documentation, complying with *Section 3.1 Acceptable Data*, to validate the **assessment NLA**:

- **NLA** surveys, leases, or other third-party documentation meeting the **measurement standard**.

**AND / OR**

- Assessor's calculations based on plans or site measurements meeting the **measurement standard**.

Documentation provided by the building owner, or other third-party, used to determine or validate the **assessment NLA** must be endorsed as being measured in accordance with the measurement standard (see *Section 2.2 Definitions*).

# 5 Luminaire details

## 5.1 Background

The first part of a TLA is a calculation of the **nominal lighting power density (NLPD)** of the **general lighting system (GLS)**. The starting point for this calculation is to identify all the luminaire types in the **GLS** and determine the nominal power consumption of each.

The **total luminaire power** is used, along with the area that the luminaires serve, to determine the NLPD which is the basis of the TLA.

## 5.2 Safe work methods

**Assessors** should carry out assessments with all due care, in accordance with all applicable occupational health and safety standards and workplace safety laws with minimal disruption to the building owner or tenant of the relevant building or area.

Assessors are responsible for ensuring the safety of their work for themselves and other building users, including undertaking a job safety analysis and documenting a safe work method statement before carrying out any assessments.

It is strongly recommended that Assessors discuss the requirements for the assessment with the building owner, facility manager or client contact and confirm any site specific risks or hazards (see *Section 3.3.3 Safety and security considerations*).

### **Assessors must avoid:**

- Handling energised **lamps** or **luminaires** (burn/electrocution risk)
- Standing on chairs or desks to reach luminaires (fall risk)
- Using a stick or pole to lift up diffusers in luminaires (injury risk)
- Opening live/energised switchboards or **lighting control systems** (electrocution risk).

These **rules** provide a variety of acceptable methods to ascertain lamp information as per *Section 5.6 Documentation requirements – Luminaires*. **Assessors** can also use default lamp values where a lamp cannot be safely or accurately identified as per *Section 5.4.6 Default lamp values*. Assessors may use these default lamp types where it is unsafe to accurately obtain lamp information.

Where luminaires cannot be easily accessed, or where an **assessor** is not qualified to access certain spaces, a tradesperson or electrician may be utilised to access luminaires and determine the nominal lamp power (note that this may need agreement of the building owner and tenant).

Additional safety training is provided in the CBD Accredited Assessor Training Course, and assessments should be carried out in accordance with that training and these **rules**. If a person has not undertaken the CBD Accredited Assessor Training Course, they should not attempt to carry out assessments in accordance with these **rules**.

## 5.3 Luminaire schedule

**Assessors** must create a schedule of all **luminaires** installed within the areas used to assess the **NLPD** for a **functional space**. If the **grid method** or **aggregate method 1** is used, then only luminaires in **open office spaces** need to be listed.

Where **aggregate method 2** is used, all luminaires in the selected sample space need to be listed – this sample space can include **cell offices** in addition to **open offices**.

Where **aggregate method 3** is used, all luminaires in the functional space **GLS** need to be listed. This must include all spaces that are part of the measured **NLA** of the **functional space**, including meeting rooms, individual offices etc.

For each luminaire, assessors must collect or assign the following information:

**Luminaire name:** A short name assigned by the **assessor** which will be used in the **assessor portal**. The name shall be unique to each **luminaire** type in the assessment and shall follow a consistent naming convention.

Examples of acceptable luminaire names include (descriptions provided below):

- RT236MAG
- RT228
- LEDDL10
- LEDPanel54

**Luminaire description:** A detailed description of the **luminaire** that should include:

- the type of **luminaire**
- details of the number, type and power of **lamps**
- the type of **control gear** (**transformer**, **ballast**, LED driver or similar)
- the type of light diffusion i.e. prismatic diffuser.

Examples of acceptable luminaire descriptions include:

- RT236MAG - 2 x 36W T8 fluorescent tubes with magnetic **ballasts** housed in a recessed troffer fitting.
- RT228 - 2 x 28W T5 fluorescent tubes housed in a recessed troffer fitting.
- LEDDL10 - 10W **LED** down light.
- LEDPanel54 - 54W **LED** panel luminaire.

**Lamp and control gear type:** Selected from the list summarised in *Table 1*. If not on the list, use "Other" (refer to *Section 5.4.2 "Other" lamp types*).

**Quantity of lamps in the luminaire:** **Assessors** should note that **luminaires** containing failed **lamps** should be treated as if they contained the typical number of lamps, as assessed by comparison to the surrounding area.

This is distinct from deliberate delamping (see *Section 5.4.7 Treatment of delamped luminaires*) that requires specific evidence.



**Nominal lamp power (watts):** Based on visual inspection or other evidence as per *Section 5.6 Documentation requirements – Luminaires*.

- For LED strip lights, specify W/m, total length and total **wattage**.

This information, when entered into the **assessor portal**, will generate a nominal lighting power rating for each **luminaire**. Inputs shall be in accordance with *Section 3.1.2 Standards for acceptable data*.

Failing this, a default 'worst case' (as per the requirements of *Section 5.4.6 Default lamp values*) must be noted in the assessment with reasons why the default value was included.

Photographs of each **luminaire** type identified in the luminaire schedule must be retained in accordance with *Section 5.6 Documentation requirements*.

**Table 1: Lamp and Ballast combinations included in the assessor portal**

TYPE	DESCRIPTION
<b>T5 HE</b>	T5 High Efficiency fluorescent <b>lamp</b> with electronic <b>ballast</b> (default option if unsure what type of T5 lamp is being used)
<b>T5 HE Eco</b>	T5 High Efficiency Eco fluorescent lamp with electronic ballast
<b>T5 HO</b>	T5 High Output fluorescent lamp with electronic ballast
<b>T5 HO Eco</b>	T5 High Output Eco fluorescent lamp with electronic ballast
<b>T8 MAG</b>	T8 fluorescent lamp with magnetic ballast
<b>T8 EL</b>	T8 fluorescent lamp with electronic ballast
<b>T12</b>	T12 fluorescent lamp with assumed magnetic ballast
<b>CFLi</b>	Single ended compact fluorescent lamp with integral ballast
<b>CFLn MAG</b>	Single ended compact fluorescent lamp with remote (non-integral) magnetic ballast
<b>CFLn EL</b>	Single ended compact fluorescent lamp with remote (non-integral) electronic ballast
<b>HAL ELV MAG</b>	12V (ELV = extra low voltage) halogen lamp with magnetic <b>transformer</b>
<b>HAL ELV EL</b>	12V (ELV = extra low voltage) halogen lamp with electronic transformer
<b>HAL LV</b>	Mains voltage (LV = low voltage = 230V ±10V) halogen or incandescent lamp
<b>MH MAG</b>	Metal halide lamp with magnetic ballast
<b>MH EL</b>	Metal halide lamp with electronic ballast
<b>MV</b>	Mercury vapour lamp with assumed magnetic ballast
<b>LED DL</b>	LED downlight
<b>LED LF RF</b>	LED retrofit lamp for linear fluorescent lamp
<b>LED Strip</b>	LED extrusion or strip lighting
<b>LED Inc RF</b>	LED incandescent retrofit
<b>LED Panel</b>	LED panel or troffer
<b>Other</b>	Other lamp/ballast types not listed here

## 5.4 Lamp details

### 5.4.1 Lamp Type

For each luminaire type the **lamp** details are required, including the lamp type as per *Table 1*. In the **assessor portal**, the lamp type is selected from a drop-down menu which lists common lamp types. Commonly encountered lamp types are listed in *Appendix B: Common Lamp Types*.

Where the lamp type is not listed, **assessors** must select “Other” (refer to *Section 5.4.2 “Other” lamp types*).

### 5.4.2 “Other” lamp types

If a **lamp/ballast** type is discovered that does not appear in *Table 1*, the lamp type should be classed as “Other”. In this case the following details will be required:

- The type of lamp present, e.g. halogen.
- The **total luminaire power** (rather than the nominal lamp power).

For “Other” lamp types, the value for **total luminaire power** must include the power draw of the lamp plus the losses of any **control gear** present (whether internal or external to the luminaire). This should be determined from the product catalogue listing for the **lamp** or fitting or alternatively may be directly measured as described in *Section 5.4.4 Measurement of non-standard lamp wattage*.

### 5.4.3 Nominal lamp power

The preferred method for identification of **nominal lamp power** is by visual inspection of the **lamps** installed in the existing **luminaires** (in-situ). In most cases, the nominal **wattage** will be clearly marked on the lamp or its base, as per the examples shown in *Appendix G Examples of photographic evidence*.

**Assessors** must validate lamp power using the methods listed in order of precedence in *Section 5.6 Documentation requirements – Luminaires*.

### 5.4.4 Measurement of non-standard lamp wattage

Where a **lamp** type is not represented in *Table 1*, the following process may be used to measure the total circuit **wattage** for the lamp:

- 1) If the **assessor** can obtain manufacturer’s data for the total circuit wattage for the lamp in combination with the associated **control gear**, then this figure should be used. The assessor must retain a copy of the supporting evidence for audit purposes.
- 2) In other circumstances the **assessor** may arrange for measurement of the total circuit wattage as follows:
- 3) A power factor correcting power meter of accuracy not less than  $\pm 5\%$  must be used.
- 4) The measurements must be undertaken when the mains voltage is in the range  $230 \pm 10V$  for the duration of the measurement.

- 5) The **lamp** must be in situ in a **luminaire** substantially identical to that used in the assessed space, and must be mounted in an orientation (e.g. horizontal, facing downwards) similar to that used in the assessed space.
- 6) The **luminaire** must be turned on and left to stabilise for at least 10 minutes before measurements commence.
- 7) Any dimming or voltage reduction functionality must be disabled for the duration of the test.
- 8) The **assessor** shall record instantaneous (power-factor-corrected) power and voltage readings at one minute intervals for a period of 5 minutes.
- 9) The measurements may only be used if the recorded voltage readings are all within the range  $230 \pm 10V$ .
- 10) The total circuit power used for the purpose of the assessment shall be the **average** of the five measurements.
- 11) The **assessor** must keep records of the voltage and power measurements for audit.

#### 5.4.5 Lamps per luminaire

The number of **lamps** per **luminaire** is determined by visual inspection, i.e. visually identifying how many lamps are present in each luminaire and documenting this through photographs or site notes.

Some luminaire reflectors can give the impression of more **lamps** than are actually present. Care should be taken to visually confirm and count the number of lamps correctly.

#### 5.4.6 Default lamp values

Where a **luminaire** cannot be safely accessed by the **assessor** or is otherwise unable to be identified, the assessor may utilise default **lamp** values provided in *Table 2*.

Assessors must first attempt to collect evidence of lamp type and lamp power as per *Section 5.6 Documentation requirements – Luminaires* before making use of default lamp values, and make site notes documenting specific reasons why other evidence was unable to be collected.

Assessors will also be required to provide reasons for using default lamp values when submitting their TLA application through the **assessor portal**.

Where an assessor cannot identify a suitable default lamp type, they must contact the **CBD administrator** for assistance to select a reasonable lamp type and power rating to enter into the **assessor portal**.

**Table 2: Default lamp values**

LAMP TYPE	DETAILS	DEFAULT LAMP SELECTION	DEFAULT LAMP WATTAGE	DEFAULT BALLAST/ CONTROL GEAR
Linear fluorescent lamp	1500mm tube	T8 MAG	58W	Magnetic ballast
Linear fluorescent lamp	1200mm tube	T8 MAG	36W	Magnetic ballast
Linear fluorescent lamp	600mm tube	T8 MAG	18W	Magnetic ballast
Halogen down-light	-	HAL ELV MAG	50W	Magnetic transformer
Halogen lamp	-	HAL LV	250W	N/A
Metal halide lamp	-	MH MAG	250W	Magnetic ballast
Mercury vapour lamp	-	MV	250W	Magnetic ballast
LED downlight (small)	<150mm cut-out diameter	LED DL	15W	N/A
LED downlight (large)	>=150mm cut-out diameter	LED DL	45W	N/A
LED retrofit tube	600mm tube	LED LF RF	10W	N/A
LED retrofit tube	900mm tube	LED LF RF	15W	N/A
LED retrofit tube	1200mm tube	LED LF RF	21W	N/A
LED retrofit tube	1500mm tube	LED LF RF	25W	N/A
LED extrusion or strip light	Per metre – 25W/m	LED Strip	25W/m	N/A
LED panel or troffer	300mm x 300m	LED Panel	18W	N/A
LED panel or troffer	300mm x 600mm	LED Panel	27W	N/A
LED panel or troffer	600mm x 600mm	LED Panel	54W	N/A
LED panel or troffer	300mm x 1200mm	LED Panel	54W	N/A
LED panel or troffer	300mm x 1500mm	LED Panel	66W	N/A
LED panel or troffer	600mm x 1200mm	LED Panel	66W	N/A
LED panel or troffer	600mm x 1500mm	LED Panel	66W	N/A
LED panel or troffer	400mm x 600mm	LED Panel	36W	N/A
LED panel or troffer	400mm x 1200mm	LED Panel	54W	N/A
LED panel or troffer	400mm x 1500mm	LED Panel	66W	N/A
LED track light	<= 79mm face diameter	LED Track	6W	N/A
LED track light	80mm to 99mm face diameter	LED Track	33W	N/A
LED track light	>= 100mm face diameter	LED Track	47W	N/A

### 5.4.7 Treatment of delamped luminaires

In some installations, **luminaires** have had **lamps** removed. By default, the number of lamps allocated to a luminaire must be the number of lamps it is capable of accepting, as per *Section 5.6 Documentation requirements – Luminaires*. Most commercial office luminaires are single or dual lamp configurations.

Where an **assessor** is defining a luminaire as part of a TLA, a lesser number of lamps may be entered where the **assessor** can substantiate this as deliberate delamping in accordance with *Section 5.6 Documentation requirements – Luminaires*.

The assessment should include a note in the “Performance comments” field that the luminaires have been intentionally delamped.

### 5.4.8 Treatment of voltage reduction devices and controllable dimmers

In situations where either of the following is present:

- Voltage reduction devices, also known as autotransformers.
- Dimmer controls (except where these are hard-wired into **control gear** and not programmable).

The **assessor** shall assess the luminaire on the basis of its performance with no voltage reduction device in place and with the dimmer control operating with no reduction in light output relative to normal operation i.e. with the energy input that would be achieved in the absence of dimmer control.

For example, where **lamps** operate at 50% output due to a fixed dimming system, **assessors** are required to consider the lamps at standard power consumption (100% output) only.

### 5.4.9 Treatment of T5 adapters

Where a T8 **luminaire** has been retrofitted with T5 adapters, the luminaire shall by default be assessed as if the luminaire were a normal T5 luminaire with the same **lamps**.

For example, a T8 luminaire using a T5 retrofit kit with two 28W T5 HE lamps would be assessed as a 2 x 28W T5 HE lamp luminaire.

**Assessors** should also select the ‘T5 adapters used’ under Performance Comments when submitting their assessment through the **assessor portal** (see *Section 8 Performance comments*).

### 5.4.10 Composite luminaires

Composite **luminaires** that include more than one **lamp** type or different numbers of lamps shall be broken down into the lowest common module and scheduled as such. As an example, a luminaire may be built up of modules of 2 x 36W units that are joined together with a 50W low voltage halogen lamp in between. The 2 x 36W modules and the 1 x 50W modules should be scheduled as separate luminaires in the **assessor portal**.

## 5.5 Identifying the ballast or control gear

The **ballast** type will affect the total power drawn by the **luminaire**. Ballasts which are not integral to the **lamp** will draw power in addition to the lamp's nominal power rating. Note that the nominal power rating of a compact fluorescent lamp with integral **ballast** (CFLi) includes the power losses of its integral ballast.

### 5.5.1 Ballasts for fluorescent lamps

There is a significant difference in the circuit power of fluorescent **luminaires** between those using (wire wound) magnetic **ballasts** and those using electronic ballasts.

For fluorescent **lamps** with separate **ballast**, the ballast type shall be determined as follows:

- By using a frequency meter (in its simplest form, obtainable as a 'ballast discriminator') aimed at the luminaire by the **assessor** (the preferred method).
- By physical evidence such as sighting a **lamp** starter (magnetic **ballasts** need a lamp starter) or by sighting T5 lamps (any of the available HE, HE Eco, HO and HO Eco types) which are only capable of operating on an electronic ballast.
- By documented evidence such as as-installed equipment lists.

If neither observation nor documented evidence is available for the existing lighting system, a default evaluation of 'magnetic **ballast**' must be recorded with reasons for using the default.

Note that some ballasts will drive more than one **lamp** in the **luminaire** and some luminaires will contain more than one **ballast**. This is not relevant to the Assessment. It is not necessary to identify how many ballasts are present in the luminaire, just what type of ballast is present and how many lamps are present.

**Figure 3: Fluorescent lamp starter. Presence of these indicates that a magnetic ballast is in use.**



### 5.5.2 Ballasts for metal halide and mercury vapour lamps

Mercury vapour **lamps** (see *Appendix B: Common Lamp Types*) will normally operate with magnetic **ballasts** (the default assumption).

Metal halide lamps can use either magnetic or electronic **ballasts** and the difference in power consumption is significant.

For metal halide lamps with separate ballast, the ballast type shall be determined as follows:

- By physical evidence such as sighting the ballast (preferred method).
- By documented evidence such as as-installed equipment lists.

If neither observation nor documented evidence is available for the existing lighting system, a default evaluation of 'magnetic ballast' must be recorded with reasons for using the default.


Use of a ballast discriminator is not permitted for the identification of metal halide and mercury lamp **control gear** as it is not sufficiently reliable.

### 5.5.3 Transformers for ELV halogen lamps

Extra low voltage (ELV) halogen **lamps** will be supplied by a magnetic or electronic **transformer**.

Magnetic transformers are significantly heavier and bulkier than electronic units (see *Figure 4* and *Figure 5* below).

**Figure 4: Electronic transformer (top) and magnetic transformer (bottom)**

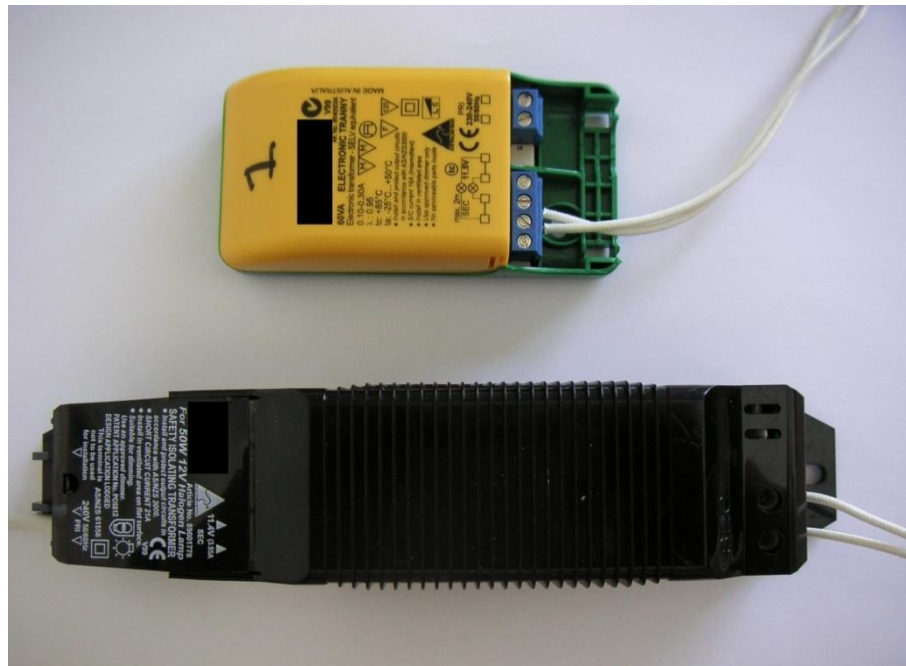

**Figure 5: Magnetic transformer in ceiling space**

For ELV **lamps**, the **transformer** type shall be determined as follows:

- By physical evidence such as sighting the transformer (preferred method).
- By documented evidence such as as-installed equipment lists.

If neither observation nor documented evidence is available for the existing lighting system, a default evaluation of 'magnetic transformer' must be recorded with reasons for using the default.

Use of a **ballast** discriminator is not permitted for the identification of ELV halogen lamp transformers as it is not sufficiently reliable.

#### 5.5.4 LED Control Gear

An **LED** driver is typically an electronic power supply that controls the power and voltage supplied to an LED **lamp**.

**Total luminaire power** for LED luminaires is the input power of the LED lamp(s) plus the LED driver(s).



## 5.6 Documentation requirements – Luminaires

All luminaire documentation must be organised or labelled in a manner that enables direct identification of the **luminaire** against the **assessor portal** luminaire schedule.

The **assessor** must retain all of the following documentation, complying with *Section 3.1 Acceptable Data*, to validate information for each type of luminaire used in the assessment i.e. for each luminaire included in the luminaire schedule:

### Lamp type and lamp power evidence (listed in order of precedence):

- Zoomed-in photograph clearly showing **lamp** power markings or labels.  
**OR**
- Zoomed-out photograph of the **luminaire** in-situ **AND** additional photographs of replacement **lamp** stocks stored at the site clearly showing lamp power markings or labels.  
**OR**
- Zoomed-out photograph of the **luminaire** in-situ **AND** as installed equipment lists or schedules clearly showing lamp power information.  
**OR**
- Site notes confirming reasons for use of default **lamp** values as per *Section 5.4.6 Default lamp values*.  
**OR**
- Test results for **lamps** or **luminaires** tested under the provisions of *Section 5.4.4 Measurement of non-standard lamp wattage* (if applicable) **OR** lamp/luminaire manufacturers data (such as a product specification).

### Number of lamps per luminaire evidence:

- Photograph clearly depicting number of **lamps** in **luminaire**.  
**OR**
- Site notes confirming number of **lamps** in **luminaire**.  
**OR**
- As installed equipment lists, schedules or diagrams clearly depicting number of **lamps** in **luminaire**.

### Ballast/Control gear evidence:

- Photograph of **control gear** or **ballast AND / OR ballast** discriminator response (only required where the **lamp** type could operate with either electronic or magnetic **ballast** such as T8 fluorescent lamps).

### Evidence of intentional delamping (if applicable):

- Photograph of stickers/other evidence showing delamping is intentional.  
**OR**
- Site notes confirming more than 80% of **luminaires** have been delamped.

### Requirements for Photographic Evidence:

Examples of acceptable and unacceptable photographs are provided in *Appendix G: Examples of photographic evidence*. Requirements for submitted photographic evidence include:

- Photographs must be of sufficient quality that the information they are intended to convey is easily discernible (e.g. **lamp** power).
- Out of focus photographs or photographs of a **luminaire** with a diffuser fitted, which leave such items unclear, are not acceptable and may lead to an adverse outcome for the **assessor** if the assessment is audited by the **CBD administrator**.
- Photographs must include a date stamp showing the day they were taken, either on the photograph image or within the photograph file properties.
- All photographs taken prior to the **assessment date** are unacceptable, including those from a previous TLA, unless:
  - a clear statement of reasons has been provided which explains why photographs taken on or after the **assessment date** cannot be obtained

#### AND

- the **CBD administrator** has subsequently provided written approval for the use of the photographs in question.

**Assessors** are not required to take a photograph of every **luminaire** used in every **functional space** assessment. **Assessors** are only required to collect evidence of each distinct luminaire type included in the luminaire schedule used in the TLA.

For example, where 2x36W T8 magnetic **ballast** fluorescent tube luminaires are used across all floors of a building, only one set of evidence is required to be collected by the **assessor** for that luminaire, as there is only one luminaire in the luminaire schedule. This set of evidence could include a:

- photograph of the entire 2x36W T8 **luminaire** in-situ.
- copy of the installed equipment list for the tenancy.
- photograph showing both 36W T8 tubes in the **luminaire** in-situ.
- photograph of **lamp** starters in the luminaire, confirming presence of magnetic **ballasts**.
- Discriminator test photograph (red/green) indication (See *Section 5.5.1 Ballasts for fluorescent lamps* for details)
- photograph clearly showing **lamp** power markings or labels

**Assessors** should be sensitive to tenant concerns regarding photographs being taken within their tenancy. To ensure a smooth assessment process **assessors** should contact the tenant prior to beginning the assessment and explain:

- why they are doing the TLA and what the assessment will involve (checking **lamps**, ceiling grids, measuring areas and checking lighting controls).
- what will be included in the photographs (**lamps**, ceiling grids, controls etc).
- what won't be included in the photographs (computer screens, desk tops, staff, white boards or posters etc.).
- that the tenant can review the photographs at the end of the assessment if required.

## 6 NLPD assessment

### 6.1 Background

This section deals with selecting a **nominal lighting power density (NLPD)** assessment methodology appropriate to the space being assessed.

In lighting systems in which up to two **luminaires** types are arranged in a regular array, the **grid method** may be used to assess NLPD. The **Total luminaire power** is divided by the area that the luminaire covers.

In lighting systems in which there is an irregular layout of luminaires or where a number of different **luminaire** types are installed, an **aggregate method** may be used to assess NLPD. The sample space is chosen by the **assessor** and the total luminaire power within this **aggregate method sample space** is calculated and divided by **aggregate method sample space** floor area.

Examples of NLPD calculations are provided in *Appendix D: NLPD calculation examples*.

### 6.2 Identifying the General Lighting System (GLS)

The **GLS** is the lighting system generally used to illuminate the **open office spaces** in the tenancy. This may consist solely of **luminaires** that were present before **fitout**, or may include a combination of original luminaires and extra or different luminaires installed by the tenant. The **NLPD** assessment does not differentiate between base building luminaires and tenant-installed luminaires.

For most offices, the **GLS** is best represented by the lighting in the **open office space**. However, for spaces that have been extensively fitted out with small cellular offices, the lighting system in these areas can also be counted in the assessment under **aggregate method 2** and **aggregate method 3**.

Specialist spaces such as meeting rooms and conference rooms are less likely to have an installed lighting system that represents the **GLS**, due to the installation of architectural or feature lighting. These are not used in the **NLPD** assessment of the GLS, except under **aggregate method 3**.

**Display lighting**, desk-mounted **task lighting**, and emergency lighting do not form part of the **GLS**. In mezzanine and other high-ceiling areas, luminaires should only be counted in the GLS where they are designed to cast light onto the **functional space** being assessed.

In the rare instances where none of the methods described in these **rules** can be applied to a **functional space**, the functional space may be determined as **non-assessable** (see *Section 2.4 Non-Assessable spaces*).

## 6.3 Selecting the NLPD assessment method

### 6.3.1 Confirm the space is assessable

Prior to assessing the **NLPD** an **assessor** must first confirm that the **functional space** is **assessable** i.e. does not meet the criteria for a **non-assessable** space as defined in *Section 2 Key concepts and definitions* and the requirements outlined in *Section 2.4 Non-Assessable spaces*.

### 6.3.2 NLPD assessment method selection


Four different methods are permitted for the assessment of **NLPD**. The selection of which method to use is determined based on the characteristics of the lighting system and the available documentation. This is shown in the flow chart shown in *Figure 6*.

Assuming the **functional space** has been deemed **assessable**, **assessors** can select any of the four available **NLPD** assessment methods as long as the documentation requirements specified in *Section 6.4 Documentation requirements – NLPD* for each method can be achieved, and the relevant criteria for the chosen assessment method can be met.

Examples of **NLPD** calculations are provided in *Appendix D: NLPD calculation examples*.

Previous versions of the **rules** required **assessors** to first establish that the **grid method** was not viable, before looking at the three **aggregate methods**. This requirement was removed in version 4.0 **rules**, allowing assessors to choose the most appropriate method for the **functional space** they are assessing and reduce the time and documentation required to complete their assessment.

**Figure 6: NLPD assessment method selection flow chart**

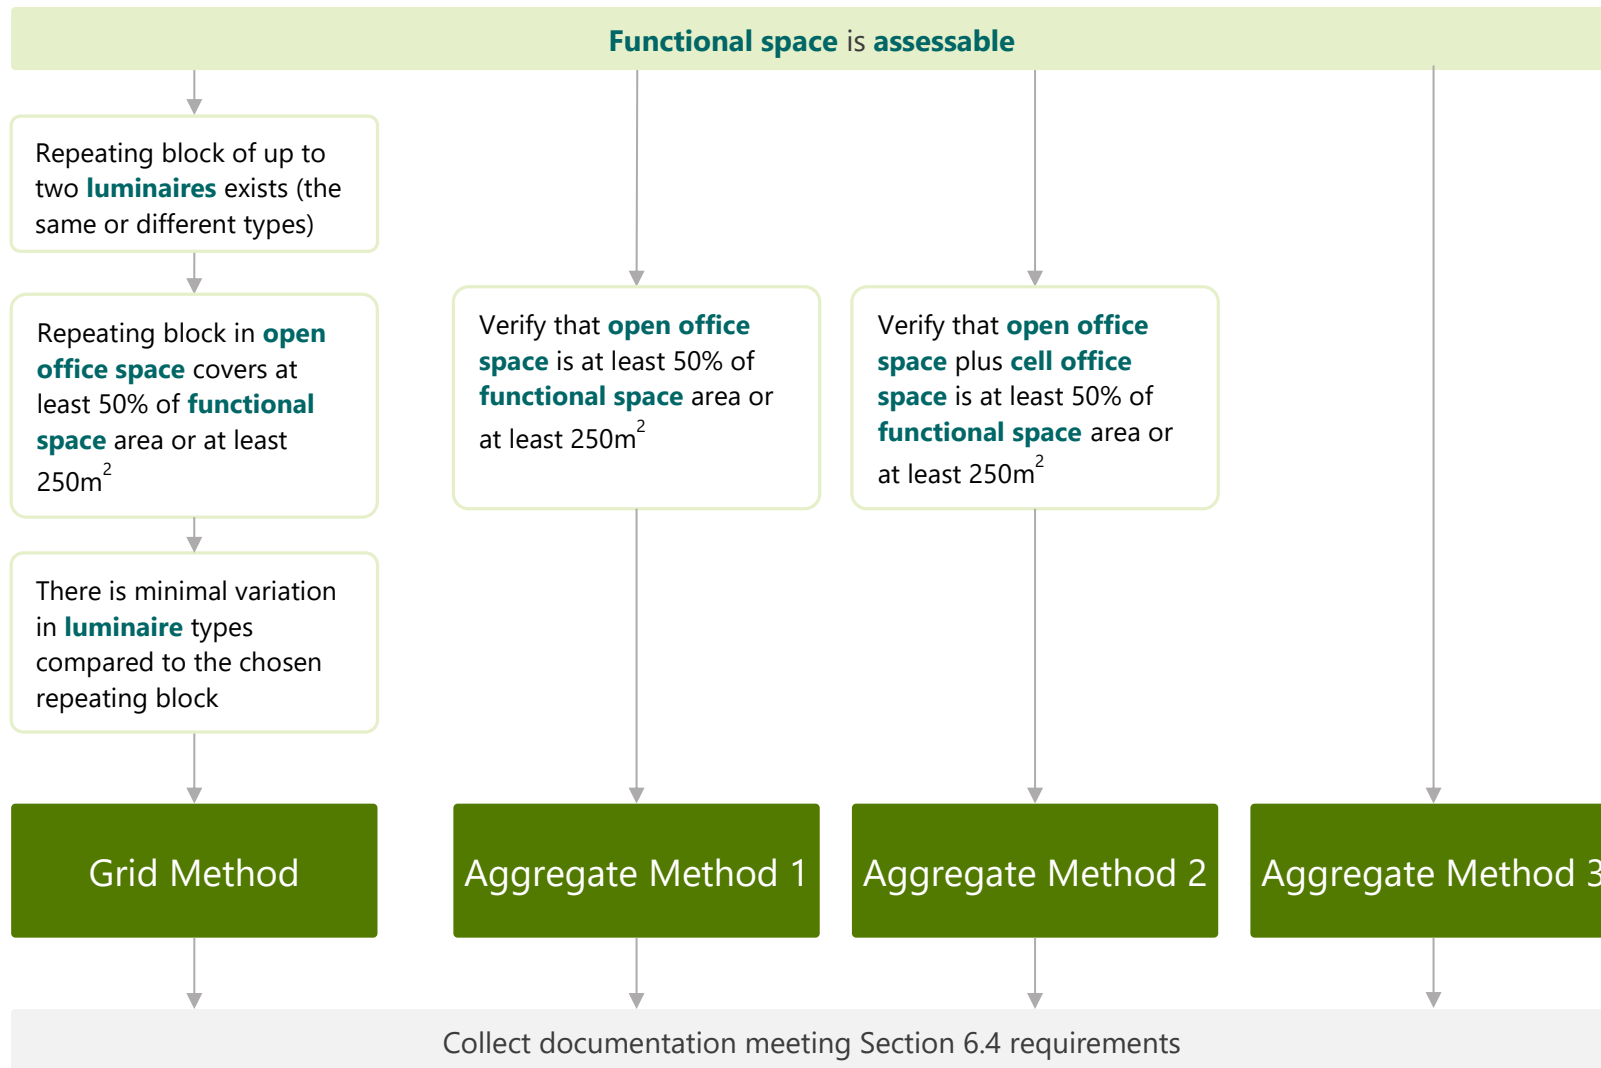

### 6.3.3 Grid Method

The **grid method** is a simple method for assessing **functional spaces** with a repeating grid pattern of up to two **luminaires** (of the same or different types), allowing for minor luminaire variations. Grid spacing may be regular in one direction and alternating in another direction, in which case the grid method evaluation can be based on the **average** grid spacing.

Some ceiling grids have very easily discernible repeating blocks of luminaires, while others can be more difficult to assess. Luminaires can sometimes appear 'out of alignment' with the identified repeating block. The key consideration for an **assessor** is whether the **NLPD** is consistent across the **open office space** i.e. **luminaires** per area block is consistent.

A common example is alternating grid patterns: In these cases a repeating block, and a mirror image of that repeating block, repeat adjacent to each other in the ceiling grid.

Within each repeating block, it is permissible to have significant differences in positioning of luminaires, as long as the area per **luminaire** is the same across the **open office space**.

The grid method can only be used when there is sufficient **open office space** as per the below criteria.

#### Criteria – The grid method is permitted where:

- A simple repeating block consisting of up to two **luminaires** (of the same or different types) from the **GLS** serving **open office space** can be identified.

#### AND

- This block is generally repeated throughout the **open office space**. This open office space must be at least 50% of the **functional space** area, or at least 250m<sup>2</sup>, whichever is smaller.

#### AND

- Throughout the **open office space** areas there are only minor variations in the types of **luminaires** present, compared to the luminaires included within the simple repeating block.

#### AND

- Documentation requirements for the **grid method** can be met as per *Section 6.4 Documentation requirements – NLPD*.

#### Process

- 1) Identify the **luminaire** types in the repeating block (maximum of two luminaires, of the same or different types).
- 2) Calculate the area of the repeating block ( $\pm 5\%$  accuracy).
- 3) Verify that the repeating grid covers at least 50% of the **functional space** area or at least 250m<sup>2</sup>, whichever is smaller.
- 4) Make site notes confirming that there are only minor variations in the types of **luminaires** present in the **functional space**, compared to the simple repeating block being assessed.
- 5) The **assessor portal** calculates the **NLPD** as total **wattage** of **luminaires** within the repeating block divided by the area of the repeating block.

In version 4.0 of the **rules**, the criteria for applying the **grid method** was updated. The intention is to allow a broader use of the grid method in **functional spaces** where a simple repeating **luminaire** block is present with a small number of different luminaires (often due to tenant changes to the original **open office space GLS** in the **functional space**).

When using the **grid method**, **assessors** must make site notes confirming that there are only minor variations in the types of **luminaires** present in the open office space, compared to the simple repeating block being assessed.

Examples of minor variations include:

- Three 600mm 14W T5 fluorescent tube fittings near corridors and doorways in a large **open office space** otherwise serviced by a repeating 2 x 1200 mm 28W T5 grid.
- Five compact fluorescent downlights near meeting rooms and a security gate in a large **open office space** otherwise serviced by a repeating 2 x 32W LED panel grid.
- Five 1200x300mm 40W **LED** panels in an **open office space** otherwise serviced by a repeating 2 x 1200 mm 28W T5 grid (defective lamps replaced with LED panels).

Where **assessors** are unsure about the impact of different types of luminaires, they can contact the **CBD administrator** for assistance and a determination.

### 6.3.4 Aggregate Method 1

**Aggregate method 1** is used where there is sufficient **open office space** (as per the below criteria) to characterise the **GLS** but no regular lighting grid. **Aggregate method 1** is used when the open office space is at least 50% of the **functional space** area or at least 250m<sup>2</sup>, whichever is smaller.

The qualifying **open office space** areas need not be contiguous, but may be made up of a number of separate open office spaces added together (see *Appendix D-4* for an example of this).

#### Criteria – Aggregate method 1 is permitted where:

- There is **open office space** of at least 50% of the **functional space** area or at least 250m<sup>2</sup>, whichever is smaller.

#### AND

- Documentation requirements for **aggregate methods** can be met as per *Section 6.4 Documentation requirements – NLPD*.

#### Process

- 1) Identify, as the **aggregate method 1 sample space**, an **open office space** that is:
  - a) at least 50% of the area of the **functional space** or at least 250m<sup>2</sup> of open office space, whichever is smaller.

#### AND

- b) contains all of the **luminaire** types present in the **open office space**, in a similar proportion to the whole of the open office space.
- 2) If a similar proportion of **luminaire** types cannot be achieved, then the whole of the **open office space** is to be used as the **aggregate method 1 sample space**.
  - 3) Prepare a simple drawing of the **aggregate method 1 sample space** and calculate the sample space area ( $\pm 5\%$  accuracy). The drawing can be:
    - a) to scale

#### OR

- b) not to scale and provided with sufficient dimensioning to enable demonstration of the area calculation.
- 4) Identify and count all **GLS** luminaires in the **aggregate method 1 sample space**. Do not count **task lighting** or **display lighting**.
  - 5) The **assessor portal** calculates the **NLPD** as the sum of the **wattage** of all luminaires in the **aggregate method 1 sample space** divided by the area of the sample space.



### 6.3.5 Aggregate Method 2

**Aggregate method 2** is similar to **aggregate method 1** but also includes **cell office space** as well as **open office space**. Aggregate method 2 is used when the open office space plus cell office space is at least 50% of the **functional space** area or at least 250m<sup>2</sup>, whichever is smaller.

The qualifying **open office space** and **cell office space** areas need not be contiguous, but may be made up of a number of disconnected open office and cell office areas added together (see *Appendix D-6* for an example of this).

#### Criteria – Aggregate method 2 is permitted where:

- There is **open office space** plus **cell office space** of at least 50% of the **functional space** area or at least 250m<sup>2</sup>, whichever is smaller.

#### AND

- Documentation requirements for **aggregate methods** can be met as per *Section 6.4 Documentation requirements – NLPD*.

#### Process

- 1) Identify, as the **aggregate method 2 sample space**, an area consisting of **open office space(s)** and **cell office space(s)** that is:
    - a) in total at least 50% or more of the area of the **functional space** or at least 250m<sup>2</sup>, whichever is smaller.
- AND**
- b) contains all of the **luminaire** types present in the **aggregate method 2 sample space** in a similar proportion to the entire **open office space** and **cell office space**.
- 2) If a similar proportion of **luminaire** types cannot be achieved, then the total combined **open office space** and **cell office space** is to be used as the **aggregate method 2 sample space**.
  - 3) Prepare a simple drawing of the **aggregate method 2 sample space** and calculate the sample space area ( $\pm 5\%$  accuracy). The drawing can be:
    - a) to scale

**OR**

    - b) not to scale and provided with sufficient dimensioning to enable demonstration of the area calculation.
  - 4) Identify and count all **GLS** luminaires in the **aggregate method 2 sample space**. Do not count **task lighting** or **display lighting**.
  - 5) The **assessor portal** calculates the **NLPD** as the sum of the **wattage** of all **luminaires** in the **aggregate method 2 sample space** divided by the area of the sample space.

### 6.3.6 Aggregate Method 3

**Aggregate method 3** can be used as the default **NLPD** assessment method for any **assessable functional space**.

**Criteria – Aggregate method 3 is permitted where:**

- Documentation requirements for **aggregate methods** can be met as per *Section 6.4 Documentation requirements – NLPD*.

**Process**

- 1) The **aggregate method 3 sample space** area is the entire **functional space** area, determined according to the **measurement standard**.

The **assessor portal** will automatically fill in the aggregate method 3 sample space area from the previously entered functional space area.

- 2) Identify and count all **GLS** luminaires in the **functional space**. This will include all areas that are part of the functional space **NLA**, including any meeting rooms, **cell offices** etc. Do not count **task lighting** or **display lighting**.
- 3) The assessor portal calculates the **NLPD** as the sum of the **wattage** of all **luminaires** in the **functional space** divided by the functional space area.

## 6.4 Documentation requirements – NLPD

The **assessor** must retain the following documentation, complying with *Section 3.1 Acceptable Data*, to validate the **NLPD** assessment calculations:

### Non-Assessable Spaces:

See *Section 2.4.2 Documentation required – Non-Assessable Spaces* for documentation requirements.

### Grid Method:

- Illustrate minimum grid coverage: **reflected ceiling plan OR assessor's** sketch identifying the area of the **functional space** covered by the grid (not to scale but sufficient to illustrate requirements).

**AND**

- Demonstrate regular repeating grid pattern: **reflected ceiling plan OR assessor's** sketch of grid coverage **OR** photograph demonstrating regular grid.

**AND**

- Evidence of simple repeating block area: Site measurements **OR** evidence of standard ceiling tile size and site photographs confirming number of tiles per block **OR** reflected ceiling plan (to scale) showing ceiling tiles and regular repeating grid.

**AND**

- Photographs **OR** site notes identifying all assessed **luminaire** types present within the **open office space**.

**AND**

- Site notes confirming only minor variations in **luminaire** types across the **open office space** compared to the simple repeating grid being assessed.

### Aggregate methods:

- Floor plan clearly showing the **aggregate method sample space**. This must either be to scale or sufficiently dimensioned to demonstrate area calculations (i.e. providing length and width for rectangular areas).

**AND**

- **Aggregate method sample space** area calculations ( $\pm 5\%$  accuracy).

**AND**

- Photographs **OR** site notes identifying all assessed **luminaire types** present within the aggregate method sample space.

**AND**

- Site notes identifying a count of all luminaires within the **aggregate method sample space** (locations of individual luminaires are not required).

All documentation must be organised or labelled in a manner such that it can be directly identified against the **functional spaces** listed in the **assessor portal**.

**Assessors** should ensure that documentation retained for audit is sufficiently detailed to allow the **CBD administrator** or an **auditor** to understand why decisions were made, and in particular, why different **NLPD** assessment methods were used.

For **aggregate methods** this means assessors must document their area measurements and calculations when defining an **aggregate method sample space** appropriately, including providing both length and width of all rectangular areas used to generate aggregate method sample space area.

Providing a square metre area figure, with no information on how this was calculated, will not meet the requirements specified in these **rules** and may result in an adverse outcome for the **assessor** if the assessment is audited.

# 7 Lighting control assessment

## 7.1 Background

The energy efficiency of a lighting system is heavily influenced by how it can be controlled. **Lighting control systems** operate to reduce the operating power by switching or dimming the lighting and therefore can have a significant impact on the overall performance of the lighting system. Owing to the complexity of dimming systems, and their second-order impact relative to time of use controls, dimming is not considered within the lighting control assessment.

It is not practical to assess the effectiveness of an installed lighting control system because of the possibility that the system is not operating as intended. For this reason, the assessment process is designed to identify and report on the **control capacity** of the lighting control system(s) installed in each **functional space**, rather than including the lighting controls in the **NLPD** calculation.

This is an assessment of the potential for the lighting control system to manage the lighting operation.

## 7.2 Identifying lighting control system capacity

### 7.2.1 Overall methodology

The **assessor** shall make an assessment of the **control capacity** of the installed **lighting control system**. This is a measure of the system's potential to closely match the operation of the **functional space** luminaires with the needs of the occupants.


The lighting control assessment is made across the entire **functional space** area. The **aggregate method sample space** used in the **NLPD** assessment has no relevance to the lighting control assessment – the lighting control assessment must assess the lighting control system for the entire **functional space**.

The **control type** shall be determined by the controls system with a coverage area larger than 50% of the **functional space NLA**. This can be either an Occupancy or Timer control system, as defined in *Section 7.2.2 Step 1: Identifying the control type*.

Manual **control type** must be selected, if there is no Occupancy or Timer control system with a coverage area larger than 50% of the **functional space NLA**.

**Control capacity** shall be assessed as 'Good', 'Moderate' or 'Poor' as detailed in *Figure 7*.

**Figure 7: Lighting control assessment methodology flow chart**

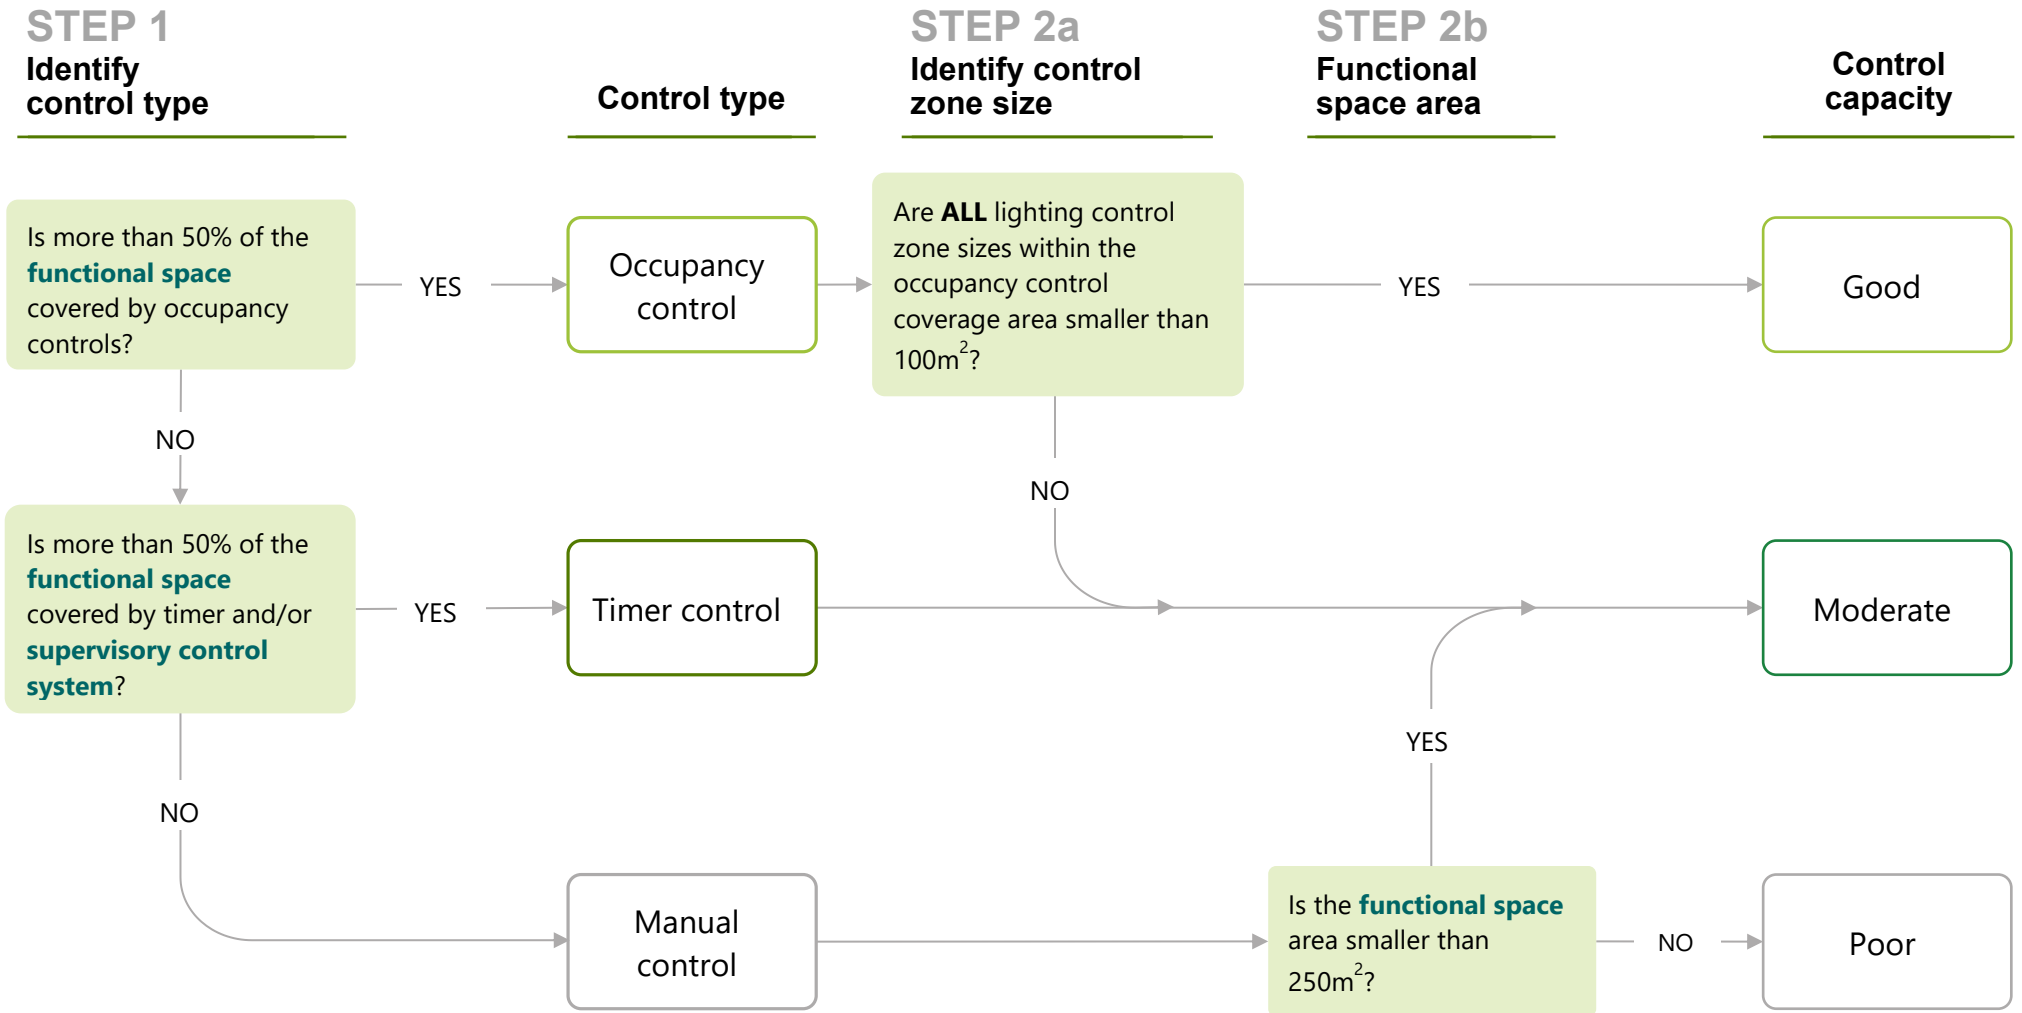

## 7.2.2 Step 1: Identifying the control type

### Occupancy Control

A **luminaire** is under occupancy control if the highest level of control for its operation is via the use of an occupancy sensor. This includes a luminaire that is:

- connected to a **supervisory control system** (circuit or individual **ballast** based) that has occupancy sensors available for control.
- connected to a hardwired circuit that is controlled via an occupancy sensor.
- controlled by timer controls at some times and by occupancy sensors at other times.

### Timer control

A **luminaire** is under timer control if the highest level of control for its operation is via the use of a timer. This includes a luminaire that is:

- connected to any form of **supervisory control system**.
- controlled by a time switch.
- interlinked to turn off on the setting of the site security alarm.

Mechanical push button delay timers are not considered a type of timer control in these **rules**.

### Manual control

Manual control is any form of control that does not meet the requirements of 'occupancy control' or 'timer control'.

Note there are no documentation requirements for manual control, and this **control type** can be selected as the default option where no evidence of lighting controls is available.

### Decision methodology for control type

The **assessor** shall determine the **control type** via the definitions above in combination with the flow chart shown in *Figure 7*.

In determining the **control type**, each identifying feature required to determine the **control type** must be documented as per *Section 7.3 Documentation requirements*.

If the required documentation is not available or cannot be provided, the identifying feature cannot be used to determine the **control type**, which may result in the **control capacity** being downgraded.

## 7.2.3 Step 2a: Identify control zone size

Assessment of lighting control zone area is only necessary for **functional spaces** that have been deemed to be under occupancy control.

A lighting control zone consists of the area associated with all the **luminaires** activated by an occupancy sensor. The area is measured to the midpoint between the included fittings and the fittings in the next adjacent control zone.

The control zone area must be demonstrated by a marked up scale drawing or controls diagram that shows the lighting fittings, separates these into each control zone and shows the calculated area for each lighting control zone.

For **control capacity** to be classified as 'Good', ALL lighting control zones within the **functional space** must be smaller than 100m<sup>2</sup>.

Counting the total number of occupancy sensors and dividing by the total **functional space** area is not a permissible method of calculating the lighting control zone size.

Where **assessors** have identified occupancy control systems integrated into individual **luminaires**, the **control capacity** of these **functional spaces** will automatically be classified as 'Good' i.e. ALL lighting control zones within the **functional space** are less than 100m<sup>2</sup>. In these cases, **assessors** must have:

- confirmed that all assessed **luminaires** in the **functional space** include integrated occupancy sensors.
- obtained a product data sheet or similar detailing the occupancy control capabilities of the **luminaire** in question.
- confirmed that individual **luminaires** are actually being automatically controlled by integrated occupancy sensors, as opposed to groups of luminaires.

#### 7.2.4 Step 2b: Functional Space area

Consideration of **functional space** area is only necessary for functional spaces that have been determined to be under manual control.

The **control capacity** of a **functional space** is classified as 'Poor' if:

- it is under manual control
- AND**
- it has an area of 250m<sup>2</sup> or greater

The **control capacity** of a **functional space** is classified as 'Moderate' if:

- it is under manual control
- AND**
- it has an area smaller than 250m<sup>2</sup>

The **assessor portal** will automatically select the correct control capacity for manually controlled functional spaces based on the functional space area.

#### 7.2.5 Control capacity

The **assessor portal** will automatically allocate the **functional space** a **control capacity** rating of Good, Moderate or Poor based on the **assessor** input. This follows the process shown in *Figure 7*, resulting in the ratings shown in *Section 1.1.2 Lighting control systems*.



## 7.3 Documentation requirements – Lighting Controls Assessment

If the required documentation is not available or cannot be provided, the identifying feature cannot be used to determine the **control type**. This may result in the **control capacity** being downgraded.

The **assessor** must retain the following documentation, complying with *Section 3.1 Acceptable Data*, to validate their assessment of **control type** and **control capacity**:

### Coverage Area:

- Sketch or commentary reasonably demonstrating the coverage of the control system as being greater than 50% of **functional space** area.

### Presence of occupancy sensors:

- Photograph of occupancy sensors **OR** product page from manual.

#### AND

- Drawing/control diagram of location of sensors **OR assessor** sketch of location of sensors **OR assessor** count of number of sensors.

### Occupancy control zone size calculations:

- Scale drawing or lighting controls diagram showing the **luminaires**, occupancy sensors and marked up to show each control zone.

#### AND

- Clear measurements showing the calculated area for each lighting control zone, highlighting the largest lighting control zone identified in the **functional space**.

Counting the total number of occupancy sensors and dividing by the total **functional space** area is not a permissible method of calculating the lighting control zone size.

See *Appendix 0* for worked examples of lighting control zone calculations.

### Presence of integrated occupancy sensor controls in luminaires:

- Photograph of occupancy sensors integrated into **luminaires**.

#### AND

- Product data sheet or similar detailing occupancy control capabilities of the **luminaire**.

#### AND

- As installed equipment lists **OR reflected ceiling plans OR** lighting diagrams confirming that all assessed **luminaires** in the **functional space** include integrated occupancy sensor controls.

**Presence of Supervisory Control System:**

- Copy of system description from manual identifying **supervisory control system**.  
**OR**
- Photograph of supervisory system hardware or interface.  
**OR**
- Other drawings or documentation that demonstrates presence of **supervisory control system**.  
**OR**
- Photograph of light switch showing that it is a toggle type e.g. standard toggle switch or a spring return press switch **OR** photograph of **supervisory control system** controllers.

**Presence of Timer Controls:**

- Copy of system description from manual identifying timer control.  
**OR**
- Other drawing or documentation that demonstrates presence of timer control.  
**OR**
- Photograph indicating presence of after-hours lighting control independent of normal switching.  
**OR**
- Site confirmation that a time switch control is in use **AND** photograph of time switch.  
**OR**
- Site confirmation that Building Management System (BMS) time switch control is in use **AND** photograph of BMS time switch schedule for each **functional space**.

**Manual Control:**

- Default 'worst case' control system selection.
- No documentation requirements.

All documentation must be organised or labelled in a manner such that it can be directly identified against the **functional spaces** setup in the **assessor portal**.

## 8 Performance comments

### 8.1 Background

The **assessor portal** allows for a single comment to be placed against each **functional space** to describe any additional features of the lighting system that may affect its energy or functional performance.

### 8.2 Performance comments

Only a single 'performance comment' may be applied to each **functional space** and that is limited to the list available in the **assessor portal**, as shown in *Table 3*.

If several comments apply, the **assessor** should select the one that appears to be having most impact on the energy consumption.

**Table 3: Performance comments list**

PERFORMANCE COMMENT	SITUATION
<b>Luminaires delamped</b>	<b>Luminaires</b> have been delamped in a regular or planned fashion.
<b>Voltage reduction or dimmer devices used</b>	Voltage reduction devices or dimmers have been used that may reduce lighting circuit power in operation.
<b>T5 adapters used</b>	Adapters have been used to retrofit linear fluorescent <b>lamps</b> with T5 lamps.
<b>Desktop task lighting used</b>	Lighting design may be reliant on the use of <b>task lighting</b> to provide adequate illumination for normal office tasks.
<b>Low illuminance levels</b>	Illuminance levels appeared to be below normal office levels.
<b>Ceiling height greater than 3m</b>	Lighting power density may be higher than normal due to the high ceiling.
<b>Many cellular offices</b>	Lighting power density may be higher due to large numbers of cell offices.

# 9 Proposed systems

## 9.1 Background

There may be cases where the building owner intends to upgrade the lighting system of the **functional spaces** to be assessed soon after the assessment has been completed. Alternatively, there may be a make-good clause in the lease agreement that requires the incumbent tenant to return the lighting system to its original state when vacating the tenancy.

Providing that there is a contractual commitment to proceed with the proposed installation which includes detailed design drawings and equipment specifications, the **proposed lighting system** may be assessed based on the available documentation.

In this case, both the installed lighting system and the **proposed lighting system** are assessed in the TLA and reported in the **BEEC**.

## 9.2 Eligibility of proposed systems

Where building owners expect that the existing lighting system will change soon after the assessment, they may request an additional assessment of the **proposed lighting system**. The upgrade may be as a result of an owner initiative or because existing tenants need to meet the make good provisions of their lease.

The assessment of the proposed system can only be done in addition to the assessment of the existing system and strict eligibility criteria must be met.

To be eligible for assessment, building owner proposed upgrades must meet all of the following criteria:

- A signed contract exists, committing the building owner to the upgrade.
- The contract completion date is within three months of the **assessment date** (122 days).
- There is detailed design documentation that provides all the information required for the assessment. This shall include **reflected ceiling plans**, lighting circuits, control strategies, equipment schedules and technical specifications.

To be eligible for assessment, upgrades resulting from make good provisions must meet all of the following criteria:

- There is an enforceable clause in the lease agreement requiring the tenant to return the lighting system to its original state.
- There is an agreed make-good completion date falling within three months of the **assessment date** (122 days).
- There is detailed design documentation that provides all the information required for the assessment. This shall include **RCPs**, lighting circuits, control strategies, equipment schedules and technical specifications.

## 9.3 Assessing proposed systems

The assessment process is identical to the process used to assess the installed lighting system, except that it is completed from contractual design information.

## 9.4 Documentation requirements – Proposed Systems

Documentation requirements for the technical details of the **proposed system** are as per the requirements listed in *Section 2 Key concepts and definitions* through to *Section 7 Lighting control assessment*.

In addition, the following documentation must be retained by the **assessor** where an additional assessment of a proposed lighting system is conducted:

- Detailed design documentation such as those specified in *Section 9.2 Eligibility of proposed systems*.

**AND**

- Either:
  - Copy of a signed contract committing the building owner to the upgrade. The contract must show the completion date to fall within 122 days of the **assessment date**.

**OR**

- Copy of the lease agreement that satisfies requirements stated in *Section 9.2 Eligibility of proposed systems*.

# 10 Appendices

## Appendix A Information checklist for certified Tenancy Lighting Assessments

The following information may be required to complete a certified TLA. This data should be obtained prior to and during the site assessment by the **assessor**, working in conjunction with the building owner/manager and the building tenants.

A site visit is compulsory to identify and count **luminaires**, photograph ceiling grids and luminaires, establish **NLPD** assessment methods and measure **aggregate method sample space** areas where applicable.

All documentation and data used for TLAs must comply with *Section 3.1 Acceptable Data*.

All data collected during a TLA is required to be kept on file by the **assessor** for seven years, for audit purposes. See *Section 3.4 Documentation and Record-keeping*.

ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
For each functional space:	<input type="checkbox"/> Confirm that the area documentation provided for each <b>functional space</b> meets the <b>measurement standard</b> for determining office <b>NLA</b> .	<i>Section 4.2 Determining office NLA</i>
Confirm functional space details	<input type="checkbox"/> Make any amendments to the provided floor plans where this may affect the assessment.	
	<input type="checkbox"/> Confirm correct <b>functional space</b> name i.e. Level 1 Suite 1 and tenant name.	<i>Section 4.3.2 Naming Functional Spaces</i>

ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
<p><b>For each functional space :</b></p> <p><b>Confirm the functional space is assessable</b></p>	<p>A <b>functional space</b> is <b>non-assessable</b> if:</p>	<p><i>Section 2.4 Non-Assessable spaces</i></p>
	<p><input type="checkbox"/> The space is smaller than 50m<sup>2</sup></p> <p><b>OR</b></p>	<p>Refer to functional space area information confirmed as per <i>Section 4.2 Determining office NLA</i></p>
	<p><input type="checkbox"/> The space does not contain at least 50m<sup>2</sup> of <b>open office space</b></p> <p><b>OR</b></p>	<p>Mark up a floor plan with dimensions clearly showing the <b>functional space</b> has less than 50m<sup>2</sup> of <b>open office space</b></p>
	<p><input type="checkbox"/> <b>Open office space</b> is not at least 15% of total <b>functional space</b> area</p> <p><b>OR</b></p>	<p>Mark up a floor plan with dimensions clearly showing <b>open office space</b> is less than 15% of the total <b>functional space</b> area.</p>
	<p>There is no existing or <b>proposed lighting system</b>.</p>	<p>Take photographs demonstrating no installed lighting system</p> <p><b>AND</b></p> <p>Make site notes confirming there is no contractual agreement for a <b>proposed lighting system</b> (see <i>Section 9 Proposed systems</i>).</p>

ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
<p><b>For each functional space:</b></p> <p><b>Confirm luminaire details</b></p>	<p><input type="checkbox"/> Identify all <b>luminaire</b> types in the <b>GLS</b> for the <b>functional space</b>.</p>	<p><i>Section 5.3 Luminaire schedule</i></p>
	<p><input type="checkbox"/> Take photographs showing number, type and <b>wattage</b> of all <b>lamp</b> types present in all <b>luminaires</b> used in the <b>GLS</b> (where not already completed). Collect equipment lists and additional photographs of replacement lamp stocks where in-situ lamp photographs are unable to be taken.</p>	<p>Note <b>assessors</b> only need to take photographs/document each <b>luminaire</b> type <u>once</u> for evidence purposes i.e. every luminaire identified in the luminaire schedule must have one set of associated documentation. <i>Section 5.4 Lamp details</i></p>
	<p><input type="checkbox"/> Take photographs, use a <b>ballast</b> discriminator or collect other evidence confirming ballast type or <b>control gear</b> type for all <b>lamps</b> used in the <b>GLS</b>.</p>	<p>Other evidence can include photographs of <b>lamp</b> starters or documented evidence such as installed equipment lists. <i>Section 5.5 Identifying the ballast</i></p>
	<p><input type="checkbox"/> Where lamp type or power cannot be determined, include the name and description of the <b>luminaires</b> in site notes and use default lamp type/wattage.</p>	<p><i>Section 5.4.6 Default lamp values</i></p>
	<p><input type="checkbox"/> Photograph of stickers/other evidence delamping is intentional. <b>AND</b> Site notes confirming more than 80% of <b>luminaires</b> have been delamped.</p>	<p>Evidence of intentional delamping (if applicable).  See <i>Section 5.4.7 Treatment of delamped luminaires</i>.</p>



ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
<p><b>For each functional space:</b></p> <p><b>Confirm NLPD assessment method</b></p>	<p>Identify the appropriate <b>NLPD</b> assessment method.</p>	<p>Follow the flow chart shown in <i>Figure 6</i>.</p>
<p><b>NLPD assessment:</b></p> <p><b>Grid method</b></p>	<ul style="list-style-type: none"> <li data-bbox="517 448 1339 568">❑ Confirm repeating <b>luminaire</b> grid covers at least 50% of the <b>functional space</b> area, or at least 250m<sup>2</sup> (whichever is smaller).</li> <li data-bbox="517 568 1339 687">❑ Take photographs of the ceiling grid that clearly show <b>luminaire</b> spacing and type.</li> <li data-bbox="517 687 1339 839">❑ Take photographs of the ceiling grid that clearly show the number of tiles in each repeating grid unit.</li> <li data-bbox="517 839 1339 960">❑ Confirm that there are only minor variations in <b>luminaire</b> types across the <b>open office space</b> compared to the simple repeating grid being assessed.</li> </ul>	<p>Obtain <b>RCPs</b>, mark up tenancy floor plans or make site notes to document repeating <b>luminaire</b> grid coverage.</p> <hr/> <p>Ensure photographs are clear and easily understood, take multiple angles if required. See <i>Example documentation storage and labelling methodology</i>.</p> <hr/> <p>Make site notes documenting repeating grid size i.e. 4 x 2 tiles. Confirm through additional site notes any variation in the area of the repeating grid unit i.e. 4 x 2 tiles with alternating 3.5 x 2 tile repeating grid units.</p> <hr/> <p>Make site notes confirming only minor variations in <b>luminaire</b> types, see <i>Section 6.3.3 Grid Method</i>.</p>

ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
<b>NLPD assessment:</b>	<b>Aggregate method 1, 2 and 3</b> all require similar documentation and evidence:	See <i>Section 6.4 Documentation requirements – NLPD</i> .
<b>Aggregate methods</b>	<input type="checkbox"/> <b>Aggregate method 1</b> Mark up floor plans clearly showing <b>open office space</b> dimensions and measurements.	Confirm <b>open office space</b> is at least 50% of the <b>functional space</b> area or at least 250m <sup>2</sup> , whichever is smaller.
	<input type="checkbox"/> <b>Aggregate method 2</b> Mark up floor plans clearly showing <b>open office space</b> and <b>cell office</b> area dimensions and measurements.	Confirm <b>open office space</b> plus <b>cell office space</b> is at least 50% of the <b>functional space</b> area or at least 250m <sup>2</sup> , whichever is smaller.
	<input type="checkbox"/> <b>Aggregate method 3</b> Count all <b>GLS luminaires</b> in the <b>functional space</b> .	No minimum requirements, any <b>assessable functional space</b> can be assessed using aggregate method 3. See <i>Section 6.3.6 Aggregate Method 3</i> and also <i>Figure 6</i> .
	<input type="checkbox"/> Confirm <b>sample space</b> contains all of the <b>luminaire</b> types present in the <b>open office space</b> in a similar proportion to the whole open office space.	Make site notes to confirm this has been checked.
	<input type="checkbox"/> Count all <b>GLS luminaires</b> in the <b>sample space</b> . For <b>aggregate method 3</b> , this is all luminaires in the functional space.	Make site notes identifying <b>luminaire</b> types and counting all luminaires in the <b>sample space</b> .
<b>For each functional space:</b>	Identify the lighting <b>control type</b> :	Follow the flow chart as per <i>Figure 7</i> .
<b>Confirm lighting control type:</b>	<input type="checkbox"/> Occupancy controls - Is more than 50% of the <b>functional space</b> operating on occupancy controls?	See documentation requirements as per 'Lighting control type – Occupancy Controls' below.
	<input type="checkbox"/> Timer controls - Is more than 50% of the <b>functional space</b> operating on timer and/or supervisory controls?	See documentation requirements as per 'Lighting control type – Timer Control' below.
	<input type="checkbox"/> If neither of the above options is applicable, or <b>control type</b> cannot be determined, then select manual controls.	No documentation requirements for manual controls (default case).

ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
<p><b>Lighting control type:</b></p> <p><b>Occupancy controls</b></p>	<p><input type="checkbox"/> Confirm occupancy controls cover more than 50% of total <b>functional space</b> area.</p>	<p>Provide a sketch of controls coverage  <b>OR</b>                      Marked up floor plan showing controls coverage  <b>OR</b>                      Reflected ceiling/controls plan showing controls coverage.</p>
	<p><input type="checkbox"/> Confirm presence of occupancy sensors.</p>	<p>Take photographs of sensors installed in the <b>functional space</b>  <b>OR</b>                      Provide a copy of the product manual of the occupancy sensor manufacturer.</p>
	<p><input type="checkbox"/> Confirm location of occupancy sensors.</p>	<p>Provide a <b>reflected ceiling plan</b> or controls diagram  <b>OR</b>                      Sketch showing occupancy sensor locations  <b>OR</b>                      Notes showing count of total number of occupancy sensors.</p>
	<p><input type="checkbox"/> Confirm size of largest occupancy sensor control zone (largest zone size must be smaller than 100m<sup>2</sup> to achieve 'Good' <b>control capacity</b>).</p>	<p>Mark up floor plan or <b>reflected ceiling plan</b> clearly showing area measurements of the control zones covered by the occupancy controls.                      See <i>Appendix E: Lighting Control Assessment Examples</i>.</p>
	<p><input type="checkbox"/> Confirm details for any <b>luminaires</b> with integrated occupancy sensors</p>	<p>Photograph of occupancy sensors integrated into <b>luminaires</b>.  <b>AND</b>                      Product data sheet or similar detailing occupancy control capabilities of the <b>luminaire</b>.  <b>AND</b>                      As installed equipment lists <b>OR reflected ceiling plans OR</b> lighting diagrams confirming that all assessed <b>luminaires</b> in the <b>functional space</b> include integrated occupancy sensor controls.</p>

ITEM	INFORMATION CHECKLIST	COMMENT / DATA REQUIREMENTS
<p><b>Lighting control type:</b></p> <p><b>Timer controls and/or supervisory controls</b></p>	<p><input type="checkbox"/> Confirm timer and/or supervisory controls cover more than 50% of total <b>functional space</b> area.</p>	<p>Provide a sketch of controls coverage</p> <p><b>OR</b></p> <p>Marked up floor plan showing controls coverage</p> <p><b>OR</b></p> <p>Reflected ceiling/controls plan showing controls coverage.</p>
	<p><input type="checkbox"/> Confirm presence of timer controls.</p>	<p>Provide a copy of system description from manual identifying time switch control</p> <p><b>OR</b></p> <p>Other drawings or documentation that demonstrates presence of time switch control</p> <p><b>OR</b></p> <p>Photograph indicating presence of after-hours lighting control independent of normal switching</p> <p><b>OR</b></p> <p>Site contact confirmation that timer controls are in use <b>AND</b> photograph of time switch</p> <p><b>OR</b></p> <p>Site contact confirmation that BMS timer controls are in use <b>AND</b> photograph of BMS timer schedule for each <b>functional space</b>.</p>

- ❑ Confirm presence of **supervisory control system**.

Provide copy of system description from operations/maintenance manual identifying **supervisory control system**

**OR**

Photograph of **supervisory control system** hardware or lighting controllers

**OR**




Other system drawings or documentation that demonstrates presence of **supervisory control system**





**OR**




Photograph of light switch showing that it is a toggle type (e.g. standard toggle switch or a spring return press switch).

# Appendix B Common Lamp Types





**Table 4: Common lamp types**

Lamp Type	DESCRIPTION	LAMP NOMINAL SIZES AND WATTAGES	NOTES AND EXAMPLES
T5	<p><b>Linear fluorescent</b> with diameter 5/8 inch (16mm). Only operates on electronic <b>ballast</b>.</p> <p>Where the specific T5 lamp type is unknown, assume T5 high efficiency (HE) type.</p>	<p>T5 600mm = 14W (HE), 24W (HO)                      T5 900mm = 21W (HE), 39W (HO)                      T5 1200mm = 28W (HE), 54W (HO)                      T5 1500mm = 36W (HE), 80W (HO)</p> <p>'Eco' versions of the HE and HO type lamps are also available, see <i>Appendix C: Common Lamp Types</i>. These are general wattages only and may vary in practice.</p>	 <p>T5 lamps are noticeably narrower than T8 lamps.</p>
T5 retrofit adapter	<p><b>Linear fluorescent</b> with adapter to install diameter 5/8 inch (16mm) lamp into fitting designed for diameter 8/8 inch (26mm) lamps.</p>	<p>Various sizes &amp; wattages as above                      See <i>Section 5.4.9 Treatment of T5 adapters</i> for discussion of retrofit T5 adapters.</p>	
T8 or T12	<p><b>Linear fluorescent</b> with diameter 8/8 or one inch (T8, 26mm) or 1 1/8 inch (T12, 38mm).</p> <p>Can be halophosphor, triphosphor or quad phosphor.</p> <p>Can operate on magnetic or electronic <b>ballast</b>.</p>	<p>T8 600mm = 18W                      T8 900mm = 30W                      T8 1200mm = 36W                      T8 1500mm = 58W                      T8 1800mm = 70W                      T12 600mm = 20W                      T12 900mm = 30W                      T12 1200mm = 40W                      T12 1500mm = 65W                      T12 1800mm = 77.5W</p> <p>These are general wattages only and may vary in practice.</p>	

Lamp Type	DESCRIPTION	LAMP NOMINAL SIZES AND WATTAGES	NOTES AND EXAMPLES
<p><b>CFLn</b></p>	<p>A single-ended <b>compact fluorescent lamp</b> with non-integral <b>ballast</b> (i.e. ballast is separate from lamp). Can operate on magnetic or electronic ballast.</p>	<p>Length ~150mm (typical) Can vary 120 – 570mm Various wattages</p>	
<p><b>CFLi</b></p>	<p>A single-ended <b>compact fluorescent lamp</b> with integral <b>ballast</b>.</p>	<p>Length ~150mm (typical) Various wattages</p>	
<p><b>Circular fluorescent</b></p>	<p>A fluorescent lamp in a circular shape Can operate on magnetic or electronic <b>ballast</b>.</p>	<p>Diameter ~300mm (typical) 22W, 32W, 40W</p>	
<p><b>Halogen low voltage (12V)</b></p>	<p>Lighting systems operating on 12V with magnetic OR electronic <b>transformer</b>.</p>	<p>50W, 35W, 20W</p>	

Lamp Type	DESCRIPTION	LAMP NOMINAL SIZES AND WATTAGES	NOTES AND EXAMPLES
<p><b>Incandescent and halogen (240V)</b></p>	<p>Mains voltage general purpose <b>lamps</b> and down lights with no <b>ballast</b> or <b>transformer</b></p>	<p>Various sizes and wattages</p>	
<p><b>LED downlights</b></p>	<p>Becoming more popular as downlights, replacing halogen and compact fluorescent <b>lamps</b>. Operates with an electronic <b>ballast</b>.</p>	<p>Various wattages</p>	 <p>LED downlight in gimble and large LED downlight (CFLn replacement)</p>
<p><b>LED linear fluorescent retrofit tubes</b></p>	<p>LED replacement for linear fluorescent <b>lamps</b>. Operates with an electronic <b>ballast</b></p>	<p>Various wattages</p>	 <p>LED retrofit tube and frosted LED retrofit tube</p>
<p><b>LED Strip light</b></p>	<p>LED Strip lighting. Increasing use for feature lighting. Operates with an electronic <b>ballast</b></p>	<p>Various wattages, typically measured in W/m</p>	



Lamp Type	DESCRIPTION	LAMP NOMINAL SIZES AND WATTAGES	NOTES AND EXAMPLES
<p><b>LED Incandescent retrofit bulbs</b></p>	<p>LED retrofit for incandescent <b>lamp</b>. Some operate with an electronic <b>ballast</b></p>	<p>Various wattages</p>	
<p><b>LED Panel</b></p>	<p>LED panel. Typically installed as a luminous ceiling tile.</p>	<p>Various wattages</p>	
<p><b>Metal halide</b></p>	<p>Becoming more popular as down lights and spotlights. Can operate on magnetic or electronic <b>ballast</b>.</p>	<p>Reflector diameter ~100mm 20W, 35W, 50W, 70W (office applications)</p>	
<p><b>Mercury Vapour</b></p>	<p>Becoming less common in office applications. Usually operates with magnetic <b>ballast</b>, also comes in a self-ballasted form which runs on mains voltage.</p>	<p>Various sizes and wattages</p>	
<p><b>Other lamp types</b></p>	<p><b>Lamp</b> types not listed above are discussed in <i>Section 5.4.2</i>.</p>	<p>Various</p>	<p>N/A</p>

## Appendix C Common Lamp Types

The total **luminaire** power for each luminaire is determined by the equations defined in *Table 5*, which are based on the **lamp** type and **ballast** or **transformer** type. Note that the number of lamps present in each luminaire will also affect the luminaire power.

**Table 5: Calculation of Total Luminaire Power (per lamp)**

LAMP TYPE	TOTAL LUMINAIRE POWER (PER LAMP, IN WATTS)	
	Electronic Ballast	Magnetic Ballast
Linear fluorescent T12	N/A	$1.2 \times \text{NLP} + 2.6$
Linear fluorescent T8	$0.9 \times \text{NLP} + 2.6$	$1.16 \times \text{NLP} + 2.6$
Linear fluorescent T5 HE	$1.09 \times \text{NLP} + 0.3$	N/A
Linear fluorescent T5 HE Eco	$\text{NLP} + 0.5$	N/A
Linear fluorescent T5 HO	$1.13 \times \text{NLP} - 1.8$	N/A
Linear fluorescent T5 HO Eco	$1.08 \times \text{NLP} - 4$	N/A
CFL-n	$1.06 \times \text{NLP}$	$1.19 \times \text{NLP} + 2.3$
CFL-i		NLP
Incandescent / halogen – mains voltage		NLP
Incandescent / halogen – low voltage	$1.02 \times \text{NLP} + 1.2$	$1.09 \times \text{NLP} + 4.9$
Metal halide	$1.05 \times \text{NLP} + 6$	$1.11 \times \text{NLP} + 1.6$
Mercury vapour		$1.1 \times \text{NLP} + 10$
LED DL		NLP
LED Linear Fluorescent Retrofit		NLP
LED Panel		NLP
LED Strip Light		NLP
LED Track Light		NLP

NLP = nominal lamp power

Notes:

- **Luminaire** power consumption does not deteriorate over time, although the power factor of fluorescent luminaires may deteriorate as the power factor correction capacitor deteriorates.
- Fixed dimming and fluorescent **ballasts** with a low ballast lumen factor (BLF) are not considered in this **rules** document.
- Equations are based on the median of total circuit **watts** for a wide range of luminaires based on manufacturer's data.
- Where a **lamp** can be selected from the available types above, the use of circuit measurement as per *Section 5.4.4* is NOT permitted.

## Appendix D NLPD calculation examples

### D-1 Grid Method – Example 1

Table 6 summarises the criteria, processes to follow and evidence to retain when conducting a TLA using the **grid method**.

**Table 6: Grid method example 1 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Repeating blocks</b>	From <b>RCP</b> or site inspection photograph, confirm the existence of repeating blocks.	<ul style="list-style-type: none"> <li>RCP or <b>assessor's</b> mock-up of typical grid or photograph demonstrating regular grid.</li> </ul>
<b>Identify repeating block coverage</b>	From <b>RCP</b> or site walk through, confirm the repeating blocks are consistent for either 50% NLA or 250m <sup>2</sup> (whichever is smaller).	<ul style="list-style-type: none"> <li>RCP or <b>assessor's</b> mock-up drawing identifying the area of the repeating block.</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection to identify which type or luminaire listed in <i>Table 1</i> is observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Site notes confirming only minor variations in <b>luminaires</b> present in the functional space compared to the repeating block.</li> <li>Photographs or site notes identifying all qualifying luminaire types are present within the <b>open office area</b>.</li> </ul>

Figure 8 is a **RCP** shows a lighting plan of a typical office space. It can be seen that the general office area is illuminated by only one type of **luminaire**, a 1x28W T5 recessed troffer. The ceiling tile size is to be confirmed. The luminaire placement shown on the RCP indicates that all T5 lights have been spread evenly in repeating blocks, hence the **grid method** is appropriate under this scenario.

Before continuing the assessment, the **assessor** verifies that the **functional space** is **assessable**. This space is **assessable**, because:


- The tenancy is not used for **police or security operations**
- The **functional space** area is not smaller than 50m<sup>2</sup>
- There is at least 50m<sup>2</sup> of **open office space**
- Open office space** makes up at least 15% of the total **functional space** area.




**Figure 8: Sample RCP for grid method – Example 1**

Based on the “Evidence to retain” column in *Table 6*, the following information needs to be obtained:

- 1) The up-to-date **RCP** is obtained as shown in *Figure 8*. Alternatively the following two types of evidence are also acceptable:

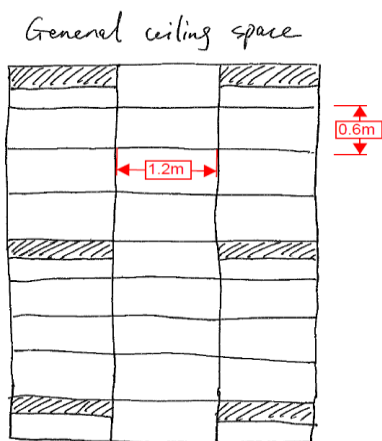

**Figure 9: Assessors mock-up of typical grid**

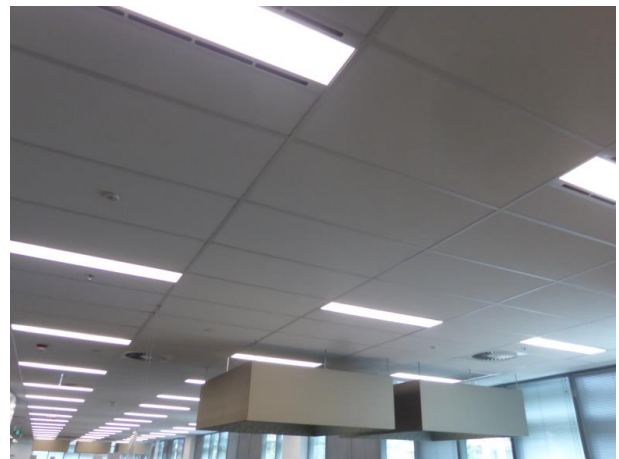

**Figure 10: Photograph showing regular grid**

- 2) Assessor’s mock-up drawing on **RCP** identifying the area of the repeating block, as shown in *Figure 11*.
- 3) Site notes stating that there is minimal variation in **luminaires** across the **open office area**, as shown in *Figure 11*.
- 4) The qualifying **luminaire** detail is provided on the legend of **RCP** and verified on site.

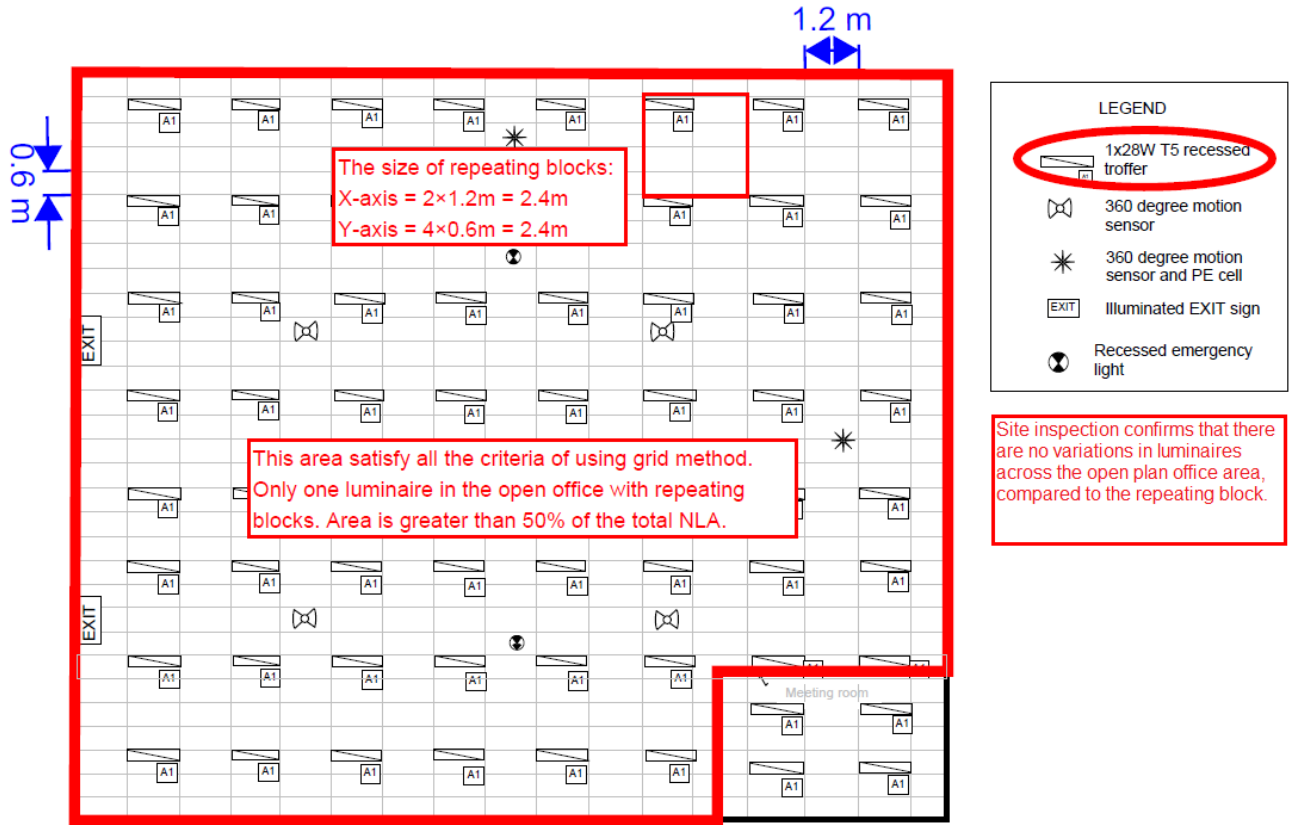


Figure 11: Sample marked up RCP for grid method – Example 1

**D-2 Grid Method – Example 2**


Table 7 summarises the criteria, processes to follow and evidence to retain when conducting a TLA using the **grid method**.

**Table 7: Grid method example 2 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Repeating blocks</b>	From <b>RCP</b> or site inspection photograph, confirm the existence of repeating blocks.	<ul style="list-style-type: none"> <li><b>RCP</b> or <b>assessor’s</b> mock-up of typical grid or photograph demonstrating regular grid.</li> </ul>
<b>Identify repeating block coverage</b>	From <b>RCP</b> or site walk through, confirm the repeating blocks are consistent for either 50% <b>NLA</b> or 250m <sup>2</sup> (whichever is smaller).	<ul style="list-style-type: none"> <li><b>RCP</b> or <b>assessor’s</b> mock-up drawing identifying the area of the repeating block.</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection to identify which type or luminaire listed in <i>Table 1</i> is observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Site notes confirming only minor variations in luminaires present in the <b>functional space</b> compared to the repeating block.</li> <li>Photographs or site notes identifying all qualifying <b>luminaire</b> types are present within the <b>open office area</b>.</li> </ul>

Figure 12 is a marked up **RCP** shows a lighting plan of an office space. It can be seen that the general office area is illuminated by only one type of **luminaire**, a 2x36W T8 unit.

The luminaire placement shown on the **RCP** indicates that there is a repeating grid of the 2x36W T8 luminaires in repeating blocks, hence the **grid method** is appropriate under this scenario. The repeating block size is confirmed as 2.4m x 2.4m.

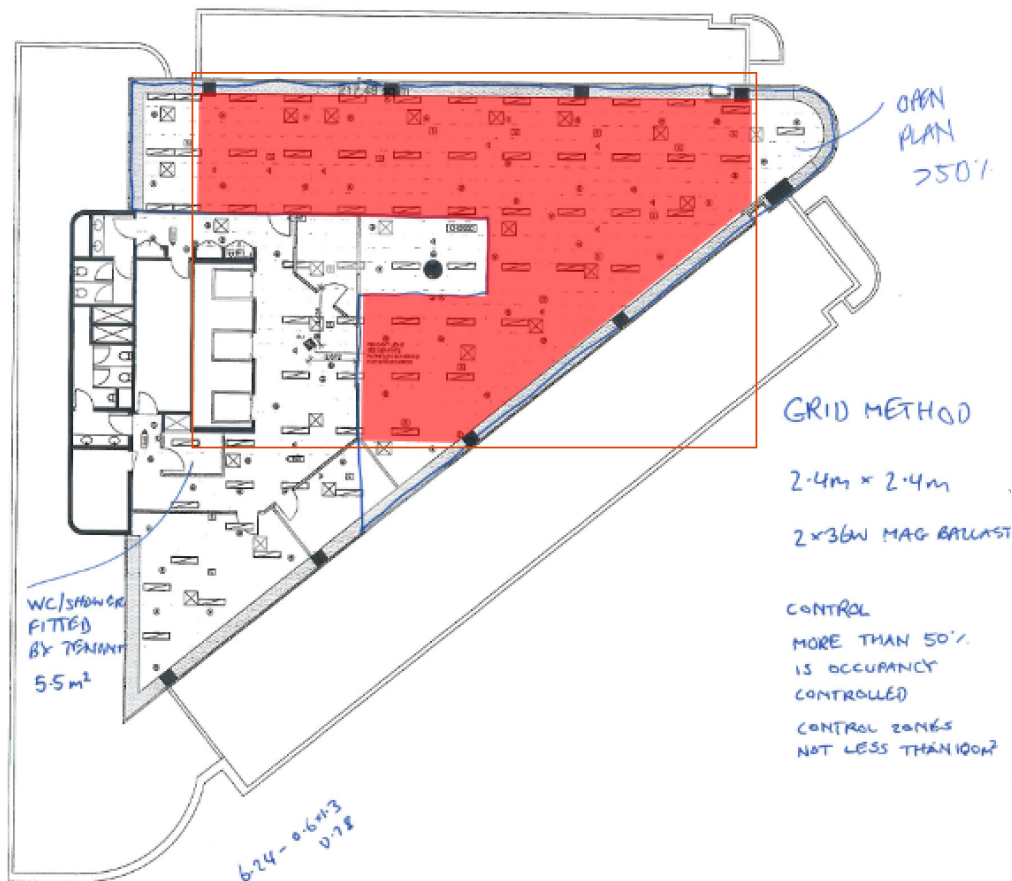

**Figure 12: Sample marked up RCP for grid method – Example 2**

Based on the “Evidence to retain” column in *Table 7*, the following information needs to be obtained.

- 1) The up-to-date and marked up **RCP** is obtained as shown in *Figure 12*. The **assessor** has also collected a photograph showing the repeating grid as shown in *Figure 13*.
- 2) A regular repeating block is demonstrated in the **RCP**, noting that some **luminaires** are ‘out of alignment’ with the standard grid but this does not impact the assessment.
- 3) **Assessor’s** mock-up drawing on the **RCP** identifying the area of the repeating block is shown in *Figure 12*, confirming more than 50% of the **functional space** area is covered by the repeating block.
- 4) The **assessor** has confirmed that there is minimal variation in luminaires across the **open office area** compared to the repeating block, as shown on the marked up RCP in *Figure 12*.
- 5) The qualifying **luminaire** detail is provided on the legend of the **RCP** and verified by the **assessor** on site.



**Figure 13: Photograph showing regular grid**



### D-3 Aggregate Method 1 – Example 1

Table 8 summarises the criteria, processes to follow and evidence to retain when conducting a TLA using **aggregate method 1**.

**Table 8: Aggregate method 1 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Identify sample space</b>	From <b>RCP</b> or site walk through, confirm the <b>open office area</b> is at least 50% of the <b>functional space NLA</b> or at least 250m <sup>2</sup> (whichever is smaller).	<ul style="list-style-type: none"> <li><b>Functional space NLA</b> evidence to the measurement standard.</li> <li>Marked up floor plans or sketch showing <b>open office areas</b>.</li> <li>Floor plan clearly showing the <b>aggregate method sample space</b>.</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection, identify which type of luminaire listed in <i>Table 1</i> is observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Photographs or site notes identifying all qualifying <b>luminaire</b> types present within the <b>aggregate method sample space</b>.</li> <li>Site notes identifying a count of all luminaires within the <b>aggregate method sample space</b>.</li> </ul>

Figure 14 is a **RCP** for a typical office space. It can be seen that the general office area is illuminated by only one type of **luminaire**, a 1x28W T5 recessed troffer.

The **luminaire** placement shown on the RCP indicates that there are no repeating blocks for the luminaires (**grid method** not applicable), and the **open office area** is greater than 50% of the total **functional space NLA**. Hence the **aggregate method 1** is appropriate under this scenario.

Before continuing the assessment, the **assessor** verifies that the **functional space** is **assessable**. This space is **assessable**, because:

- The tenancy is not used for **police or security operations**
- The **functional space** area is not smaller than 50m<sup>2</sup> (369m<sup>2</sup> > 50m<sup>2</sup>)
- There is at least 50m<sup>2</sup> of **open office space**
- Open office space** makes up at least 15% of the total **functional space** area.



**Figure 14: Sample RCP for aggregate method 1 – Example 1**

Based on the “Evidence to retain” column in *Table 8*, the following information needs to be obtained:

- 1) As shown in *Figure 15*, the sample space used for **aggregate method 1** is clearly marked on the **RCP**.
- 2) The **NLA** figure is listed in *Figure 15*, and was obtained from an NLA survey completed to the **measurement standard**.
- 3) The qualifying **luminaire** detail is provided on the legend of the **RCP** and verified on site.
- 4) Site count of all **luminaires** within the **aggregate method sample space** is recorded in the site notes shown on *Figure 15*.



Figure 15: Sample marked up RCP for aggregate method 1 – Example 1

## D-4 Aggregate Method 1 – Example 2

Table 9 summarises the criteria, processes to follow and evidence to retain when conducting a TLA using aggregate method 1.

**Table 9: Aggregate method 1 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Identify sample space</b>	From <b>RCP</b> or site walk through, confirm the <b>open office area</b> is at least 50% of the <b>functional space NLA</b> or at least 250m <sup>2</sup> (whichever is smaller).	<ul style="list-style-type: none"> <li><b>Functional space NLA</b> evidence to the measurement standard.</li> <li>Marked up floor plans or sketch showing <b>open office areas</b>.</li> <li>Floor plan clearly showing the <b>aggregate method sample space</b>.</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection, identify which type of luminaire listed in <i>Table 1</i> is observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Photographs or site notes identifying all qualifying <b>luminaire</b> types present within the <b>aggregate method sample space</b>.</li> <li>Site notes identifying a count of all <b>luminaires</b> within the <b>aggregate method sample space</b>.</li> </ul>

Figure 16 shows a typical **functional space** within an office building. The **assessor** has used the *PCA March 1997 Method of Measurement for Lettable Area* to scale the marked-up measurements off this drawing, to ±5% accuracy.

The **assessor** has determined that this functional space is **assessable**, because:

- The tenancy is not used for **police or security operations**.
- The **functional space** area is not smaller than 50m<sup>2</sup>.
- There is at least 50m<sup>2</sup> of **open office space**.
- Open office space makes up at least 15% of the total functional space area.

The **assessor** decided to use **aggregate method 1** for their **NLPD** assessment, and have selected an assessment area represented in *Figure 16* by the highlighted open office areas labelled "Area 1", "Area 2" and "Area 3". The total **aggregate method 1 sample space** is the sum of these three areas, 273.30m<sup>2</sup>.

- This is greater than the required 250m<sup>2</sup>, and so it is acceptable to use **aggregate method 1** as long as documentation requirements can be met.

Note: This example shows that the assessed area does not need to be contiguous. Separate **open office areas** in the same **functional space** can be combined to achieve the minimum area (50% of **functional space** or 250m<sup>2</sup>).

The **assessor** has made site notes identifying the types and quantities of lights, as per their site notes on *Figure 16*.

*Figure 18* and *Figure 18* are photographs showing the **lamp** power and **ballast** discriminator tests, as required for fluorescent **luminaires**.

**Lamp** power for the CLF-n downlight has been proven using a photograph of a spare lamp, and a zoomed-out photograph of the **luminaire** in-situ, as described in *Section 5.6 Documentation requirements – Luminaires*.



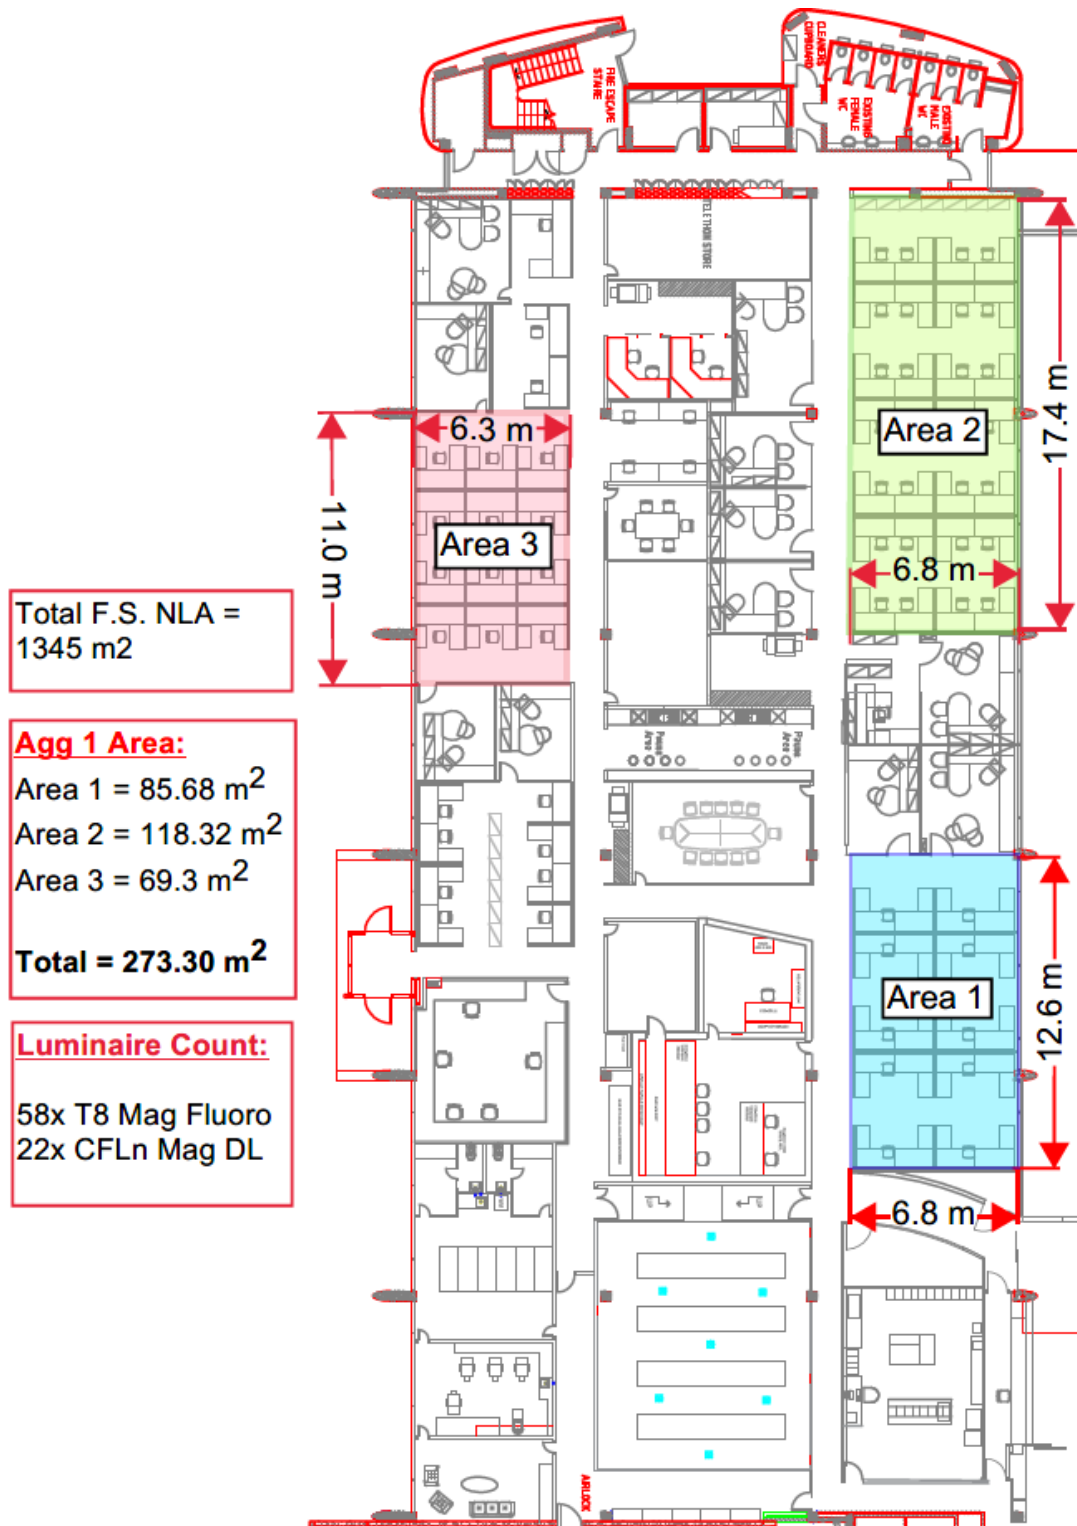


Figure 16: Marked up floor plan showing aggregate method 1 sample space

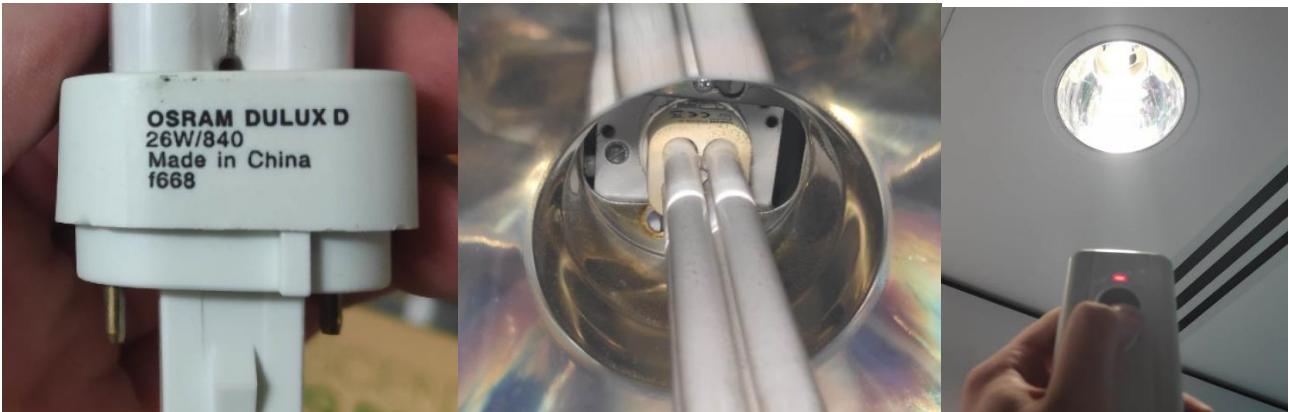

**Figure 17: Photographic Evidence for CFLn downlights**

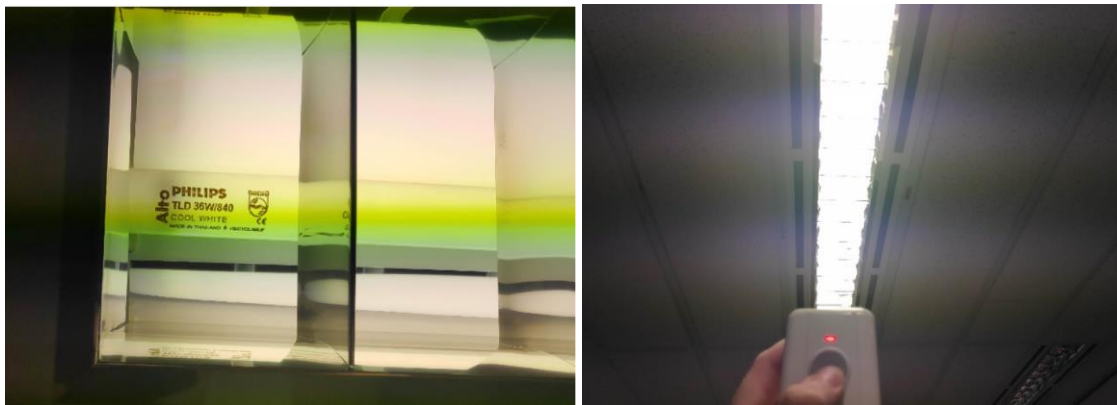

**Figure 18: Photographic Evidence for T8 Troffer lights**

Based on the “Evidence to retain” column in *Table 9*, the following information needs to be obtained:

- 1) **Functional space NLA** evidence, as noted on the floor plan in *Figure 16*. This has been scaled off the floor plan to the appropriate **measurement standard**, to  $\pm 5\%$  accuracy.
- 2) Floor plan clearly showing **aggregate method 1 sample space**, shown in *Figure 16*. The **sample space** has been scaled off the drawing to the appropriate **measurement standard**, to  $\pm 5\%$  accuracy.
- 3) Site notes and photographs identifying all **luminaire** types present within the **aggregate method sample space**, as shown in *Figure 17* and *Figure 18*.
- 4) Site notes identifying a count of all **luminaires** within the **aggregate method sample space**, as shown in *Figure 16*.

## D-5 Aggregate Method 2 – Example 1

Table 10 summarises the criteria, processes to follow and evidence to retain when conducting a TLA using aggregate method 2.

**Table 10: Aggregate method 2 example 1 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Identify sample space</b>	From <b>RCP</b> or site walk through, confirm <b>open office space</b> plus <b>cell office space</b> is at least 50% of the <b>functional space</b> NLA or at least 250m <sup>2</sup> (whichever is smaller).	<ul style="list-style-type: none"> <li><b>Functional space NLA</b> evidence to the measurement standard.</li> <li>Marked up floor plans or sketch showing <b>open office</b> and <b>cell office areas</b>.</li> <li>Floor plan clearly showing the <b>aggregate method sample space</b>.</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection, identify which type of <b>luminaire</b> listed in <i>Table 1</i> is observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Photographs or site notes identifying all qualifying luminaire types present within the <b>aggregate method sample space</b>.</li> <li>Site notes identifying a count of all <b>luminaires</b> within the <b>aggregate method sample space</b>.</li> </ul>

Figure 19 is a **RCP** for a typical office space. It can be seen that the general office area is illuminated by only one type of **luminaire**, a 1x28W T5 recessed troffer. The **luminaire** placement shown on the RCP indicates that there are no repeating blocks for the luminaires (**grid method** not applicable), and the **open office space** is less than 50% of the total **NLA** and also less than 250m<sup>2</sup> (**aggregate method 1** not applicable).

Hence the **aggregate method 2** is appropriate under this scenario. Note that the **aggregate method 2** includes some of the **luminaires** in **cell offices**, which include another type of lamp, the 2x13W compact fluorescent downlight.

The **assessor** has determined that this **functional space** is **assessable**, because:

- The tenancy is not used for **police or security operations**.
- The **functional space** area is not smaller than 50m<sup>2</sup> (369m<sup>2</sup> > 50m<sup>2</sup>).
- There is at least 50m<sup>2</sup> of **open office space**.
- Open office space makes up at least 15% of the total **functional space** area.





**Figure 19: Sample RCP for aggregate method 2 Example 1**

Based on the “Evidence to retain” column in *Table 10*, the following information needs to be obtained:

- 1) As shown in *Figure 20*, the total **open office space** is less than 50% of total **NLA**. Hence the sample space used for **aggregate method 2** needs to include some additional **cell office** area.
- 2) The **functional space NLA** is listed in *Figure 20*, and was obtained from an NLA survey completed to the **measurement standard**.
- 3) The qualifying **luminaire** details are provided on the legend of **RCP** and verified on site.
- 4) Site count of all **luminaires** within the **aggregate method sample space** is recorded in *Figure 20*.

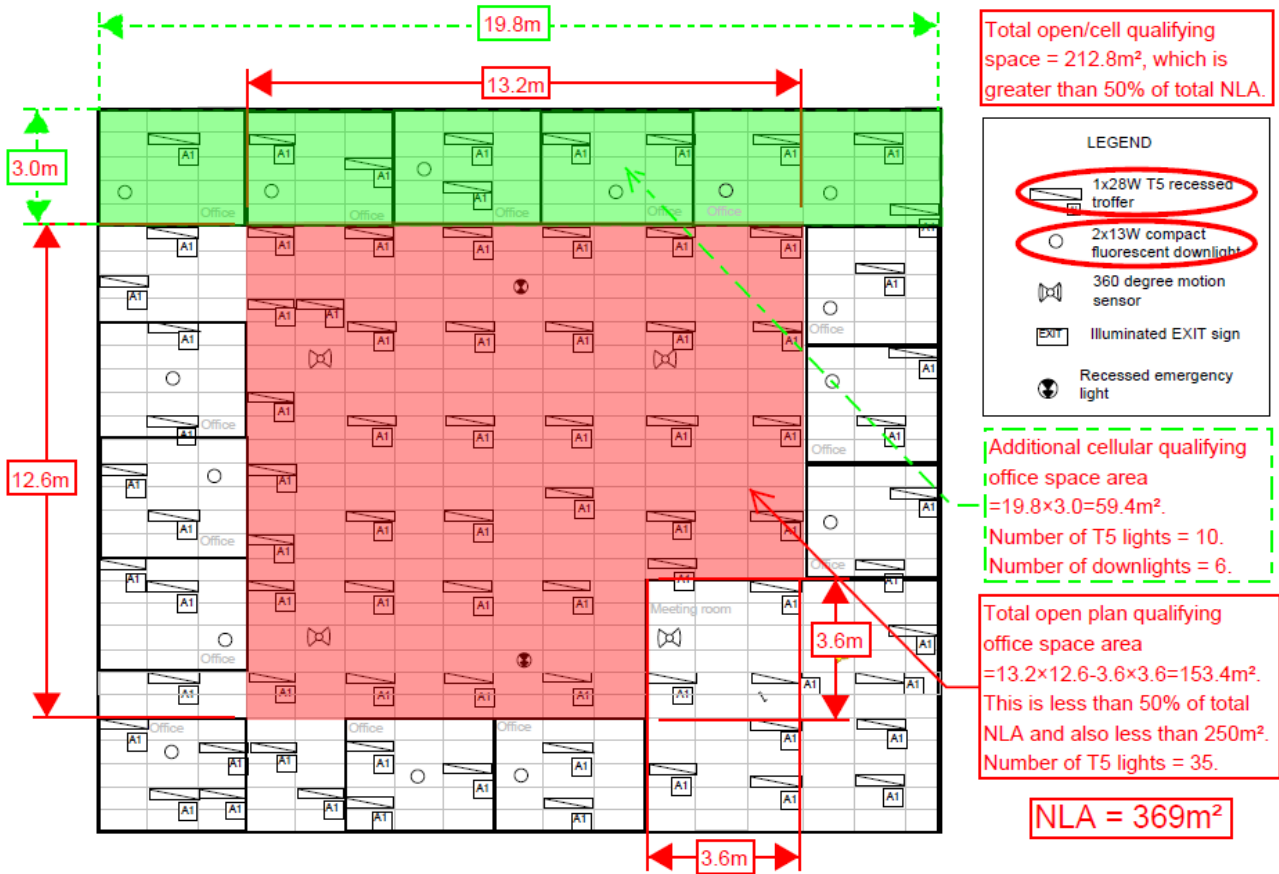


Figure 20: Sample marked up RCP for aggregate method 2 example 1

## D-6 Aggregate Method 2 – Example 2

Table 11 summarises the criteria, processes to follow and evidence to retain when conducting a TLA using **aggregate method 2**.

**Table 11: Aggregate method 2 example 2 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Identify sample space</b>	From <b>RCP</b> or site walk through, confirm <b>open office space</b> plus <b>cell office space</b> is at least 50% of the <b>functional space NLA</b> or at least 250m <sup>2</sup> (whichever is smaller).	<ul style="list-style-type: none"> <li><b>Functional space NLA</b> evidence to the measurement standard.</li> <li>Marked up floor plans or sketch showing <b>open office</b> and <b>cell office</b> areas.</li> <li>Floor plan clearly showing the <b>aggregate method sample space</b>.</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection, identify which type of <b>luminaire</b> listed in Table 1 is observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Photographs or site notes identifying all qualifying luminaire types present within the <b>aggregate method sample space</b>.</li> <li>Site notes identifying a count of all <b>luminaires</b> within the <b>aggregate method sample space</b>.</li> </ul>

Figure 21 is an **RCP** for a typical office space of 461.73m<sup>2</sup>. The **assessor** has determined that the **open office** and **cell office** areas are lit by only one type of **luminaire**, a 2x36W T8 recessed troffer (Figure 22) with magnetic **ballast** (Figure 23).

The **luminaire** placement shown in Figure 21 indicates that there are no repeating blocks so **grid method** is not viable.


The **assessor** has determined that this **functional space** is **assessable**, because:

- The tenancy is not used for **police or security operations**.
- The **functional space** area is not smaller than 50m<sup>2</sup>.
- There is at least 50m<sup>2</sup> of **open office space**.
- Open office space makes up at least 15% of the total **functional space** area.

Table 12 shows the **assessor's** schedule of office spaces, listing the measured areas of each **open office** (labelled as "OA") and **cell office** (labelled as "CO") shown on the RCP which have been scaled off the **RCP** to a ±5% accuracy.

This indicates:

- 
- **Aggregate method 1** is not viable, because the total **open office space** (105.32m<sup>2</sup>) is less than 250m<sup>2</sup>, and is also less than 50% of the total **NLA** for the **functional space** (461.73 m<sup>2</sup>).
  - **Aggregate method 2** is viable, because the required minimum coverage can be achieved (i.e. **open office space** plus **cell office space** must be at least 250m<sup>2</sup>, or 50% of the **NLA** for the **functional space**).
    - The sum of areas for Open Areas 1 to 3 and cell offices 1 to 7 totals 238.46m<sup>2</sup>, which is 52% of the total **functional space** area of 461.73m<sup>2</sup>.

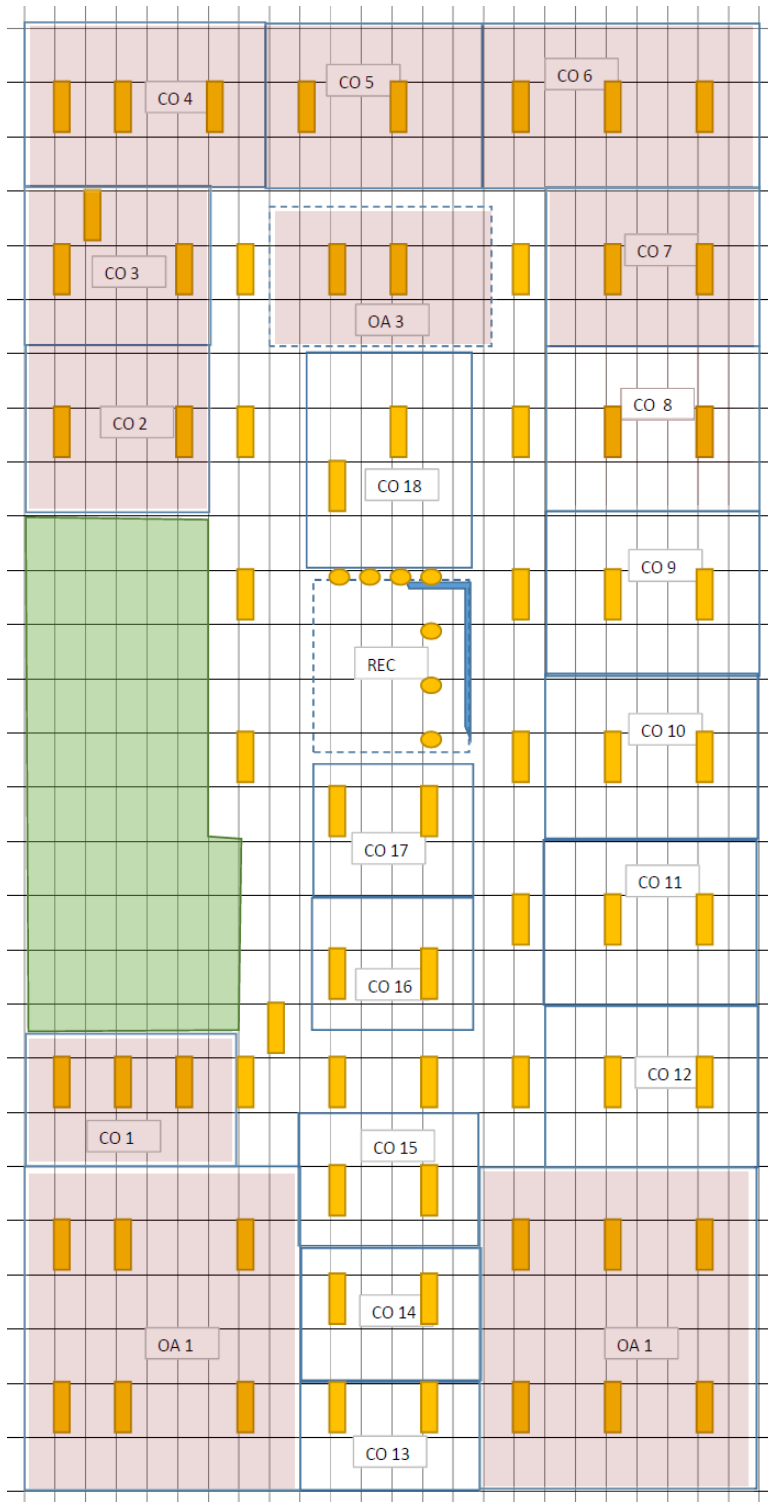

**Figure 21: RCP sketch of a functional space for aggregate method 2 example 2. Sample space is highlighted in orange.**

Location	Area m <sup>2</sup>
Open area 1	45.1
Open area 2	45.1
Open area 3	15.12
Cell office 1	18.23
Cell office 2	21.34
Cell office 3	18.23
Cell office 4	19.44
Cell office 5	15.12
Cell office 6	22.55
Cell office 7	18.23
<b>Sum (sample space area)</b>	<b>238.46</b>
<b>Total functional space NLA</b>	<b>461.73</b>

**Table 12: Aggregate method 2 example 2 area calculations**

Based on the "Evidence to retain" column in *Table 11*, the following information needs to be obtained:

- 1) The **RCP** sketched in *Figure 21* clearly showing the selected sample space.
- 2) **Aggregate method sample space** area calculations ( $\pm 5\%$  accuracy) and total **NLA** figure.
- 3) Because the sketch shown in *Figure 21* is not to scale, additional documentation must be provided to verify the accuracy of the area measurements listed in *Table 12*.
- 4) Site notes or photographs identifying all qualifying **luminaire** types present within the **aggregate method sample space**.
- 5) Site notes identifying a count of all **luminaires** within the **aggregate method sample space**. (This is appropriately demonstrated through the **RCP** sketched in *Figure 21*.)



**Figure 22: Photographs showing 2x36W T8 fluorescent tubes.**



**Figure 23: Photograph showing ballast discriminator test**

## D-7 Aggregate Method 3

As per the **NLPD** Assessment flowchart in *Figure 6*, any **assessable functional space** can be assessed using **aggregate method 3**

**Table 13: Aggregate method 3 summary table**

CRITERIA	PROCESS	EVIDENCE TO RETAIN
<b>Functional space is assessable</b>	Confirm that: <ul style="list-style-type: none"> <li>There is lighting installed in the <b>functional space</b>, or there is a contractual agreement to install a <b>proposed system</b> within three months of the <b>assessment date</b>.</li> <li>The <b>functional space</b> area is equal to or larger than 50m<sup>2</sup>.</li> <li>The <b>functional space</b> contains at least 50m<sup>2</sup> of <b>open office space</b>.</li> <li><b>Open office space</b> in the <b>functional space</b> is at least 15% of the total <b>functional space</b> area.</li> </ul>	<ul style="list-style-type: none"> <li>Floor plan or <b>assessor</b> sketch clearly showing the <b>functional space</b> has at least 50m<sup>2</sup> of <b>open office space</b> and this <b>open office space</b> makes up at least 15% of the total <b>functional space</b> area.</li> <li>Add additional evidence with photographs where possible.</li> <li>Site notes confirming any contractual agreements where a <b>proposed system</b> is to be installed within three months of the <b>assessment date</b>.</li> </ul>
<b>Identify sample space</b>	Confirm that the <b>functional space</b> is <b>assessable</b> .	<ul style="list-style-type: none"> <li><b>Functional space NLA</b> evidence to the measurement standard.</li> <li>Floor plan clearly showing the <b>aggregate method sample space</b> (i.e. the whole <b>functional space</b>).</li> </ul>
<b>Luminaire</b>	From documentation provided or site inspection, identify which types of <b>luminaire</b> listed in <i>Table 1</i> are observed in each <b>functional space</b> .	<ul style="list-style-type: none"> <li>Photographs or site notes identifying all qualifying <b>luminaire</b> types present within the <b>aggregate method sample space</b>.</li> <li>Site notes identifying a count of all <b>luminaires</b> within the <b>aggregate method sample space</b>.</li> </ul>

*Figure 24* is a floor plan for a typical office space. The **assessor** has a copy of a third-party survey of this **functional space**, which was completed to the **measurement standard** (*PCA March 1997 Method of Measurement for Lettable Area*) and shows the total **NLA** for this functional space is 182m<sup>2</sup>.


After visiting this building the **assessor** has also marked up an **RCP** in *Figure 25* which shows a different configuration to the originally provided floor plan in *Figure 24*.

The **open office** and **cell office** areas are lit by only one type of **luminaire**, a 2x28W T5 HE troffer (*Figure 26*).

This marked up RCP in *Figure 25* indicates:


- The functional space is **assessable**, because it contains at least 15% **open office space**.
- There are no repeating blocks of **luminaires** so the **grid method** is not viable.

Neither **grid method** nor **aggregate method 1** can be used, because the total open office space is smaller than 250m<sup>2</sup> and makes up less than 50% of the **functional space** area.

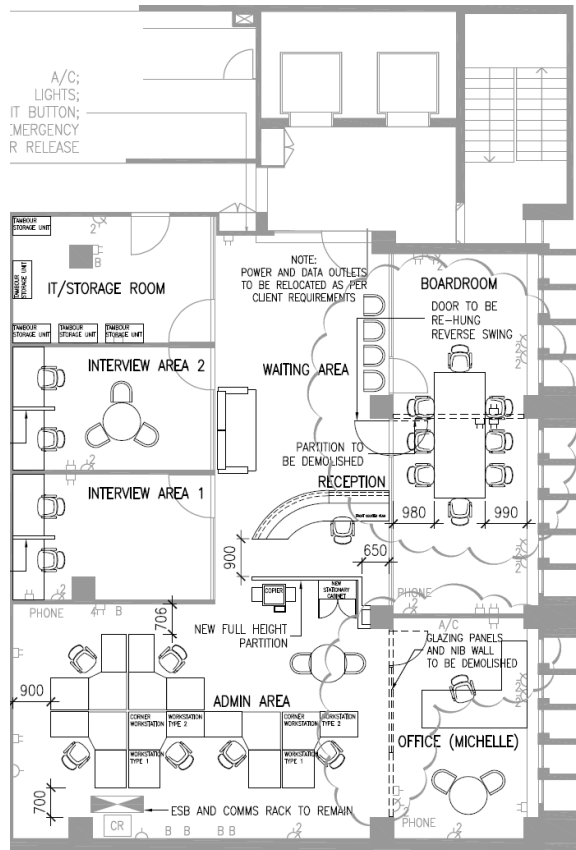

**Figure 24: Floor plan for aggregate method 3**



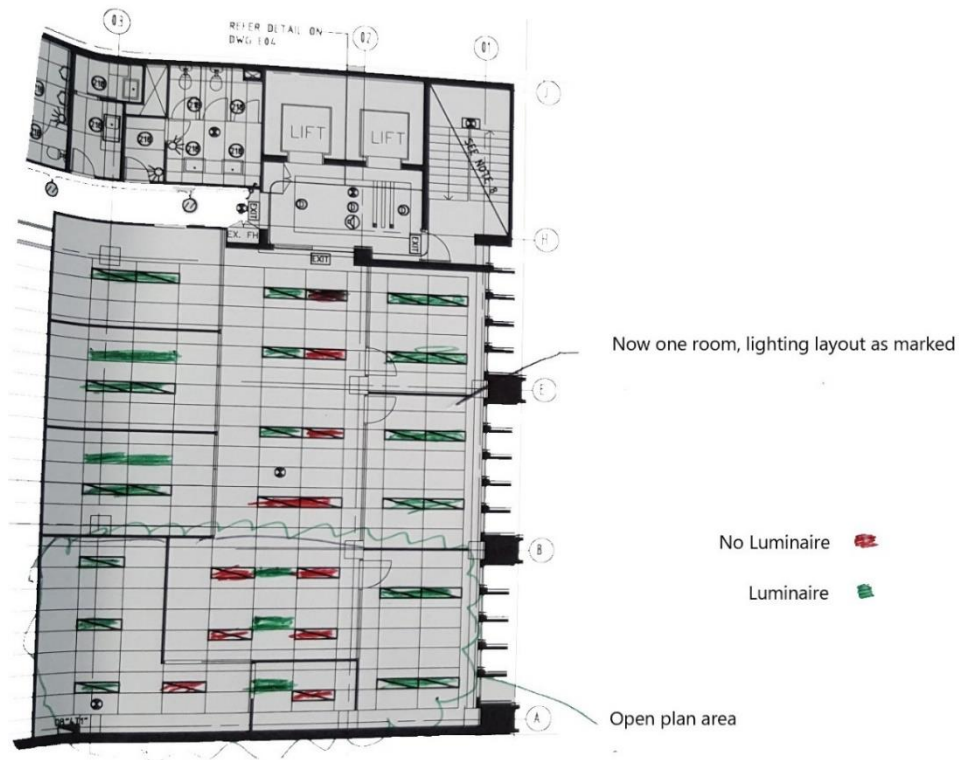

**Figure 25: Assessor's marked-up RCP for aggregate method 3**

Based on the "Evidence to retain" column in *Table 13*, the following information needs to be obtained:

- 1) Copy of the third-party survey of this **functional space**, which was completed to the **measurement standard**.
- 2) Site notes or photographs identifying all qualifying **luminaire** types present within the **aggregate method sample space** (demonstrated by the photographs in *Figure 26*).
- 3) A count of all **luminaires** within the **functional space**. This is appropriately demonstrated through the marked up **RCP** in *Figure 25*. Site notes confirming quantities would also be acceptable.



**Figure 26: Photographs showing the twin tube 28W T5 HE luminaires**

## Appendix E Lighting Control Assessment Examples

The following are examples of how lighting controls are typically represented in as-built drawings and documentation, and explanations of how an as-built plan can be used to:

- assess the **control type**.
- assess the coverage of the **control type**.
- calculate lighting control zone sizes.

### E-1 Assessing control type

The applicable **control type** is the highest rated level of controls that is being used in more than 50% of the **functional space**. The hierarchy for the rating of the lighting **control type** is provided in *Section 7 Lighting control assessment*.

To identify the **control type**, the **assessor** should look for lighting control equipment installed within the **functional space** and document it by taking photographs and making site notes. This includes physical evidence of a:

- occupancy sensor
- time clock controller
- local lighting control panel
- BMS or lighting control head end computer.

Having identified the highest level of controls type in the space, the **assessor** must calculate the coverage of that controls type in the **functional space**.

If the identified **control type** in the **functional space** covers less than 50% of the **functional space** then it does not apply to the rating, and the next highest level of control identified in the **functional space** should be calculated until the highest level of controls type with the applicable coverage has been identified.


Note that if no or insufficient controls evidence is available, the default selection is 'Manual'.

### E-2 50% coverage requirement

While the **functional space** area is generally known, it is necessary to work out a scale to be able to calculate the area of the **controls type** coverage and the control zone size from an **RCP**. The scale can be checked on site by measuring the dimensions of a ceiling tile. It is important not to assume that the tiles are a standard metric size, as in practice there may be numerous grids in use. It is not possible to be sure of ceiling grid dimensions without measurement or other evidence, such as a label from a replacement ceiling tile box.

To calculate whether the controls cover > 50% of the **functional space**, sum the areas of the control zones for occupancy sensing or time clock control and divide the answer by the total area of the **functional space**.

**Figure 27: Plan showing occupancy sensors throughout the site**

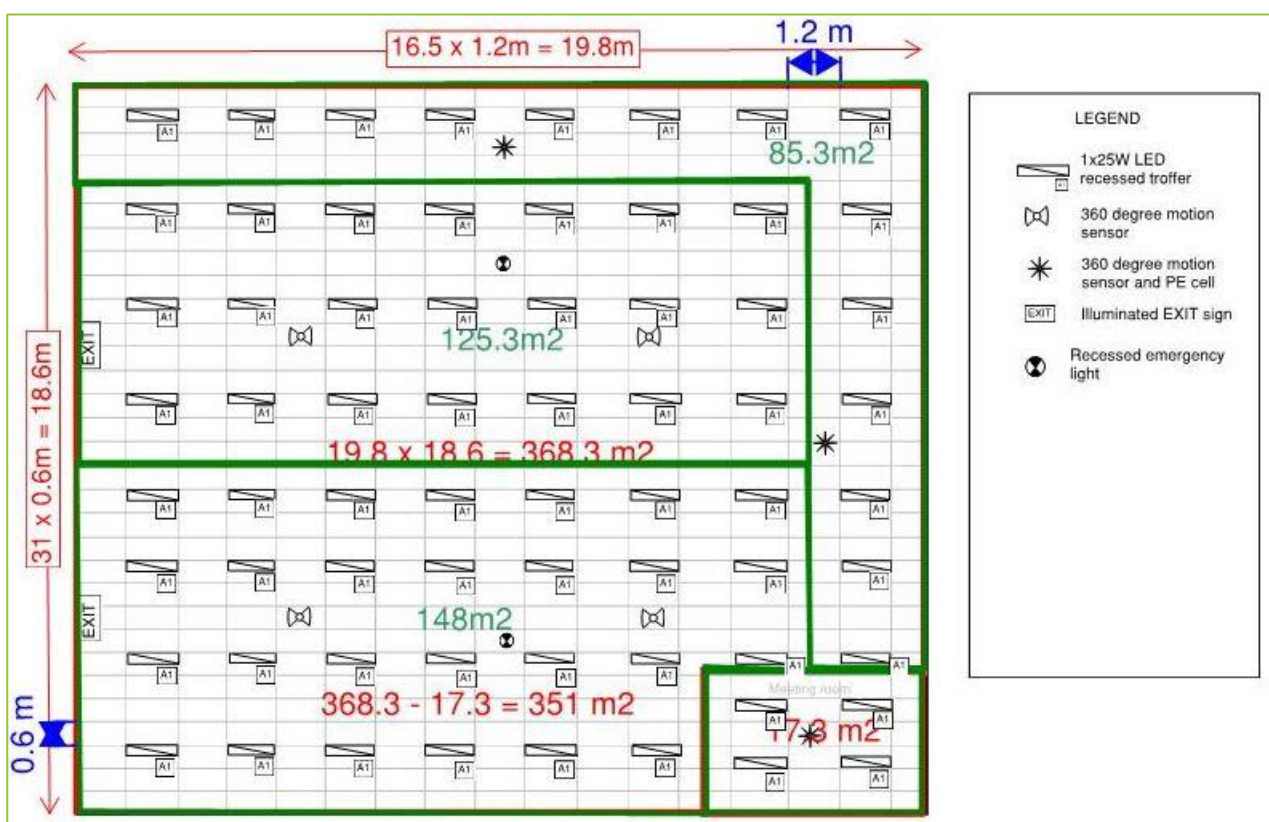


For example, there are four separate areas shown in *Figure 27* and each has at least one occupancy sensor present. As all spaces have occupancy sensors, this is greater than 50% of the **functional space** Area and thus the **control type** for this tenancy is 'Occupancy control'.

Note the provided plans in *Figure 27* do not provide any information about how the **luminaires** in each space are linked to the various occupancy sensors. Additional information would be needed to try and calculate the various control zone sizes in this **functional space**.

Figure 28 shows a plan with perimeter occupancy sensing and daylight harvesting, but with no controls marked for the rest of the **Functional Space**. In this case it is possible that the remaining space is controlled by some form of manual or timer control.

**Figure 28: Plan showing perimeter occupancy sensing and daylight harvesting, with no controls marked for the rest of the tenancy.**

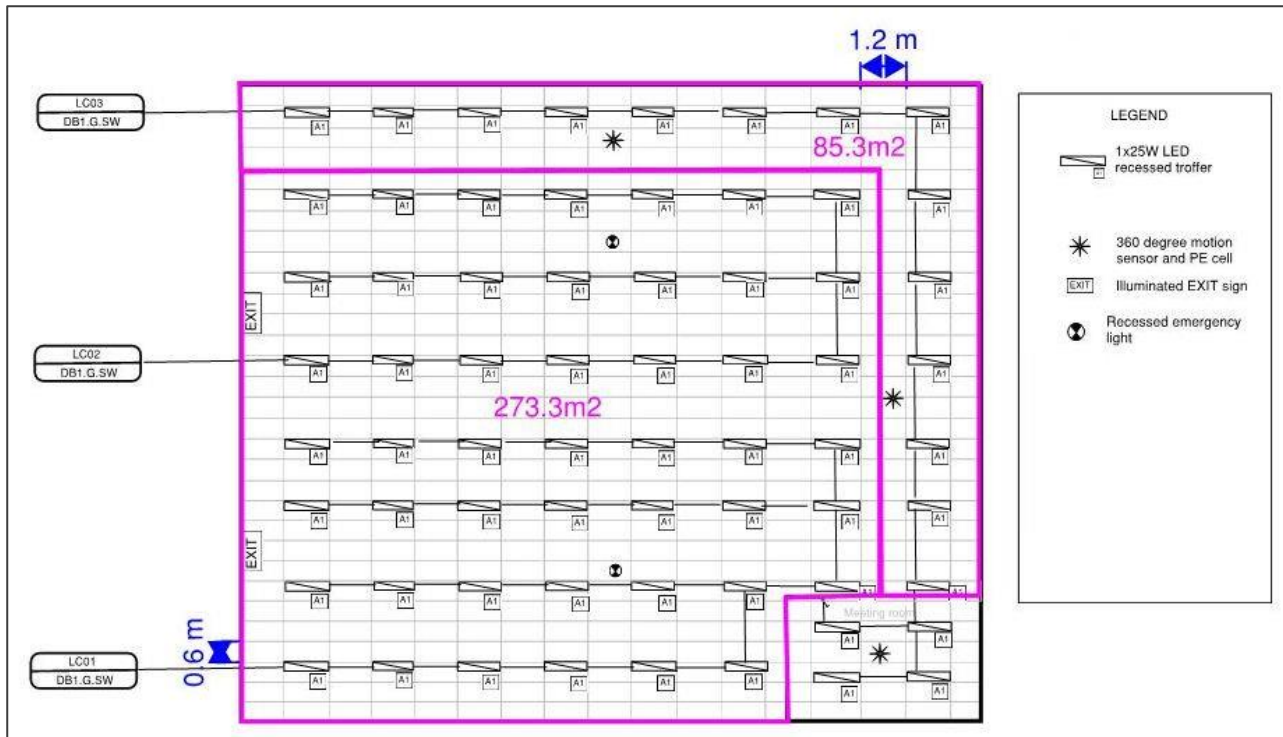

The **assessor** can try and understand the controls by:

- asking the facilities manager about timer controls.
- asking building occupants about any automatic or timed behaviour of the lighting.
- checking local lighting control panels for evidence of timer controls.
- checking the O&M manual documentation for a functional controls description mentioning timer controls.
- looking in the switch board/s for clock equipment.
- checking the central BMS or head end computer for lighting schedules.

Evidence of the presence of the timer controls should be collected as per *Section 7.3 Documentation requirements – Lighting Controls Assessment* including:

- photographs of time clock equipment.
- photographs of local lighting control panels showing toggle or timer switches.
- confirmation of BMS or lighting control head end computer.
- copies of drawings or documentation such as O&M manual.

In *Figure 28* the occupancy sensing area is 85.3m<sup>2</sup>, and the total area of the **functional space** is 351m<sup>2</sup> so the controls coverage is:

$$85.3/351 = 0.24 \text{ or } 24\%.$$

---

This would not qualify as being >50% of the total **functional space** area running on Occupancy controls.

If evidence can be collected by the **assessor** that the remaining **functional space** area is controlled by timer controls, then the timer control area is 273.3m<sup>2</sup> and the controls coverage is:

$$273.3/351 = 0.78 \text{ or } 78\%.$$


This would qualify as being >50% of the **functional space** area on Timer control.

If no evidence can be collected that lighting is switched off automatically either by timer control or occupancy sensing, then the remaining **functional space** should be assessed as 'Manual control'.

**E-3 Calculating control zone size**

Figure 29 shows a lighting plan with no control zones or circuits marked. The information it provides includes the ceiling grid and the **luminaire** and lighting occupancy sensor placements.


**Figure 29: Lighting plan with no control circuits or zones marked**

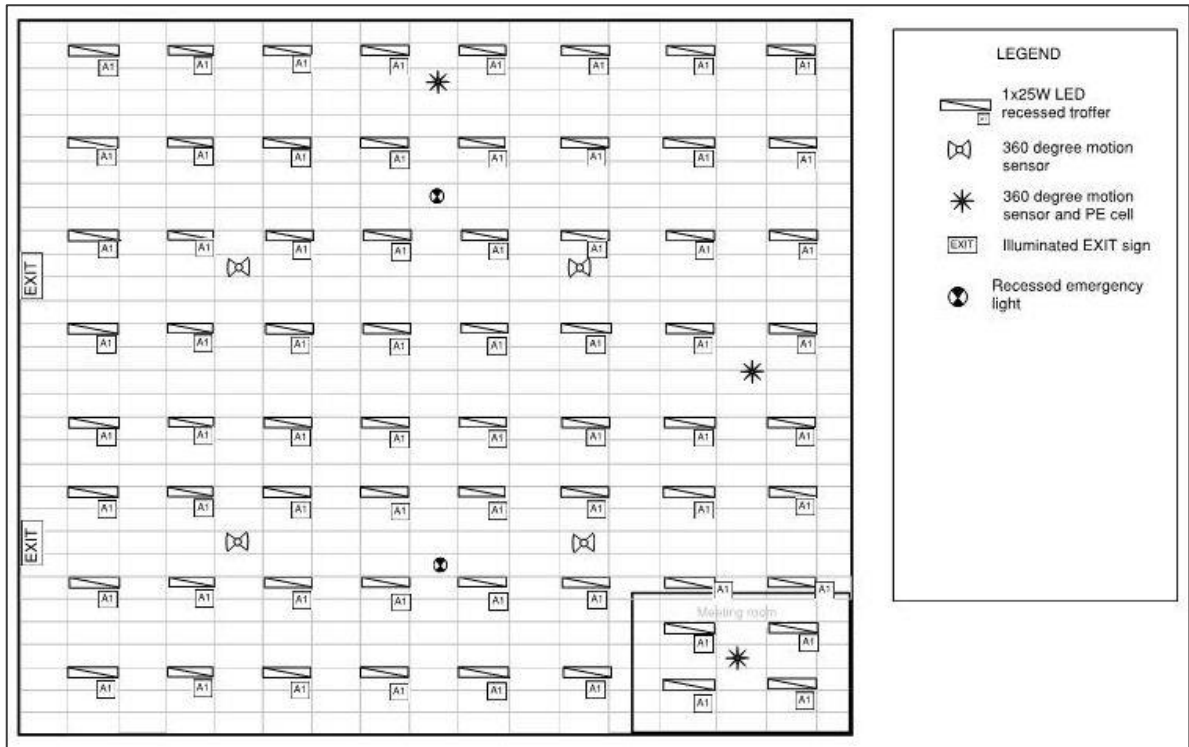

If no plan is provided or the on-site plans are this simple and do not provide information about control zones or circuits, then it is assumed that each sensor switches every light in the space, and the control assessment is based on the total size of the whole **functional space**.

In *Figure 30* the calculated area of the **functional space** is 351m<sup>2</sup> and there are 6 lighting movement sensors shown on the plan in the functional space, but there is no evidence as to how they are circuited or zoned. Therefore the reportable control zone size is 351m<sup>2</sup>.

**Figure 30: Previous diagram with area measurements shown**

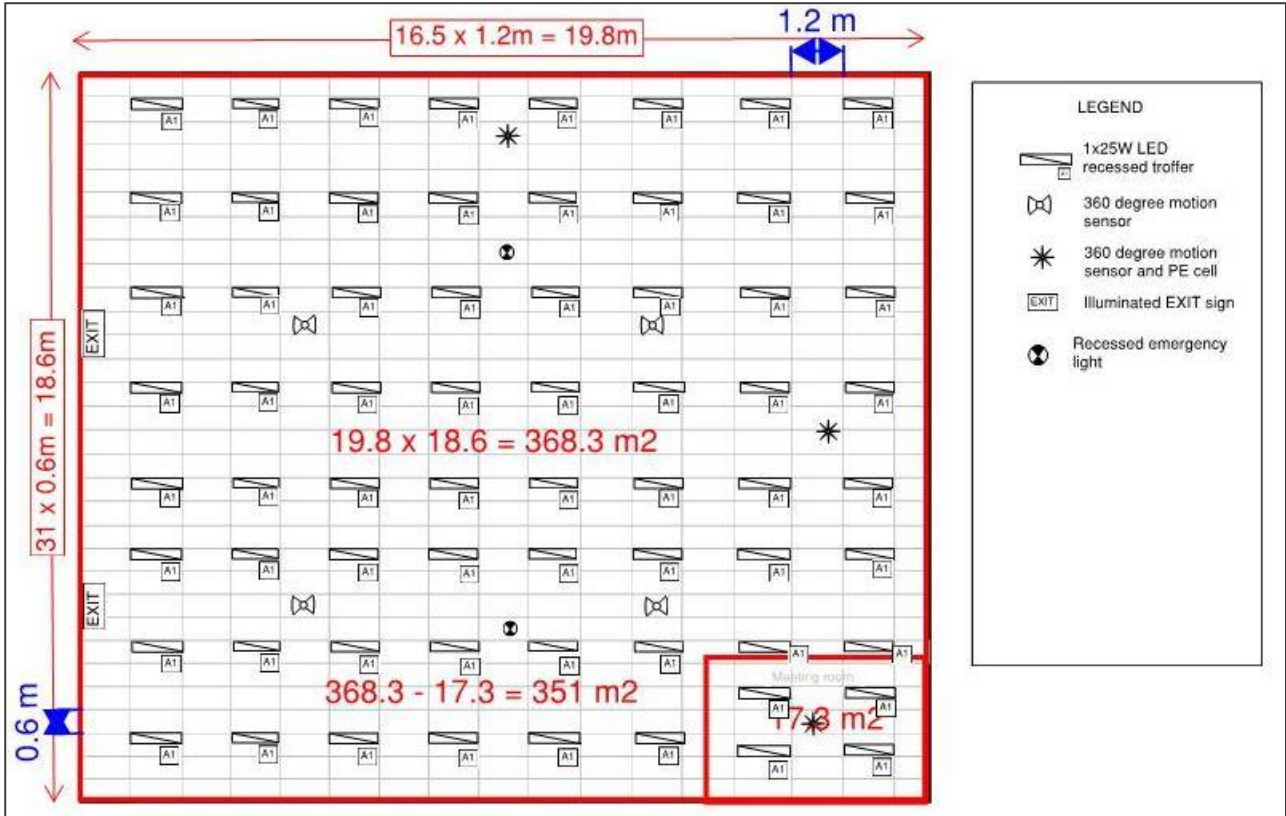

This is >100m<sup>2</sup> and as per *Figure 7* the controls in this space would be rated as ‘Moderate’.

If the sensors have not been marked on the plan, the **assessor** must mark them in, and provide a small legend to indicate the symbol used for the sensor, or a label beside each sensor marked.


If no plan is provided to the **assessor**, the assessor must sketch one up and mark in the position of the lights and the sensors.

A copy of the plan with the marked up measurements and sensors must be included with the TLA documentation with control zones marked.


*Figure 31* shows a plan with the lighting control zones marked in. When the lighting control zones are marked on the plan a more accurate assessment of the control zone size is possible.



**Figure 31: Plan with lighting control zones marked**

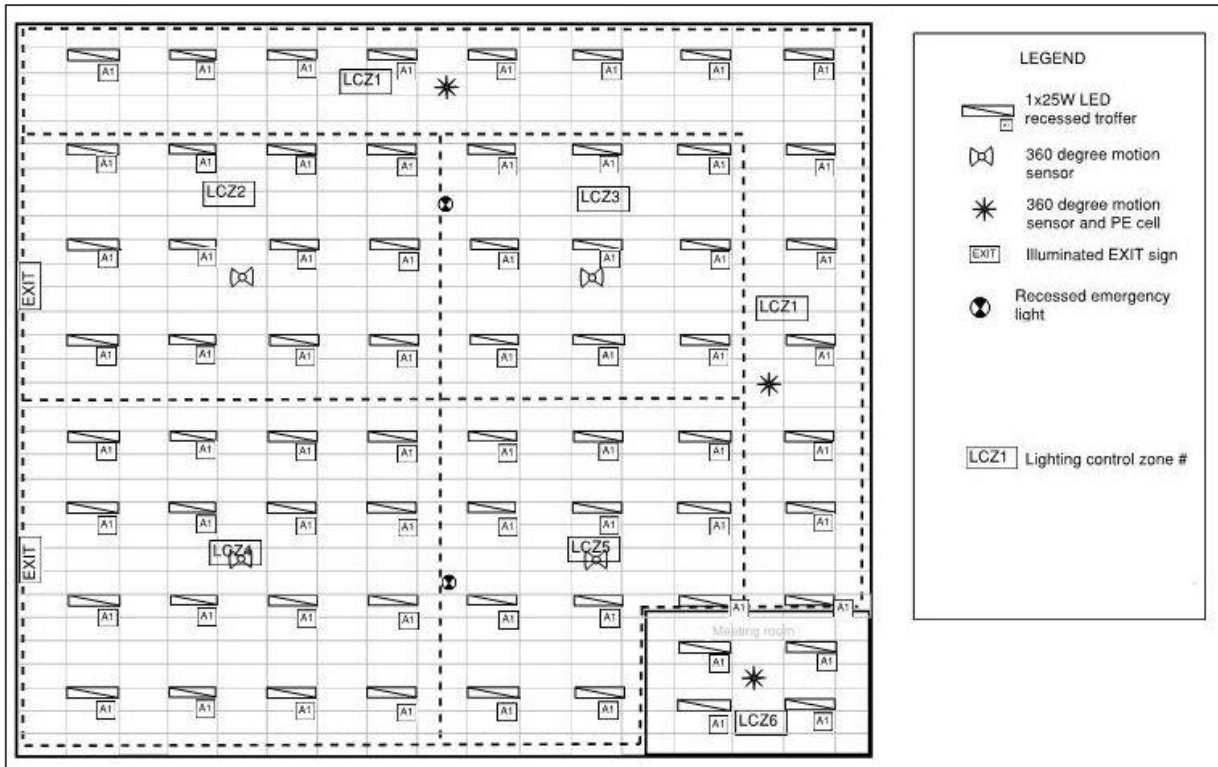

**Figure 32: Previous diagram with lighting control zone measurements shown**

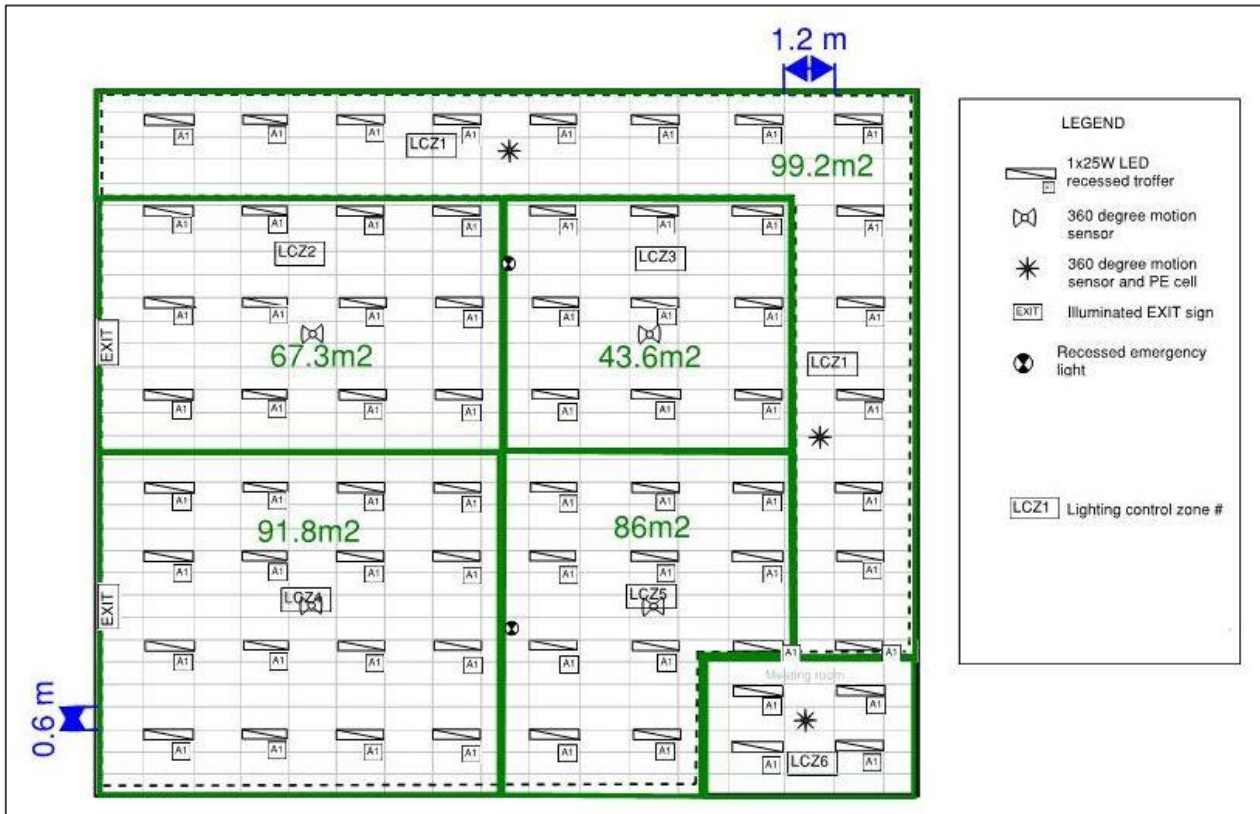

---

In *Figure 32* the ceiling tiles have been measured and are a standard size of 1.2m x 0.6m. By counting the number of ceiling tiles and using these dimensions the area of the lighting control zones has been calculated.


The maximum size of the lighting control zones is 99.2m<sup>2</sup>. This is <100m<sup>2</sup> and *Figure 7* indicates that the **control capacity** in this space would be rated as 'Good'.

A copy of the plan with the marked up measurements must be included in the TLA documentation.

### E-4 Plans of hard wired controls systems


In some cases the lighting plans may show the lighting control circuits, but not the lighting control zones. *Figure 33* shows a hard wired lighting controls system, which does not incorporate supervisory control. The lighting control zones are directly associated with the wiring of the circuit to each sensor. This plan shows the distribution board location and lighting circuit number for each circuit, and since each circuit has an occupancy sensor, the lighting circuits indicate the lighting control zone.

**Figure 33: Lighting plan showing lighting control circuits for hard wired sensor system**

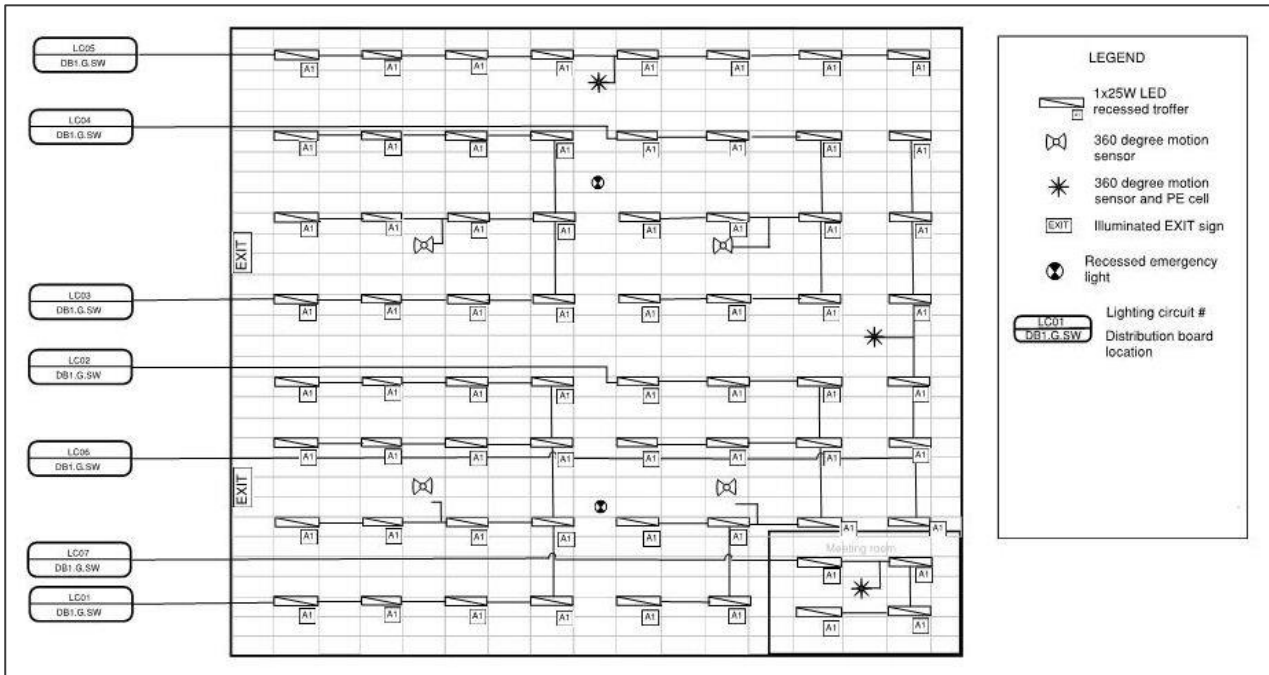

In *Figure 34* the respective the lighting control zones have been marked up around the lighting control circuits already marked on the plan.

**Figure 34: Previous diagram with lighting control zone measurements shown**

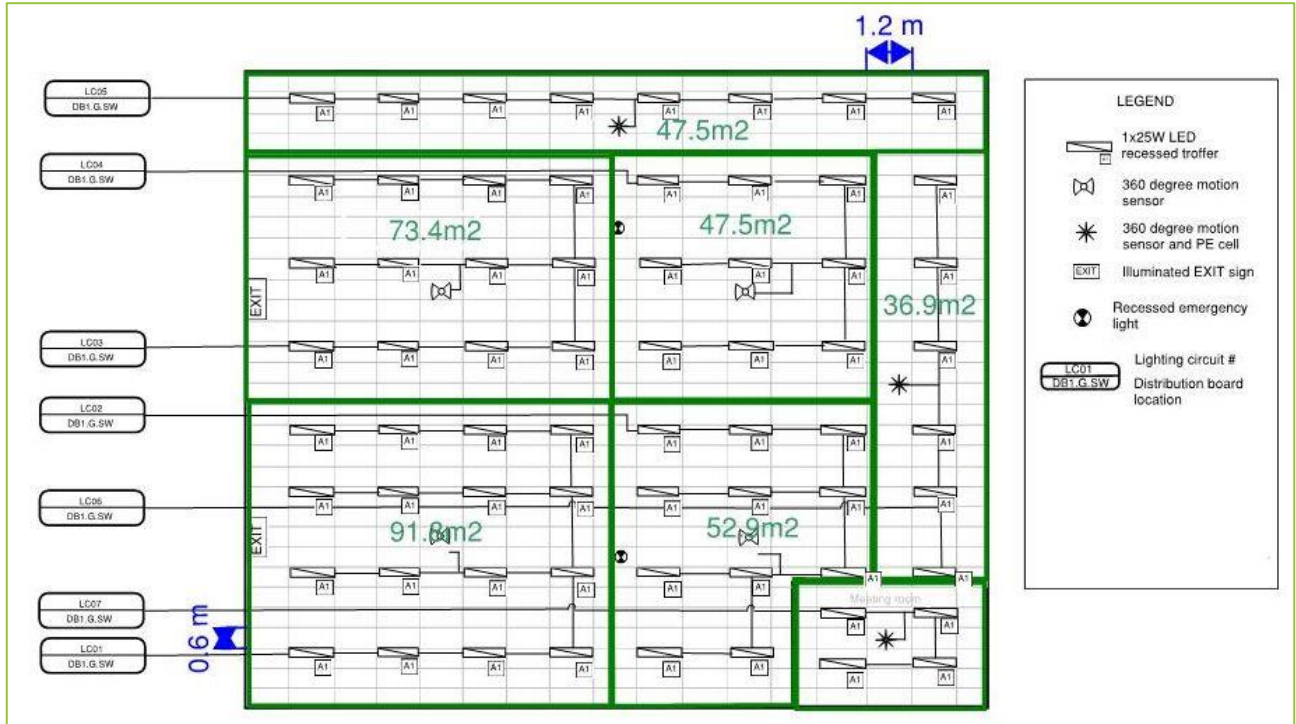

The ceiling tiles have been measured and are a standard size of 1.2m x 0.6m. By counting the number of ceiling tiles and using these dimensions the area of the lighting control zones has been calculated.


The maximum size of the lighting control zones is 91.8m<sup>2</sup>. This is <100m<sup>2</sup> and reference to the control assessment decision making tree in *Figure 7* indicates that the **control capacity** in this space would be rated as 'Good'.

A copy of the plan with the marked up measurements must be provided with the TLA documentation.

### E-5 Plans of supervisory (soft wired) controls systems

Figure 35 is a detailed plan of a supervisory (soft wired) controls system. These plans usually include mark ups of lighting circuits and lighting control zones, because in the case of a **supervisory controls system** these two systems are not necessarily the same. The plan in Figure 35 also shows a lighting control equipment address against every **luminaire** and sensor. This address is used by the lighting control software to assign **luminaires** and sensors to control zones.

**Figure 35: Detailed plan of a soft wired controls system**

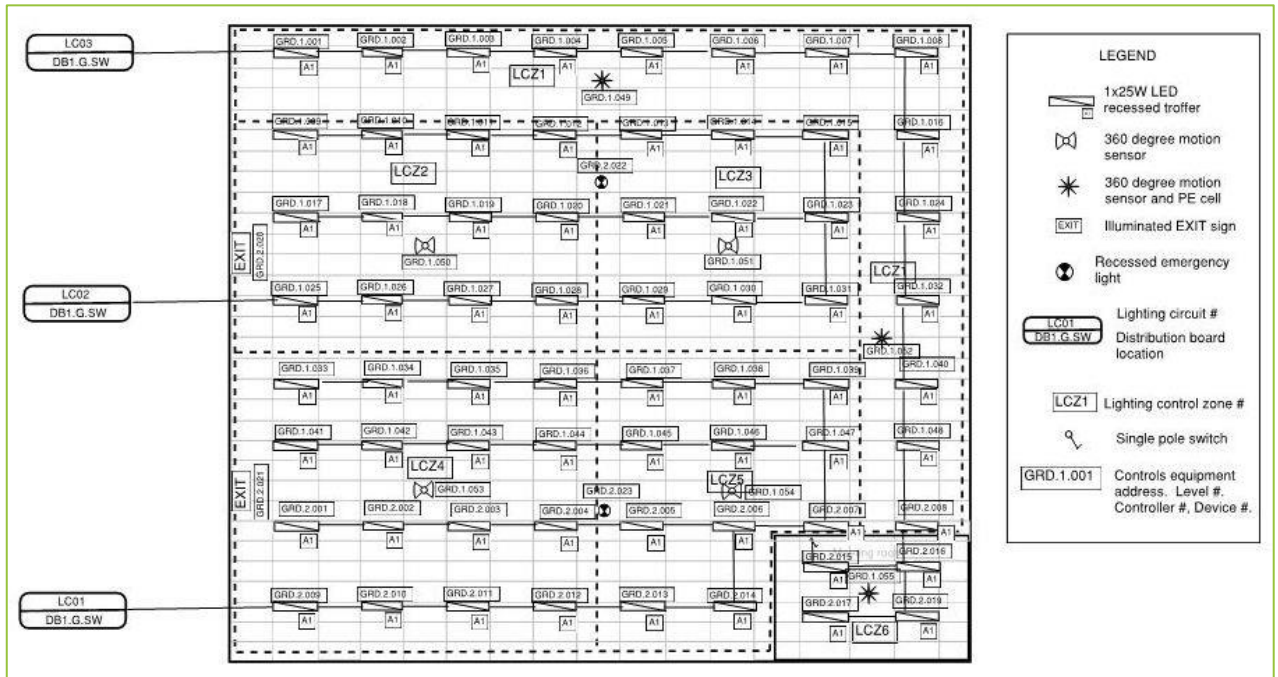


This detailed plan has control zones marked so calculating the control zone size is completed with the same methodology described in previous sections.

Occasionally, lighting plans are not as detailed as they could be. *Figure 36* shows a plan of a soft wired controls system with the lighting circuits shown, but no control zones marked. Multiple sensors are shown around large circuits, with no indication of which **luminaires** are controlled by each sensor.

This is because the link between the occupancy sensors and the luminaires is setup and maintained through programming in the BMS or head end computer’s software, not hard wired.

**Figure 36: Plan of a soft wired controls system showing lighting circuits, but no zones**

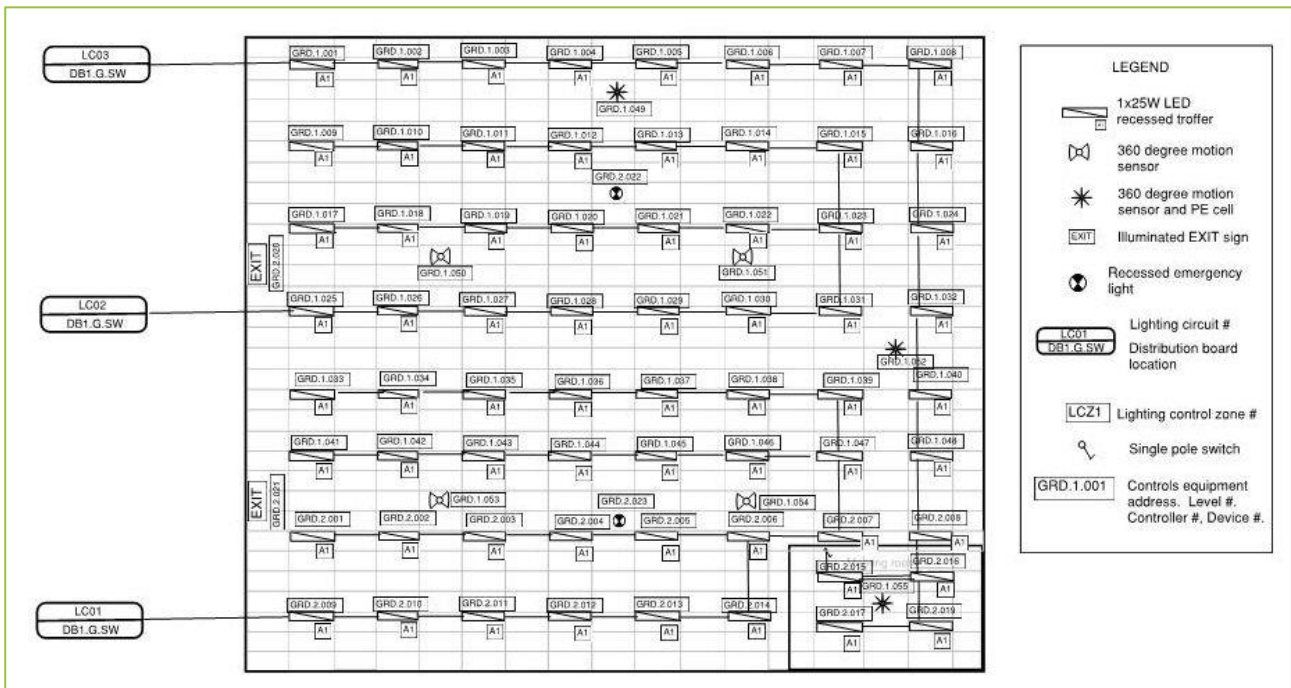


A list of equipment addresses and their location may be provided on the plan, or may be provided in a separate list. A list of the assigned lighting control zones for each of the address may also be available. If both of these are provided it may be possible to mark out the assigned lighting control zones on the lighting plan and calculate the control zone sizes.

In the absence of any more detailed information, the **luminaire** circuits shown on the plan must be used to assess the control zone size as described previously. In this case where multiple sensors control one circuit it should be treated as a single lighting control zone. This is because without any further evidence to show otherwise, the plan indicates that the entire circuit is to be operated by multiple sensors, keeping the entire zone on whenever there is an occupant at either end of the zone tripping the occupancy sensor.

In *Figure 37* the respective the lighting control zones have been marked up around the lighting control circuits already marked on the plan.

**Figure 37: Previous diagram with control zone measurements shown**

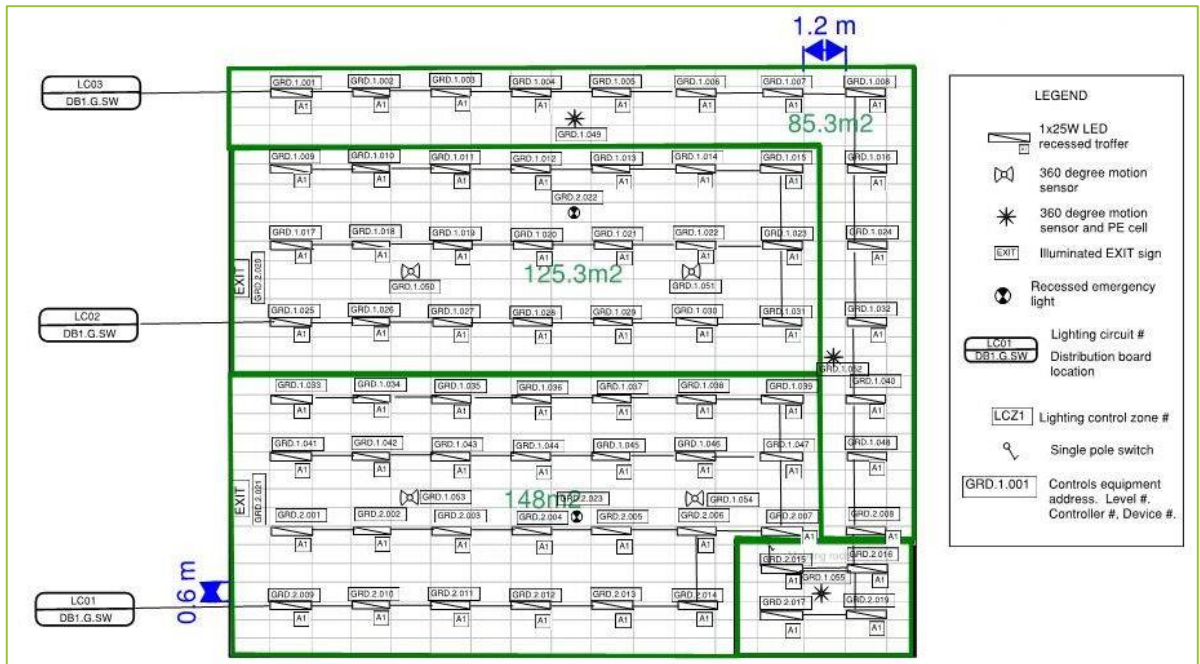


In *Figure 37* the ceiling tiles have been measured and are a standard size of 1.2mx0.6m. By counting the number of ceiling tiles and using these dimensions the area of the lighting control zones has been calculated.

Despite the presence of several sensors, the maximum size of the lighting control zones is 148m². This is >100m² and reference to *Figure 7* indicates that the **control capacity** in this space would be rated as 'Moderate'. A copy of the plan with the marked up measurements must be provided with the TLA documentation.

**E-6 Common symbols on lighting control plans**

Figure 38 shows some common symbols used on lighting control plans and RCPs.

**Figure 38: Common symbols used on lighting control plans**

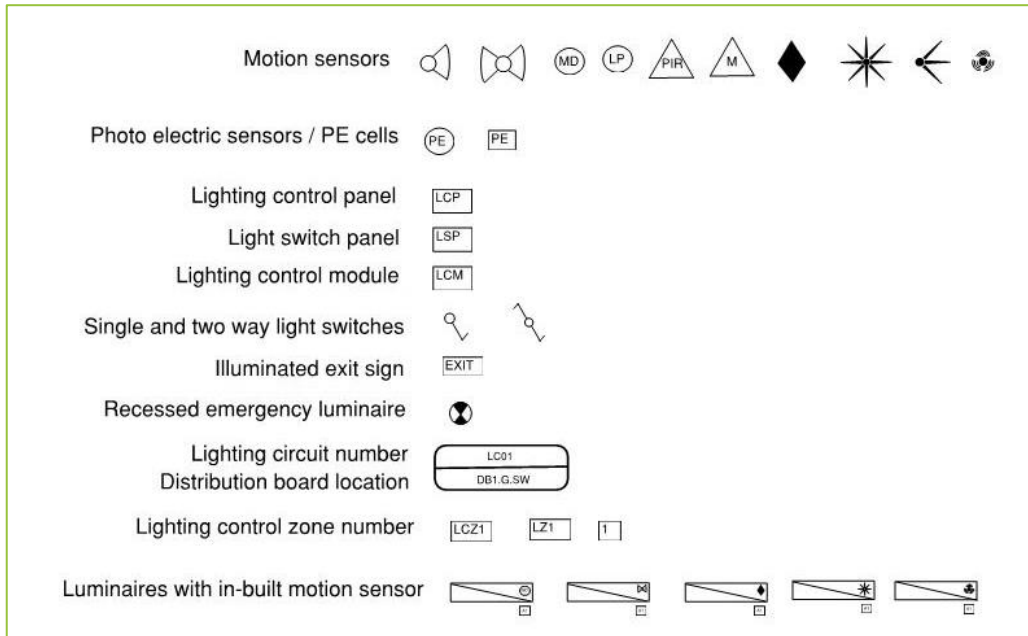




# Appendix F Example documentation storage and labelling methodology

There is a large amount of documentation required for an assessment. For this data to be useful to third parties and particularly for it to be auditable, it is essential that the data is well organised so that it can be cross referenced to calculations and selections made in the assessment. Although there is no prescriptive requirement for any particular approach to be adopted, failure to properly organise data for audit is adequate reason for an assessment to fail an audit.

A great deal of complexity can be avoided if the file structure for data storage is arranged logically. An example of a logical file structure is shown below. Note that use of this file structure significantly reduces the need to provide specific names for individual files, although basic file naming conventions will still improve the communication of the documentation.

**Assessors** are encouraged to collate evidence (photographs, plans and notes) using a suitable document management or audit management application.

**Figure 39: Recommended File Structure**

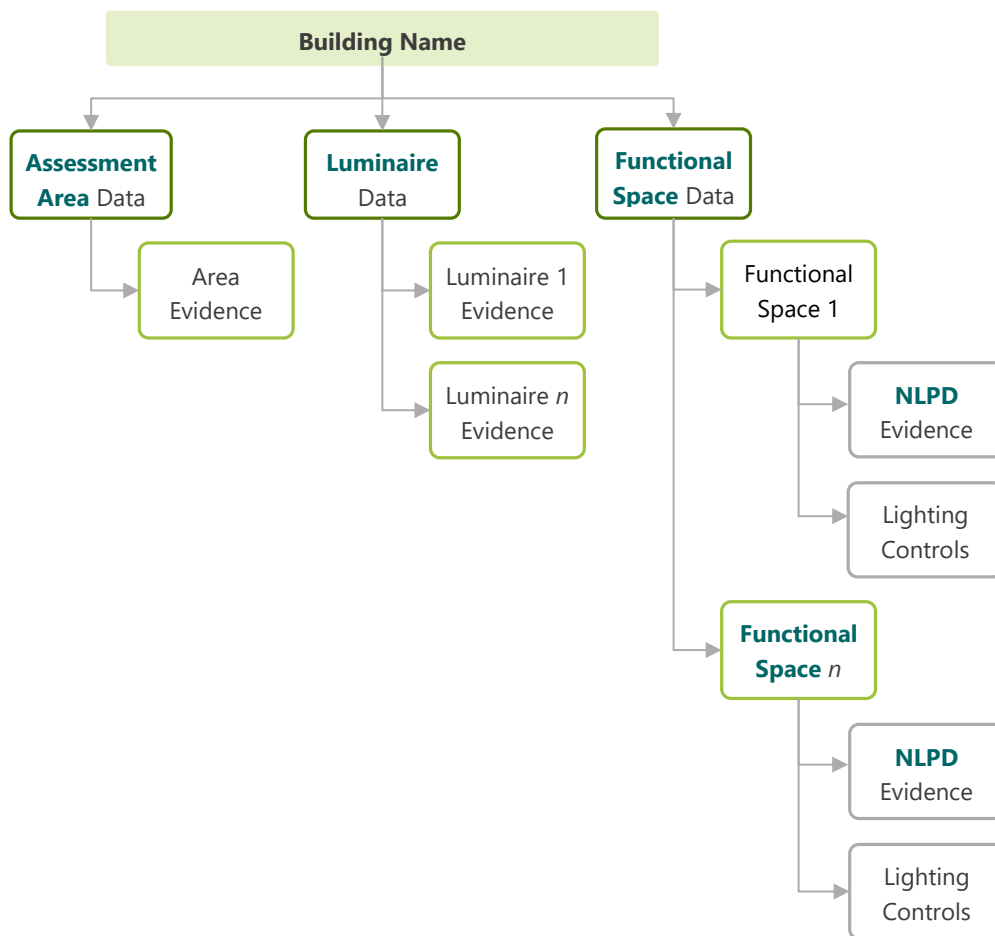

## Appendix G Examples of photographic evidence

Photographic evidence must be clear and must be able to demonstrate the features it is intended to demonstrate. The photographs below illustrate some examples of good and bad photographs. Note that a photograph that demonstrates one aspect of an assessment may not be suitable for demonstrating other aspects of the same assessment.



Photograph too blurry to show **lamp** power



Photograph too blurry to show **lamp** power



Number of **lamps** not visible



Number of **lamps** clearly visible




Lamp facing the wrong way, wattage not visible



Lamp wattage clearly visible



Grid not demonstrated

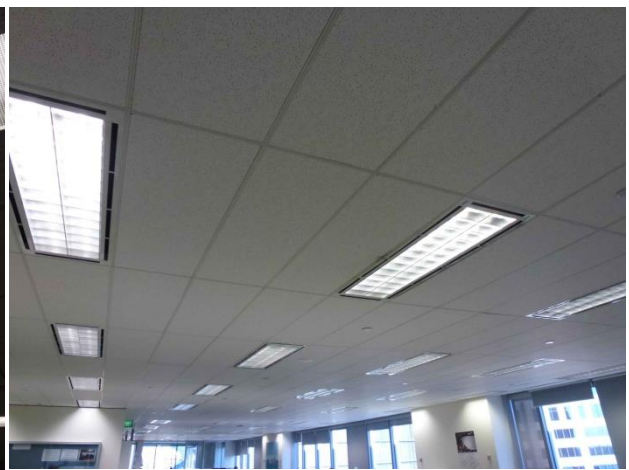

Grid clearly demonstrated




The CBD Administrator

Department of Industry, Science, Energy and Resources

GPO Box 2013

Canberra ACT 2601

 [info@cbd.gov.au](mailto:info@cbd.gov.au)

 1800 020 131

 [www.cbd.gov.au](http://www.cbd.gov.au)

